




# OM 402PWR

---

**4 DIGIT PROGRAMMABLE  
UNIVERSAL WATTMETER**

AC VOLTMETER/AMMETER  
NETS ANALYSER  
WATTMETERS

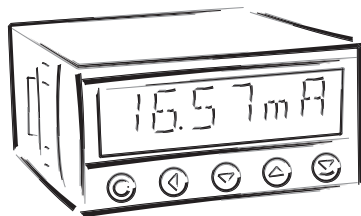



## SAFETY INSTRUCTIONS

Please, read the enclosed safety instructions carefully and observe them!  
These instruments should be safeguarded by isolated or common fuses (breakers)  
For safety information the EN 61 010-1 + A2 standard must be observed.  
This instrument is not explosion-safe!

## TECHNICAL DATA

Measuring instruments of the OM 402 series conform to the European regulation 89/336/EWG.

The instruments are up to the following European standards:

EN 55 022, class B

EN 61000-4-2, -4, -5, -6, -8, -9, -10, -11

Seismic capacity:

IEC 980: 1993, čl. 6

The instruments are applicable for unlimited use in agricultural and industrial areas.

## CONNECTION

Supply of energy from the main line has to be isolated from the measuring leads.



## ORBIT MERRET, spol. s r.o.

Vodnanská 675/30  
198 00 Prague 9  
Czech Republic

Tel: +420 - 281 040 200  
Fax: +420 - 281 040 299  
e-mail: orbit@merret.eu  
www.orbit.merret.eu



<b>1. CONTENTS</b> .....	<b>3</b>
<b>2. INSTRUMENT DESCRIPTION</b> .....	<b>4</b>
<b>3. INSTRUMENT CONNECTION</b> .....	<b>6</b>
Measuring ranges .....	6
Termination of RS 485 communication line .....	6
Instrument connection .....	7
Recommended connection of sensors .....	8
<b>4. INSTRUMENT SETTING</b> .....	<b>10</b>
Symbols used in the instructions .....	12
Setting the DP and the {} sign .....	12
Control keys function .....	13
Setting/permitting items into 'USER' menu .....	13
<b>5. SETTING "LIGHT" MENU</b> .....	<b>14</b>
5.0 Description "LIGHT" menu .....	14
Access to menu .....	16
Setting current value .....	16
Setting „Channel I“ - Current .....	18
Setting „Channel U“ - Voltage .....	19
Setting „Channel P“ - Power .....	21
Setting mathematic functions .....	22
Setting Limits .....	24
Setting analog output .....	26
Selection of programming menu „LIGHT“/„PROFI“ .....	28
Restoration of manufacture setting .....	28
Selection of instrument menu language version .....	29
Setting new access password .....	30
Instrument identification .....	30
<b>6. SETTING "PROFI" MENU</b> .....	<b>32</b>
6.0 Description of "PROFI" menu .....	32
6.1 "PROFI" menu - INPUT .....	
6.1.1 Resetting internal values .....	34
6.1.2 Setting measuring type, range, mode, rate .....	35
6.1.3 Setting the Real Time .....	37
6.1.4 External input function selection .....	38
6.1.5 Optional accessory functions of the keys .....	40
6.2 "PROFI" menu - CHANNEL .....	
6.2.1 Setting „Channel I“ - Current .....	46
6.2.2 Setting „Channel U“ - Voltage .....	50
6.2.3 Setting „Channel P“ - Power .....	50
6.2.4 Setting „Channel I“ - Frequency .....	51
6.2.5 Setting mathematic functions .....	52
6.2.6 Selection of evaluation of min/max. value .....	57
6.3 "PROFI" menu - OUTPUTS .....	
6.3.1 Setting data logging into memory .....	58
6.3.2 Configuration and setting the limits .....	60
6.3.3 Setting data output .....	64
6.3.4 Setting analog output .....	65
6.3.5 Setting display brightness .....	67
6.4 "PROFI" menu - SERVICE .....	
6.4.1 Selection of programming menu „LIGHT“/„PROFI“ .....	68
6.4.2 Restoration of manufacture setting .....	69
6.4.3 Selection of inst. menu language version .....	70
6.4.4 Setting new access password .....	70
6.4.5 Instrument identification .....	70
<b>7. SETTING "USER" MENU</b> .....	<b>72</b>
<b>8. DATA PROTOCOL</b> .....	<b>74</b>
<b>9. ERROR STATEMENTS</b> .....	<b>76</b>
<b>10. TABLE OF SYMBOLS</b> .....	<b>77</b>
<b>11. TECHNICAL DATA</b> .....	<b>78</b>
<b>12. INSTRUMENT DIMENSION AND INSTALLATION</b> . . .	<b>80</b>
<b>13. CERTIFICATE OF WARRANTY</b> .....	<b>81</b>

## 2. INSTRUMENT DESCRIPTION



### 2.1 DESCRIPTION

The OM 402PWR model is a universal 4-digit panel wattmeter with independent measuring of AC voltage/current, frequency, power factor and other quantities.

The instrument is based on an 8-bit microcontroller and precise RMS converter, which secures high accuracy, stability and easy operation of the instrument

#### PROGRAMMABLE PROJECTION

Measured quantities	voltage ( $V_{RMS}$ ) current ( $A_{RMS}$ ) active power (P) frequency (Hz)
with calculation	idle power (Q) apparent power (S) power factor (cos fi)
Measuring range:	adjustable as fixed or with automatic change
Setting:	manual, it is possible to set arbitrary projection on the display for maximum value of the input signal in the menu, e.g. input 0..250 V/0..5 A > 0..1500 kW
Projection:	-9999...9999

#### LINEARIZATION

Linearization by linear interpolation in 45 points/channel (solely via OM Link)

#### DIGITAL FILTERS

Floating average	from 2...30 measurements
Exponen.average	from 2...100 measurements
Rounding	setting the projection step for display

#### MATEMATICKÉ FUNKCE

Min/max. value	registration of min/max. value reached during measurement
Tare	designed to reset display upon non-zero input signal
Peak value	the display shows only max. or min. value
Mat. operations	polynome, $\sqrt{x}$ , logarithm, exponential, power, root, sin x

#### EXTERNAL CONTROL

Lock	control keys blocking
Hold	display/instrument blocking
Tare	tare activation/resetting tare to zero
Resetting MM	resetting min/max value

\* only for types DC, PM, DU

## 2.2 OPERATION

The instrument is set and controlled by five control keys located on the front panel. All programmable settings of the instrument are performed in three adjusting modes:

<b>LIGHT</b>	<p><b>Simple programming menu</b></p> <ul style="list-style-type: none"> <li>- contains solely items necessary for instrument setting and is protected by optional number code</li> </ul>
<b>PROFI</b>	<p><b>Complete programming menu</b></p> <ul style="list-style-type: none"> <li>- contains complete instrument menu and is protected by optional number code</li> </ul>
<b>USER</b>	<p><b>User programming menu</b></p> <ul style="list-style-type: none"> <li>- may contain arbitrary items selected from the programming menu (LIGHT/PROFI), which determine the right (see or change)</li> <li>- acces without password</li> </ul>

All programmable parameters are stored in the EEPROM memory (they hold even after the instrument is switched off).



Complete instrument operation and setting may be performed via OM Link communication interface, which is a standard equipment of all instruments.

The operation program is freely accessible ([www.orbit.merret.eu](http://www.orbit.merret.eu)) and the only requirement is the purchase of OML cable to connect the instrument to PC. It is manufactured in version RS 232 and USB and is compatible with all ORBIT MERRET instruments. Another option for connection is with the aid of data output RS 232 or RS 485 (without the need of the OML cable).

The program OM LINK in „Basic“ version will enable you to connect one instrument with the option of visualization and archiving in PC. The OM Link „Standard“ version has no limitation of the number of instruments connected.

## 2.3 OPTIONS

**Comparators** are assigned to monitor one, two, three or four limit values with relay output. The user may select limits regime: LIMIT/DOSING/FROM-TD. The limits have adjustable hysteresis within the full range of the display as well as selectable delay of the switch-on in the range of 0...99,9 s. Reaching the preset limits is signalled by LED and simultaneously by the switch-on of the relevant relay.

**Data outputs** are for their rate and accuracy suitable for transmission of the measured data for further projection or directly into the control systems. We offer an isolated RS232 and RS485 with the ASCII or DIN MessBus protocol.

**Analog outputs** will find their place in applications where further evaluating or processing of measured data is required in external devices. We offer universal analog output with the option of selection of the type of output - voltage/current. The value of analog output corresponds with the displayed data and its type and range are selectable in Menu.

**Measured data record** is an internal time control of data collection. It is suitable where it is necessary to register measured values. Two modes may be used. FAST is designed for fast storage (40 records/s) of all measured values up to 8 000 records. Second mode is RTC, where data record is governed by Real Time with data storage in a selected time segment and cycle. Up to 250 000 values may be stored in the instrument memory. Data transmission into PC via serial interface RS232/485 and OM Link.

### 3. INSTRUMENT CONNECTION



The instrument supply leads should not be in proximity of the incoming low-potential signals.

Contactors, motors with larger input power should not be in proximity of the instrument.

The leads into the instrument input (measured quantity) should be in sufficient distance from all power leads and appliances. Provided this cannot be secured it is necessary to use shielded leads with connection to ground (bracket E).

The instruments are tested in compliance with standards for use in industrial area, yet we recommend to abide by the above mentioned principles.

#### MEASURING RANGES


RANGE	INPUT 1 - „I“	INPUT 2 - „U“	INPUT 3 - „U“
K	0...60/150/300 mV		
P	0...1/2,5/5 A		
S		0...10 V	0...120 V
U		0...250 V	0...450 V


#### Termination of RS 485 communication line

##### X3 - Termination of communication line RS 485

Full	Significance	Default	Recommendation
1-2	connect L+ to (+) source	terminalconnected	
3-4	termination of line 120 Ohm	disconnected	connect at the end of line
5-6	connect L- to (-) source	terminalconnected	do not disconnect

RS 485 line should have a linear structure - wires (ideally shielded and twisted) should lead from one device to another.



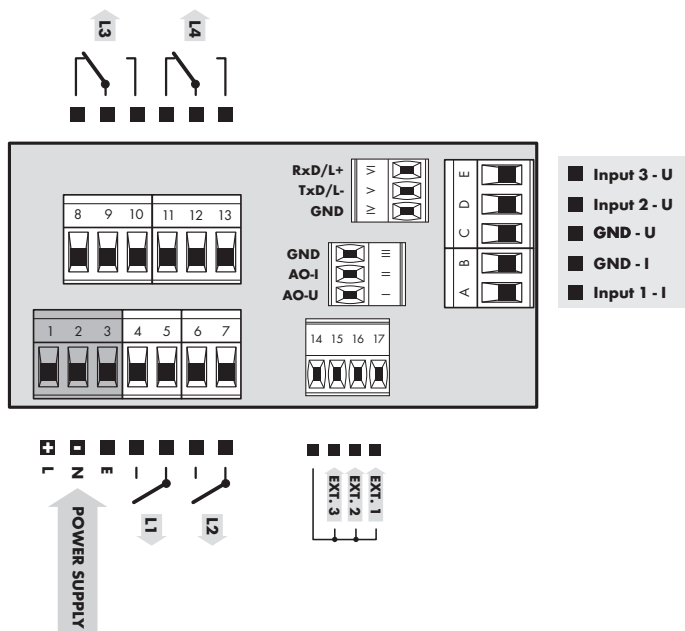


Clips GND - U and GND - I have galvanic connection

In case of connecting clips GND - U or GND - I to a phase, on this potential is subsequently the connector DM Link and secondary inputs.  
It is necessary to abide by the precautions of hazardous contact with active parts of the instrument in compliance with relevant standards and regulations


### 3. INSTRUMENT CONNECTION




#### Connection for measuring on one phase

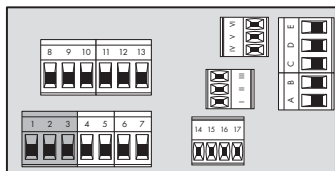


- Input 3 - U
- Input 2 - U
- GND - U
- GND - I
- Input 1 - I



#### Connection for measuring on three phase

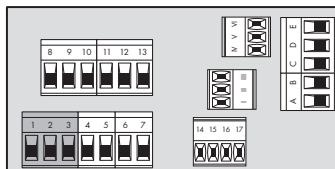

- Input 3 - U
- Input 2 - U
- GND - U
- GND - I
- Input 1 - I









## SETTING **PROFI**

For expert users

Complete instrument menu

Access is password protected

Possibility to arrange items of the **USER MENU**

Tree menu structure

## SETTING **LIGHT**

For trained users

Only items necessary for instrument setting

Access is password protected

Possibility to arrange items of the **USER MENU**

Linear menu structure

## SETTING **USER**

For user operation

Menu items are set by the user (Profi/Light) as per request

Access is not password protected

Optional menu structure either tree (PROFI) or linear (LIGHT)

## 4.1 SETTING

The instrument is set and controlled by five control keys located on the front panel. All programmable settings of the instrument are performed in three adjusting modes:


- LIGHT**      **Simple programming menu**  
 - contains solely items necessary for instrument setting and is protected by optional number code
- PROFI**      **Complete programming menu**  
 - contains complete instrument menu and is protected by optional number code
- USER**      **User programming menu**  
 - may contain arbitrary items selected from the programming menu (LIGHT/PROFI), which determine the right (see or change)  
 - access without password

All programmable parameters are stored in the EEPROM memory (they hold even after the instrument is switched off).

Complete instrument operation and setting may be performed via QM Link communication interface, which is a standard equipment of all instruments.


The operation program is freely accessible ([www.orbit.merret.cz](http://www.orbit.merret.cz)) and the only requirement is the purchase of QML cable to connect the instrument to PC. It is manufactured in version RS 232 and USB and is compatible with all ORBIT MERRET instruments. Another option for connection is with the aid of data output RS 232 or RS 485 (without the need of the QML cable).

## Scheme of processing the measured signal

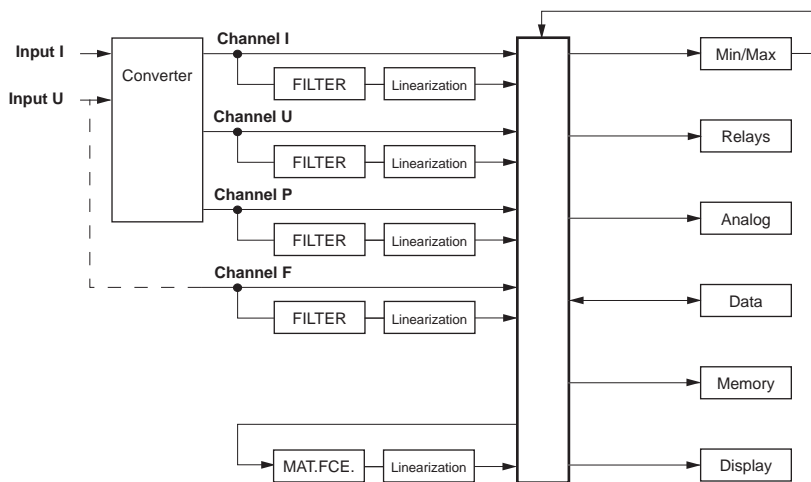

## 4. INSTRUMENT SETTING

Setting and controlling the instrument is performed by means of 5 control keys located on the front panel. With the aid of these keys it is possible to browse through the operation menu and to select and set required values.

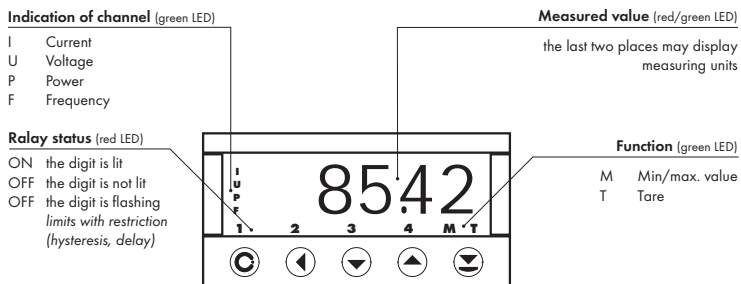

### Symbols used in the instructions



values preset from manufacture



symbol indicates a flashing light (symbol)



inverted triangle indicates the item that can be placed in USER menu



broken line indicates a dynamic item, i.e. it is displayed only in particular selection/version



after pressing the key the set value will not be stored



after pressing the key the set value will be stored



continues on page 30

### Setting the decimal point and the minus sign

#### DECIMAL POINT

Its selection in the menu, upon modification of the number to be adjusted it is performed by the control key with transition beyond the highest decade, when the decimal point starts flashing. Positioning is performed by .

#### THE MINUS SIGN

Setting the minus sign is performed by the key on higher decade. When editing the item subtraction must be made from the current number (e.g.: 013 > , on class 100 > -87)

## Control keys functions

KEY	MEASUREMENT	MENU	SETTING NUMBERS/SELECTION
	access into USER menu	exit menu	quit editing
	programmable key function	back to previous level	move to higher decade
	programmable key function	move to previous item	move down
	programmable key function	move to next item	move up
	programmable key function	confirm selection	confirm setting/selection
			numeric value is set to zero
	access into LIGHT/PROFI menu		
	direct access into PROFI menu		
		configuration of an item for "USER" menu	
		determine the sequence of items in "USER - LIGHT" menu	

## Setting items into „USER" menu

- in **LIGHT** or **PROFI** menu
- no items permitted in **USER** menu from manufacture
- on items marked by inverted triangle

## USER



<b>NO</b>	item will not be displayed in USER menu
<b>YES</b>	item will be displayed in USER menu with the option of setting
<b>SHOW</b>	item will be solely displayed in USER menu



# SETTING LIGHT

For trained users

Only items necessary for instrument setting

Access is password protected

Possibility to arrange items of the **USER MENU**

Linear menu structure

## PROJECTION OF MEASURING UNITS ON THE DISPLAY

	MULTIPLYING CONSTANT		
	MILJ (0,001)	WITHOUT (1)	KILO (1000)
"CHANNEL I" - CURRENT	mA	A	kA
"CHANNEL U" - VOLTAGE	mV	V	kV
"CHANNEL P" - ACTIVE POWER	mW	W	kW
"CHANNEL FR" - FREQUENCY	Hz	Hz	Hz
"S" - APPARENT POWER	mVA	VA	kVA
"Q" - IDLE POWER	mVr	VAr	kVr
"COS FI" - POWER FACTOR	-	-	-

Access password  
 1428

Range "Channel P"   Range for "Channel U"   AC filter

Projection for "Channel I"   Multiplying const for "Channel I"   Decimal point for "Channel I"

Projection for "Channel U"   Multiplying const for "Channel U"   Decimal point for "Channel U"

Calculation of 3-phase power   Multiplying const for "Channel P"   Decimal point for "Channel P"

Select input for "Mat. funkce"   Multiplying const for "Mat. funkce"   Decimal point for "Mat. funkce"

Option - comparator

Option - Analog output

Menu type   Return to manufacture calibration   Return to manufacture setting

Language selection   New password

Identification   Type of instruments  SW: version  Input   Return to measuring mode


## Preset from manufacture

Password	"0"
Menu	LIGHT
USER menu	OFF
Setting the items	<b>DEF</b>
Preset	"POWER"




Upon delay exceeding 60 s the programming mode is automatically discontinued and the instrument itself restores the measuring mode

## 5. SETTING LIGHT

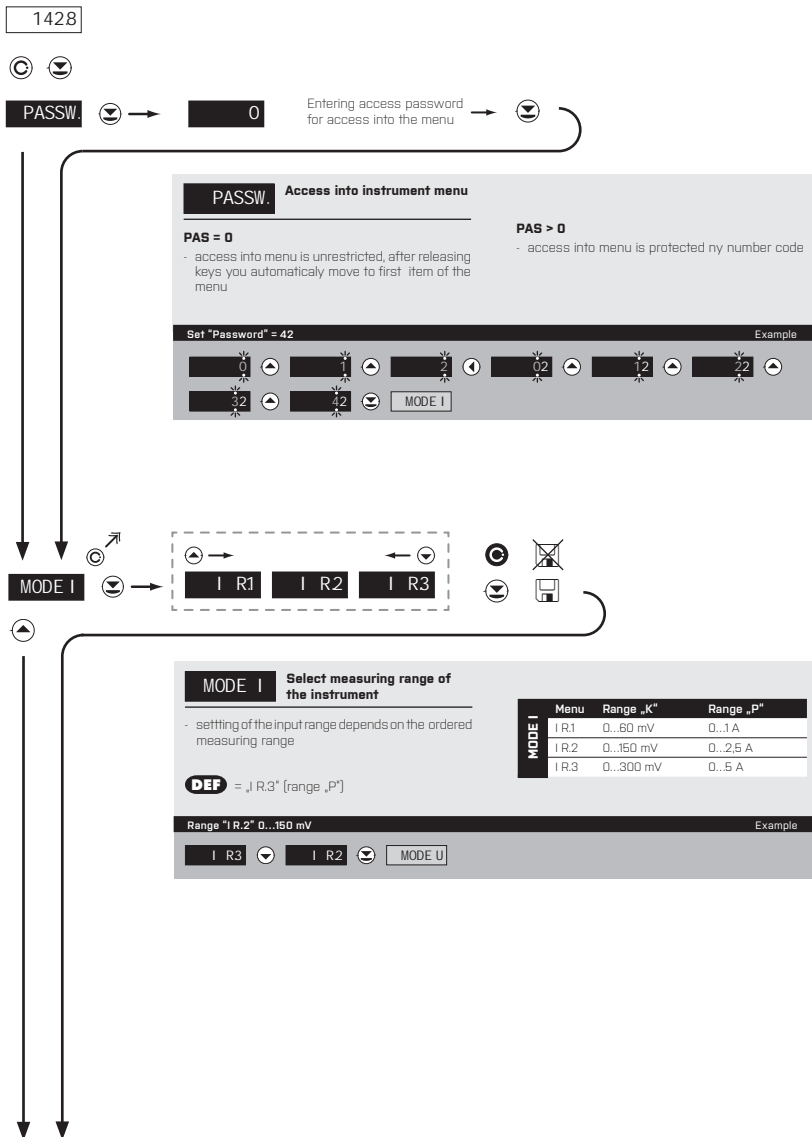



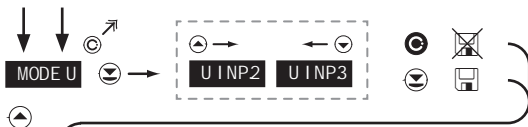

**MODE U** Select measuring range of the instrument


- setting of the input range depends on the ordered measuring range

**DEF** = U INP3

U	Menu	Range „S“	Range „U“
MODE	U INP2	0...10 V	0...250 V
	U INP3	0...120 V	0...450 V

Range 0...250 V Example

U INP3 U INP2 AC.FIL

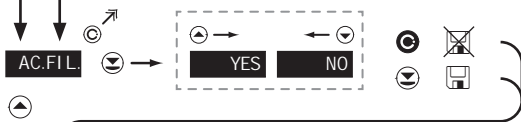

**AC.FIL** Input filter function - suppressing the DC component

- allows for measurement solely of the AC component

**DEF** = NO

NO Filter is off

- measures both the DC and the AC component of the input signal

YES Filter is on

- measures solely the AC component of input signal

Measurement of alternating component only Example

NO YES MAX I

## 5. SETTING PROFI



**MAX I** Setting display projection for maximum value of input current

**DEF** = 5

- range of the setting: -999...9999
- position of the DP does not affect display projection

Projection for 150 mV > Max = 3500 Example

5	4	3	2	1	0
00	000	100	200	300	400
500	0500	1500	2500	3500	PREF.1



**PREF. I** Select the multiplying constant


- the constant allows for another mathematical calculation with the option of extended projection of measuring units, display projection

**DEF** = 1 [- NULL]

m-MI LI	Constant 0,001 prefix "m" added
- NULL	Constant 1 without prefix
K-KI LO	Constant 1000 prefix "K" added

Multiplying constant 1000 > PREF. I = K-KI LO Example

- NULL | K-KI LO | FORM.1

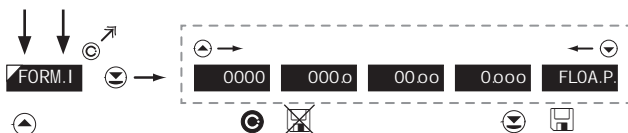

**FORM.I** Setting projection of the decimal point **DEF** = 00.00

- positioning of the DP is set here in the measuring mode

Projection of DP on display > 000.0 Example

00.00 000.0 MAX U



**MAX U** Setting display for maximum value of input voltage **DEF** = 450

- range of the setting is -999...9999

- position of the DP does not affect display projection

Projection for 450 V > MAX U = 1000 Example

450	450	450	470	490	490
500	400	300	200	100	000
0000	1000	PREF U			

## 5. SETTING LIGHT



**PREF.U** **Select multiplying constant**


- the constant allows for another mathematical calculation with the option of extended projection of measuring units, display projection

**DEF** = 1 [- NULL]

m-MI LI	Constant 0,001 prefix "m" added
- NULL	Constant 1 without prefix
K-KI LO	Constant 1000 prefix "k" added

Multiplying constant 1000 > PREF. U = K-KILO Example

-NULL ◀ K-KI LO ▶ FORM.U

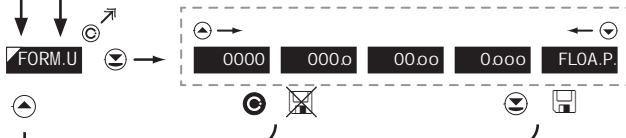


**FORM.U** **Setting projection of the decimal point**

- positioning of the DP is set here in the measuring mode

**DEF** = 000.0

Projection of DP on display > 0000 Example

000.0 ▶ 0000 ▶ 3FGRI D

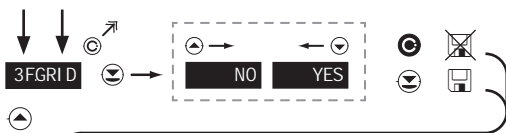

**3FGRID** Select calculation for 3-phase network

**DEF** = NO

Calculation is inactive  
 Calculation is active

- value is calculated with presumption of balanced take-off in all phases
- for P, S Q the value is multiplied by 3x

Calculation for 3-phase network > 3F\_GRID = YES Example



**PREF.P** Select multiplying constant


- the constant allows for another mathematical calculation with the option of extended projection of measuring units, display projection

**DEF** = 1[- NULL]

Constant 0,001 prefix "m" added  
 Constant 1 without prefix  
 Constant 1000 prefix "K" added

Multiplying constant 1000 > PREF.P = K-KILO Example

## 5. SETTING LIGHT

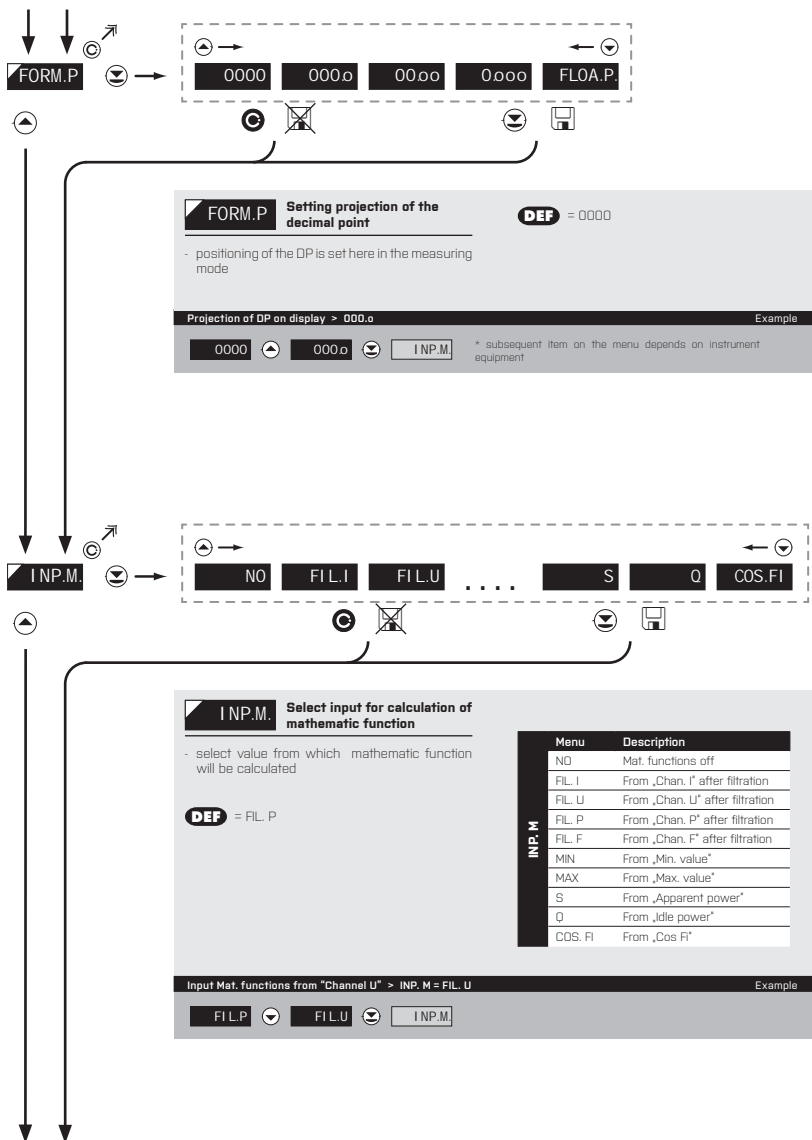

The diagram illustrates the navigation path for setting the multiplying constant and the decimal point projection. It starts with a main menu containing 'PREF.M.' and 'FORM.M.' options. Arrows indicate the sequence of selections and screen transitions.

**Top Section: PREF.M. - Select multiplying constant**

The initial selection is **PREF.M.**, which leads to a menu with options: **m-MI LI**, **-BEZ**, and **K-KI LO**. A dashed box highlights these options. Below this menu is a detailed screen for selecting the multiplying constant.

**Select multiplying constant**

- m-MI LI**: Constant 0,001 prefix "m" added
- NULL**: Constant 1 without prefix
- K-KI LO**: Constant 1000 prefix "K" added

**DEF** = 1 [- NULL]

Example: Multiplying constant 1000 > PRE. I = K.KILO

Navigation buttons: **- NULL**, **K-KI LO**, **FORM.M.**

**Bottom Section: FORM.M. - Setting projection of the decimal point**

The initial selection is **FORM.M.**, which leads to a menu with options: **000000**, **00000o**, **0000o0**, **000o0o**, **00o0o0**, **0o0o00**, and **FLOA.P.**. A dashed box highlights these options. Below this menu is a detailed screen for setting the decimal point projection.

**Setting projection of the decimal point**

**DEF** = FLOA.P.


Example: Projection of DP on display > 000000

Navigation buttons: **FLOA.P.**, **000000**, **MENU**

\*subsequent item on the menu depends on instrument equipment


## 5. SETTING LIGHT

DISPLAYED ONLY WITH OPTIONS > COMPARATORS

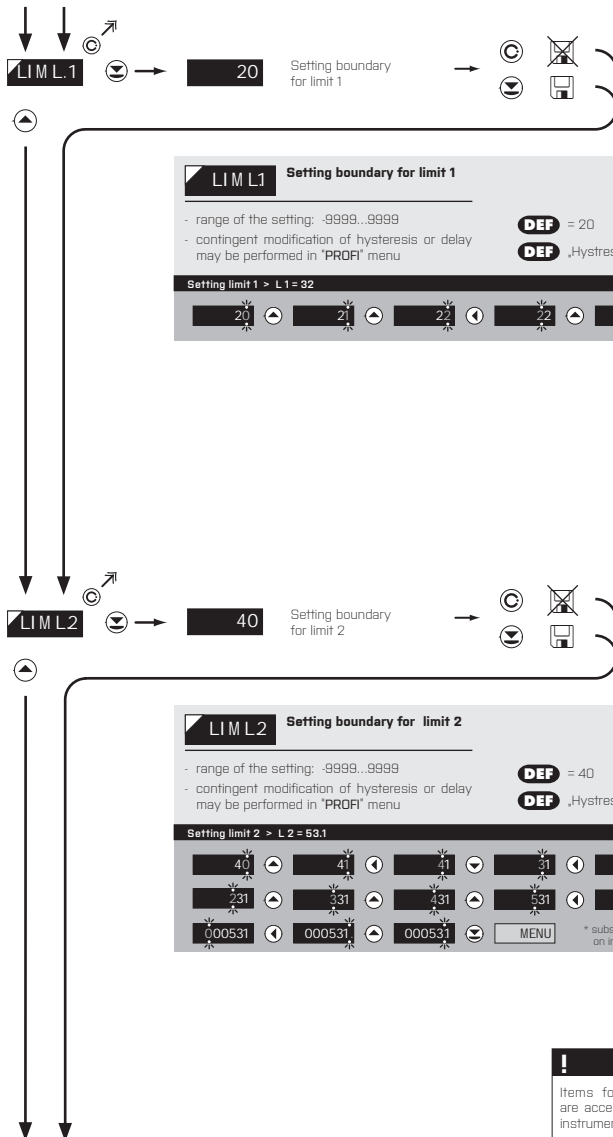

**!**  
Items for "Limits" and "Analog output" are accessible only if incorporated in the instrument.





**LIM L3** Setting boundary for limit 3


- range of the setting: -9999...9999
- contingent modification of hysteresis or delay may be performed in "PROF" menu

**DEF** = 60

**DEF** „Hysteresis“=0, „Delay“=0

Setting limit 3 > L 3 = 85 Example

60	61	62	63	64	65	
65	75	85	MENU	* subsequent item on the menu depends on instrument equipment		



**LIM L4** Setting boundary for limit 4

- range of the setting: -9999...9999
- contingent modification of hysteresis or delay may be performed in "PROF" menu

**DEF** = 80

**DEF** „Hysteresis“=0, „Delay“=0

Setting limit 4 > L 4 = 103 Example

80	81	82	83	83	93	
03	003	103	MENU	* subsequent item on the menu depends on instrument equipment		

## 5. SETTING LIGHT

DISPLAYED ONLY WITH OPTIONS > ANALOG OUTPUT

**TYP.A.O.** Setting the type of analog output

Menu	Range	Description
0-20mA	0...20 mA	
Er4-T	4...20 mA	with error message indication and broken loop indication (<3,6 mA)
4-20T	4...20 mA	with broken loop indication (<3,6 mA)
Er4-20	4...20 mA	with indication of error statement (<3,6 mA)
4-20mA	4...20 mA	
0.5mA	0...5 mA	
0.2 V	0...2 V	
0.5 V	0...5 V	
0-10 V	0...10 V	
+10 V	±10 V	

**DEF** = 4...20 mA

Type of analog output - 0...10 V > TYP. A.O. = 0-10 V Example

4-20mA   0-5mA   0-2 V   0-5 V   0-10 V   MIN.A.O.

**MIN.A.O.** Assigning the display value to the beginning of the AD range

**DEF** = 0

- range of the setting: -9999...9999

Display value for the beginning of the AD range > MIN.A.O. = 0 Example

0   MAX.A.O.

**!**

Items for "Limits" and "Analog output" are accessible only if incorporated in the instrument.



**MAX A.D.** Assigning the display value to the end of the AD range

- range of the setting: -9999...9999


**DEF** = 100

Display value for the end of the AD range > MAX A.D. = 120 Example

100 100 110 120 MENU

DISPLAYED ONLY WITH OPTIONS > ANALOG OUTPUT

## 5. SETTING LIGHT

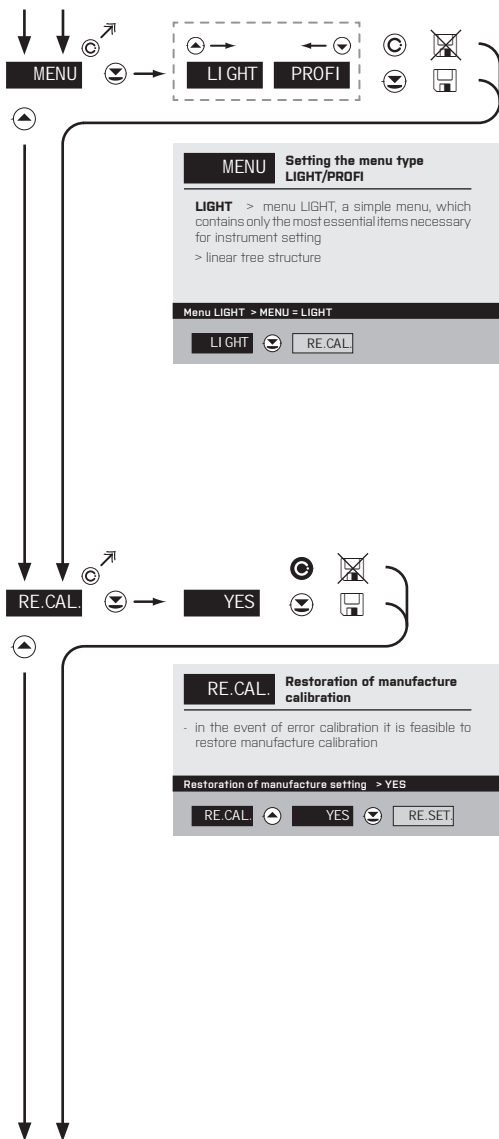



### RE.SET. Restoration of manufacture instrument setting

- in the event of error setting or calibration it is possible to return to manufacture setting. Prior to execution of changes you will be asked to confirm your selection (YES)
- reading manufacture calibration and primary setting of items in menu (DEF)

Restore manufacture

#### Presetting constants and evaluation

- presetting "source" for further evaluation (e.g.: select "VOLTAGE" > evaluation of limits, analog, min/max. value, etc... from "Channel U")

**POWER** Setting for measurement of power output - "Channel P"


**VOLTAG.** Setting for measurement of voltage - "Channel U"

**CURREN.** Setting for measurement of current - "Channel I"

Restoration of manufacture setting > POWER

Example

**POWER** **LANG.**



### LANG. Selection of language in instrument menu

- selection of language version of the instrument menu


**DEF** = ENGL.

Language selection - ENGLISH > LANG. = ENGL.

Example

**CZECH** **ENGL.** **PAS.LI**

## 5. SETTING LIGHT

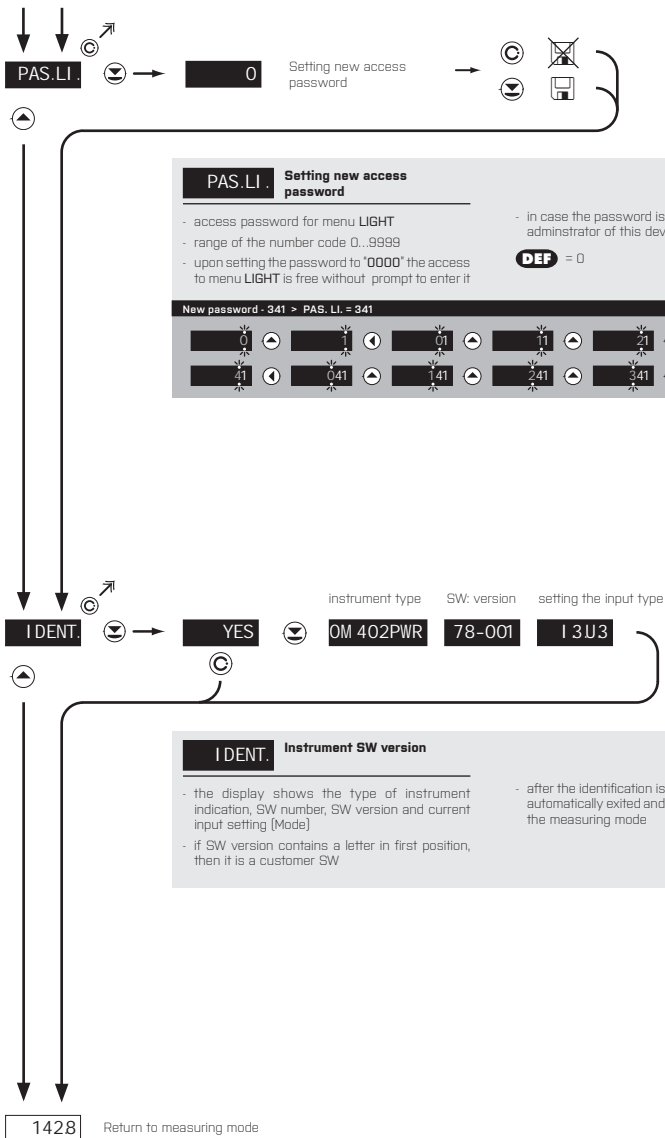





# SETTING **PROFI**

For expert users

Complete instrument menu

Access is password protected

Possibility to arrange items of the **USER MENU**

Tree menu structure

### 6.0

#### SETTING "PROFI"

#### **PROFI**

##### **Complete programming menu**

- contains complete instrument menu and is protected by optional number code
- designed for expert users
- preset from manufacture is menu **LIGHT**

#### Switching over to "PROFI" menu



- access to **PROFI** menu
- authorization for access to **PROFI** menu does not depend on setting under item **SERVIC. > MENU**
- password protected access (unless set as follows under the item **SERVIC. > N. PASS. > PROFI =0**)



- access to menu selected under item **SERVIC. > MENU > LIGHT/PROFI**
- password protected access (unless set as follows under the item **SERVIC. > N. PASS. > LIGHT =0**)
- for access to **LIGHT** menu passwords for **LIGHT** and **PROFI** menu may be used




**PROJECTION OF MEASURING UNITS ON THE DISPLAY**

	MULTIPLYING CONSTANT		
	MILI (0,001)	WITHOUT (1)	KILO (1000)
"CHANNEL I" - CURRENT	mA	A	kA
"CHANNEL U" - VOLTAGE	mV	V	kV
"CHANNEL P" - ACTIVE POWER	mW	W	kW
"CHANNEL FR" - FREQUENCY	Hz	Hz	Hz
"S" - APPARENT POWER	mVA	VA	kVA
"Q" - IDLE POWER	mVr	VAR	kVr
"COS FI" - POWER FACTOR	-	-	-

## 6. SETTING PROFI


### 6.1 SETTING "PROFI" - INPUT



The primary instrument parameters are set in this menu


<b>CLEAR</b>	Resetting internal values
<b>CONFIG.</b>	Selection of measuring range and parameters
<b>RTC</b>	Setting date and time for option with RTC
<b>EXT.IN.</b>	Setting external inputs functions
<b>KEYS</b>	Assigning further functions to keys on the instrument

### 6.1.1 RESETTING INTERNAL VALUES

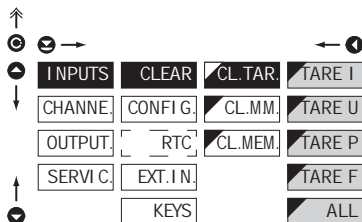


**CLEAR** Resetting internal values

<b>TARE I</b>	Tare resetting Channel - Current
<b>TARE U</b>	Tare resetting Channel - Voltage
<b>TARE P</b>	Tare resetting Channel - Power
<b>TARE F</b>	Tare resetting Channel - Frequency
<b>ALL</b>	Tare resetting on all channels
<b>CL.MM.</b>	Resetting min/max value
- resetting memory for the storage of minimum and maximum value achieved during measurement	
<b>CL.MEM.</b>	Resetting the instrument memory
- resetting memory with data measured in the "FAST" or "RTC" modes	
- not in standard equipment	



## 6.1.2a SELECT MEASURING MODE - MEASURING CHANNEL I

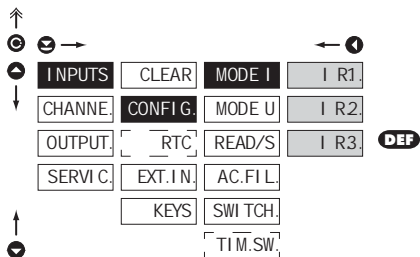


## MODE I Select measuring mode - Current

- selection of measuring range depends on the ordered version

I R1.	Range 1 0...60 mV/1 A
I R2.	Range 2 0...160 mV/2,5 A
I R3.	Range 3 0...300 mV/5 A

## 6.1.2b SELECT MEASURING RANGE - MEASURING CHANNEL U

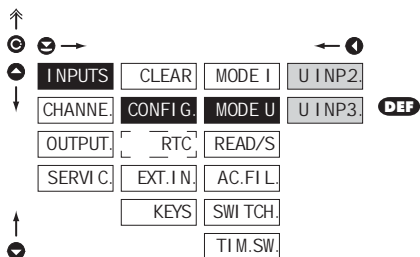


## MODE U Select measuring mode - Voltage

- selection of measuring range [input] depends on the ordered version

U I NP2	Voltage input 2 0...10 V/250 V
U I NP3	Voltage input 3 0...120 V/450 V

## 6.1.2c SELECTION OF MEASURING RATE

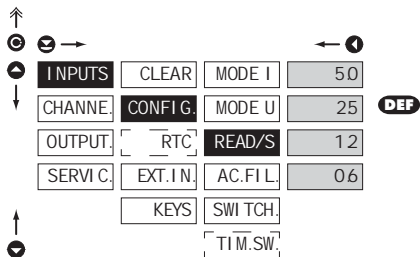


## READ/S Selection of measuring rate

5.0	5,0 measurements/s
25	2,5 measurements/s
1.2	1,2 measurements/s
0.6	0,6 measurements/s

## 6. SETTING PROFI

### 6.1.2d SELECT FUNCTION OF INPUT FILTER

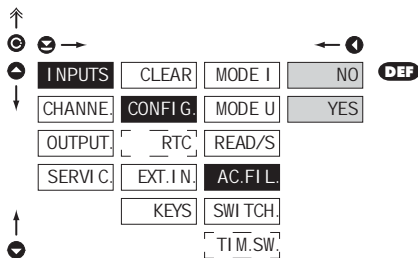

#### AC.FI.L. Input filter function - suppressing DC component

- allows for measurement of alternating component of the input signal


**NO** Filter is off

- measures both DC and AC components of the input signal

**YES** Filter is on

- measures only AC component of the input signal

### 6.1.2e SELECT PROJECTION OF MEASURING CHANNELS

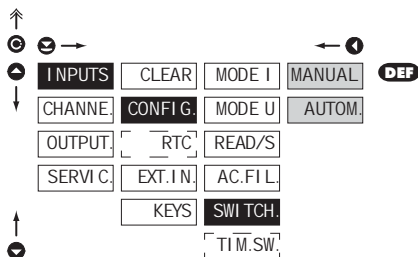

#### SWI.TCH. Select switching of projection of measuring channels

- in this menu it is possible to select switching for projection of measuring channels I, U, P, F, MF
- selection of quantities for switching can be set separately for individual channels (e.g. for Channel I >> "CHANNELS > CHAN. I > SWITCH.")

**MANUAL** Manual switching of projection

- projection may be switched by selected button ("INPUT > BUTTUN") or external input ("INPUT > EXT. IN.")


**AUTOM.** Switching of projection is automatic

- switching time is adjustable in item "TIM.SW."


#### TIM.SW. Setting switching interval for projection

- time is adjustable in range 0,5...99,9 s


**DEF** = 2



## 6.1.3 SETTING THE REAL TIME CLOCK

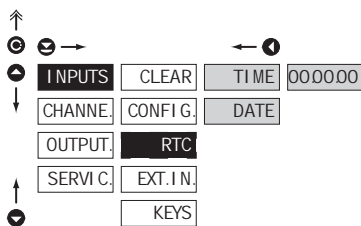

RTC	Setting the real time clock (RTC)
TIME	Time setting - format 23.59.59
DATE	Date setting - format DD.MM.YY

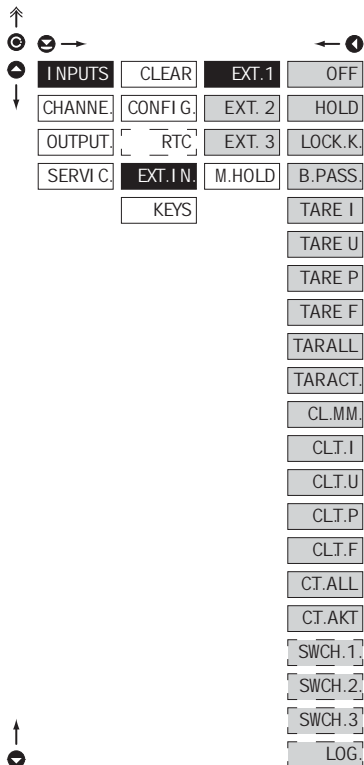

External inputs table

Channel	Ext 1	Ext 2	Ext 3
"I"	0	0	
"U"	0	1	
"P"	1	0	
"F"	1	1	
"MF"	0	0	1
"Cos fi"	0	1	1
"Min"	1	0	1
"Max"	1	1	1

- DEF** EXT. 1 > HOLD
- DEF** EXT. 2 > LOCK. K.
- DEF** EXT. 3 > SWCH. 1


**!**  
Response to change of input is approx. 100 ms

**\***  
Procedure identical for EXT. 2 and EXT. 3.

EXT. 1 N.	Select function of external input
OFF	Input is off
HOLD	Activation of HOLD
LOCK.K.	Locking keys on the instrument
B.PASS.	Activation of locking access into programming menu
LIGHT/PROFI	
TARE I	Tare activation for "Channel I"
TARE U	Tare activation for "Channel U"
TARE p	Tare activation for "Channel P"
TARE F	Tare activation for "Channel F"
TAR.ALL	Tare activation on all channels
TAR.ACT.	Tare activation on active channel
CL.MM.	Resetting min/max value
CL.T.I	Clear Tare for "Channel I"
CL.T.U	Clear Tare for "Channel U"
CL.T.p	Clear Tare for "Channel P"
CL.T.F	Clear Tare for "Channel F"
CT.ALL	Clear tare on all channels
CT.ACT.	Clear tare on active channel
SWCH. 1	Successive switching of channels projection
SWCH. 2	BCD switching of channels projection - EXT. 1, 2
- control see table	
- after selecting this option setting for "INPUT 2" is automatically banned	
SWCH. 3	BCD switching of channels projection - EXT. 1, 2, 3
- control see table	
- after selecting this option setting for "EXT. 2" and "EXT. 3"	
LOG.	Selection of storing data into instrument memory

## 6.1.4b

## SELECTION OF FUNCTION "HOLD"

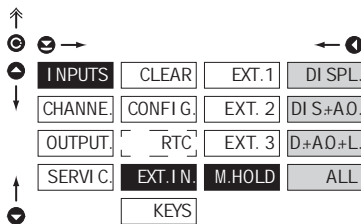**M.HOLD****Selection of function "HOLD"**

DI SPL.

"HOLD" locks only the value displayed

DI S+A.O.

"HOLD" locks the value displayed and on AO

D+A.O+L.


"HOLD" locks the value displayed, on AO and limit evaluation

ALL

"HOLD" locks the entire instrument

## 6. SETTING PROFI

### 6.1.5a OPTIONAL ACCESSORY FUNCTIONS OF THE KEYS

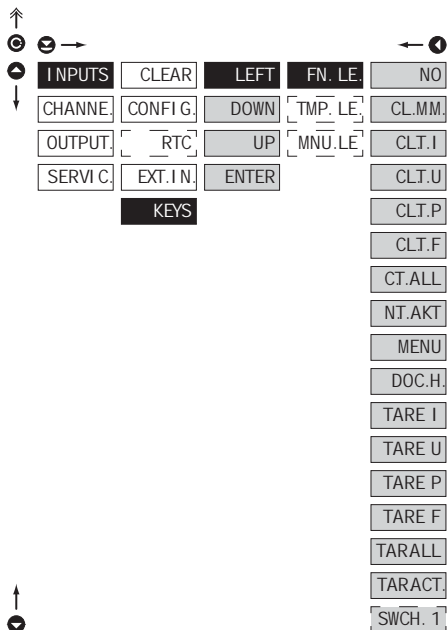

! Preset values of the control keys <b>DEF</b>	
<b>Preset &gt; POWER</b>	
LEFT	Current [Chan. I]
UP	Frequency [Chan. F]
DOWN	Voltage [Chan. U]
ENTER	cos fi [Mat. Fn.]
<b>Preset &gt; VOLTAGE</b>	
LEFT	Current [Chan. I]
UP	Frequency [Chan. F]
DOWN	Power [Chan. P]
ENTER	cos fi [Mat. Fn.]
<b>Preset &gt; CURRENT</b>	
LEFT	Power [Chan. P]
UP	Frequency [Chan. F]
DOWN	Voltage [Chan. U]
ENTER	cos fi [Mat. Fn.]

#### FN. LE. Assigning further functions to instrument keys

-, FN. LE.' > executive functions


NO	Key has no further function
CL. MM.	Resetting min/max value
CLT. I	Clear Tare for "Channel I"
CLT. U	Clear Tare for "Channel U"
CLT. P	Clear Tare for "Channel P"
CLT. F	Clear Tare for "Channel F"
CT. ALL	Clear tare on all channels
CT. ACT.	Clear tare on active channel
MENU	Direct access into menu on selected item
- after confirmation of this selection the "MNU. LE." item is displayed on superior menu level, where required selection is performed	
TEMP. N.	Temporary projection of selected values
- after confirmation of this selection the item "TMP. LE." is displayed on superior menu level, where required selection is performed	
TARE I	Tare activation for "Channel I"
TARE U	Tare activation for "Channel U"
TARE p	Tare activation for "Channel P"
TARE F	Tare activation for "Channel F"
TAR. ALL	Tare activation on all channels
TAR. ACT.	Tare activation on active channel
SWCH. 1	Successive switching of channels projection

! Setting is identical for LEFT, DOWN, UP and ENTER



## 6.1.5b

## OPTIONAL ACCESSORY FUNCTIONS OF THE KEYS - TEMPORARY PROJECTION

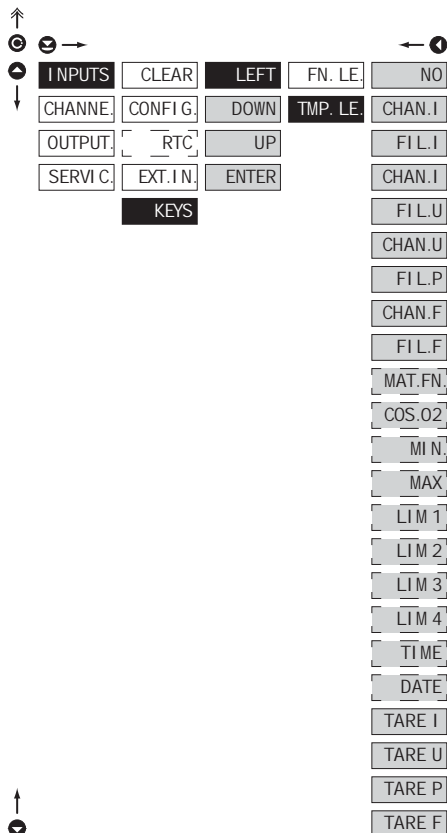


**!**  
"COS. 02" is derived from "COS. Fl.", where for evaluation -1..1 range is converted to 0..2

**!**  
Setting is identical for LEFT, DOWN, UP and ENTER


**TMP. LE.** Temporary projection of selected item

- „TMP. LE.“ > temporary projection of selected values
- "Temporary" projection of selected value is displayed for the time of keystroke
- "Temporary" projection may be switched to permanent by pressing **C** + "Selected key", this holds until the stroke of any key

NO	Temporary projection is off
CHAN. I	Temporary projection of "Channel I" value
FIL. I	Temporary projection of "Channel I" value after processing digital filters
CHAN. U	Temporary projection of "Channel U" value
FIL. U	Temporary projection of "Channel U" value after processing digital filters
CHAN. P	Temporary projection of "Channel P" value
FIL. P	Temporary projection of "Channel P" value after processing digital filters
CHAN. F	Temporary projection of "Channel F" value
FIL. F	Temporary projection of "Channel F" value after processing digital filters
MAT. FN.	Temporary projection of "Mathematic functions" value
COS. 02	Temporary projection of value of auxiliary channel cos fi (range 0-2)
MIN	Temporary projection of "Min. value"
MAX	Temporary projection of "Max. value"
LIM -	Temporary projection of Limit 1..4 value
TIME	Temporary projection of "TIME" value
DATE	Temporary projection of "DATE" value
TARE I	Temporary projection of tare for „Channel I“
TARE U	Temporary projection of tare for „Channel U“
TARE P	Temporary projection of tare for „Channel P“
TARE F	Temporary projection of tare for „Channel F“

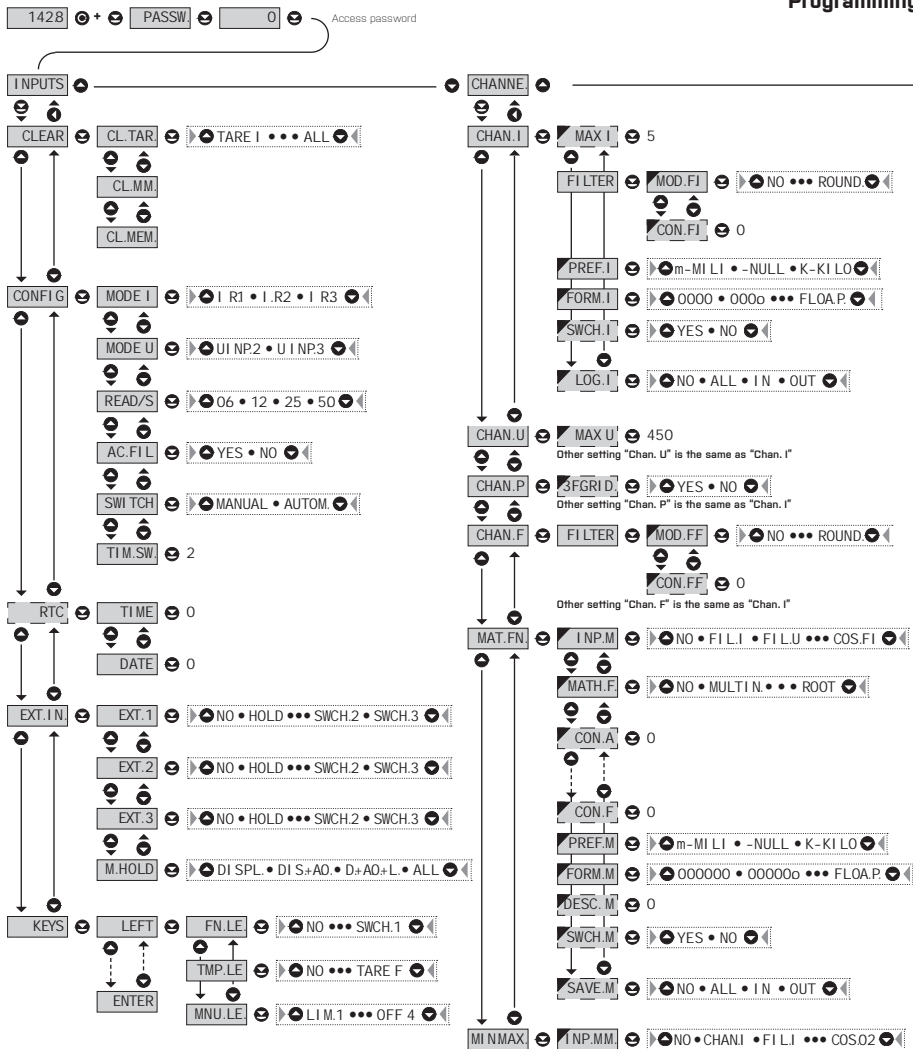

## HOME PROFI MENU

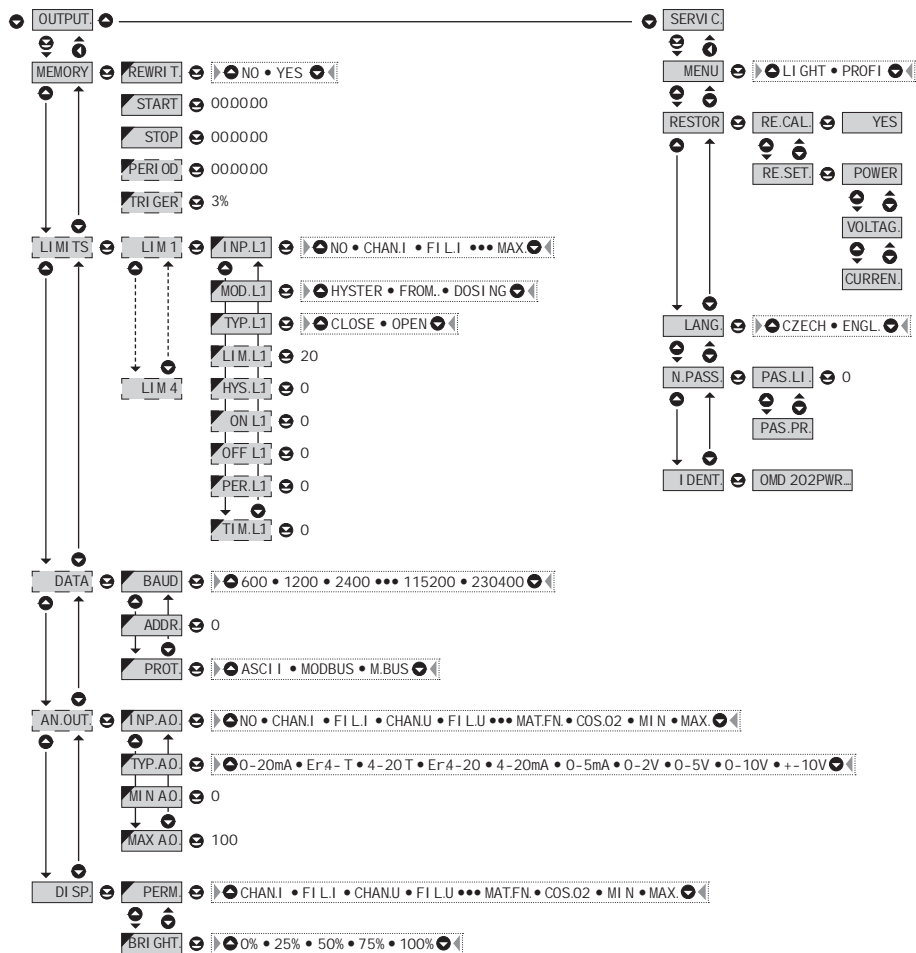


Upon delay exceeding 60 s the programming mode is automatically discontinued and the instrument itself restores the measuring mode

## 6. SETTING PROFI

6.1.5c

OPTIONAL ACCESSORY FUNCTIONS OF THE KEYS - DIRECT ACCESS TO ITEM

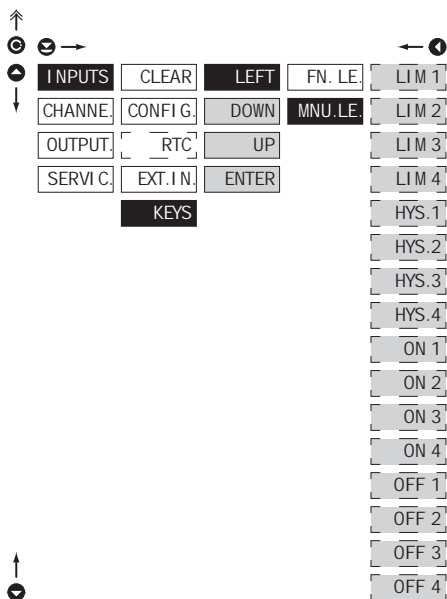

### MNU. LE. Assigning access to selected menu item

-, "MNU. LE." > direct access into menu on selected item

LIM 1	Direct access to item "LIM 1"
LIM 2	Direct access to item "LIM 2"
LIM 3	Direct access to item "LIM 3"
LIM 4	Direct access to item "LIM 4"
HYS. 1	Direct access to item "HYS. 1"
HYS. 2	Direct access to item "HYS. 2"
HYS. 3	Direct access to item "HYS. 3"
HYS. 4	Direct access to item "HYS. 4"
ON 1	Direct access to item "ON 1"
ON 2	Direct access to item "ON 2"
ON 3	Direct access to item "ON 3"
ON 4	Direct access to item "ON 4"
OFF 1	Direct access to item "OFF 1"
OFF 2	Direct access to item "OFF 2"
OFF 3	Direct access to item "OFF 3"
OFF 4	Direct access to item "OFF 4"




Setting is identical for LEFT, DOWN, UP and ENTER



## 6. SETTING PROFI


### 6.2 SETTING "PROFI" - CHANNELS



In this menu the instrument input parameters are set

CHAN. I	Setting parameters of measuring "Channel I"
CHAN. U	Setting parameters of measuring "Channel U"
CHAN. P	Setting parameters of measuring "Channel P"
CHAN. F	Setting parameters of measuring "Channel F"
MAT. FN.	Setting parameters of mathematic functions
MI NMAX	Selection of access and evaluation of Min/max value

### 6.2.1a DISPLAY PROJECTION - „CHANNEL I“

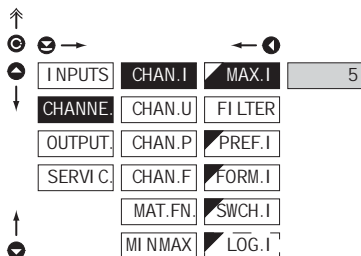



**MAX. I** Setting display projection for maximum value of input signal

- range of the setting is -9999...9999

- **DEF** = 5

! Setting is identical for "CHAN. U"

## 6.2.1b SETTING DIGITAL FILTERS - „CHANNEL I”

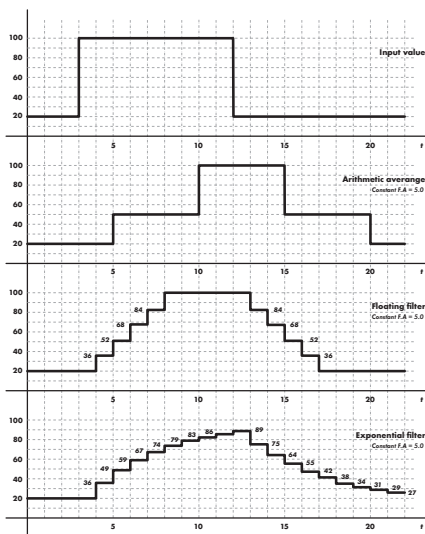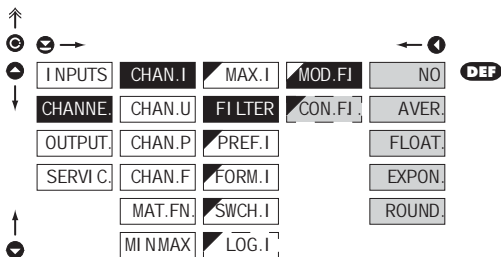**MOD.FI** Selection of digital filters

- at times it is useful for better user projection of data on display to modify it mathematically and properly, wherefore the following filters may be used:

**NO** Filters are off

**AVER.** Measured data average\*

- arithmetic average from given number [CON.FI] of measured values
- range 2..100

**FLOAT.** Selection of floating filter\*

- floating arithmetic average from given number [CON.FI] of measured data and updates with each measured value
- range 2..30

**EXPON.** Selection of exponential filter\*

- integration filter of first prvnho grade with time constant [CON.FI] measurement
- range 2..100

**ROUND.** Measured value rounding

- is entered by any number, which determines the projection step  
[e.g. "CON.FI" = 2,5 > display 0, 2,5, 5,...]


**CON.FI** Setting constants

- this menu item is always displayed after selection of particular type of filter

**DEF** = 2

## 6. SETTING PROFI

### 6.2.1c SETTING MULTIPLYING CONSTANT - „CHANNEL I“

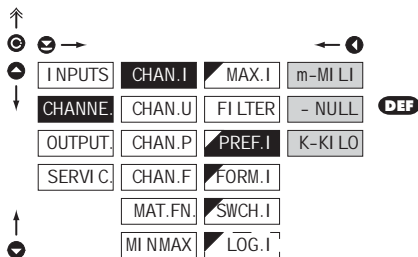

#### PREF. I Select multiplying constant


- the constant allows for another mathematical calculation with the option of extended projection of measuring units, display projection

**m-MI LI** Constant 0.001  
prefix "m" added

**- NULL** Constant 1  
without prefix

**K-KI LO** Constant 1000  
prefix "k" added

### 6.2.1d PROJECTION FORMAT - POSITIONING OF DECIMAL POINT

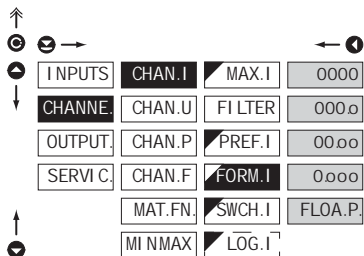

#### FORM. I Selection of decimal point

- the instrument can project numbers in a standard way incl. the decimal point, time formats and also floating decimal point which ensures the most accurate value projection when „FLOA. P.“ is selected

**0000.** Setting DP - XXXX.

**000.o** Setting DP - XXX.x

**00.o0** Setting DP - XX.xx

**0.o00** Setting DP - X.xxx

**FLOA. P.** Floating DP

**DEF** "Channel I" - 00.00


**DEF** "Channel U" - 000.o

**DEF** "Channel P" - 0000

**DEF** "Channel F" - 00.o0



## 6.2.1e SELECTION OF CHANNEL PROJECTION UPON SWITCHING

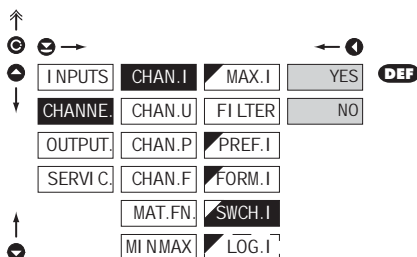
**SWI T. I** Selection of channel projection upon switching

- setting in this item enables the user to select individual measuring channels which will be displayed upon switching the channel functions ,SWT. I'

NO Projection permitted

YES Projection restricted

## 6.2.1f SELECTION OF STORING DATA INTO INSTRUMENT MEMORY

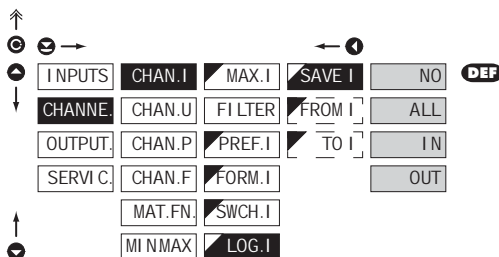**SAVE I** Selection of storing data into instrument memory

- by selection in this item you allow to register values into instrument memory  
 - another setting in item "OUTPUT. > MEMORY" (not in standard experiment)

NO Measured data is not stored

ALL Measured data is stored in memory

IN Only data measured within the set interval is stored in memory

OUT Only data measured outside the set interval is stored in memory

FROM I Setting the initial interval value


- setting range: -9999...9999

TO I Setting the final interval value

- setting range: -9999...9999

## 6. SETTING PROFI

### 6.2.2a DISPLAY PROJECTION - „CHANNEL U“

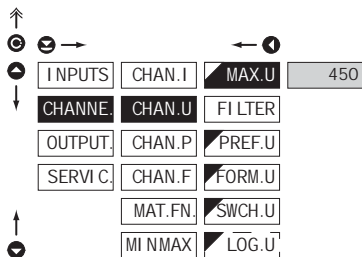

#### MAX.U Setting display projection for maximum value of input signal


- range of the setting is -9999...9999

- DEF = 450



Setting is identical for "CHAN. I"

### 6.2.3a SETTING OF PARAMETERS FOR "CHANNEL P"

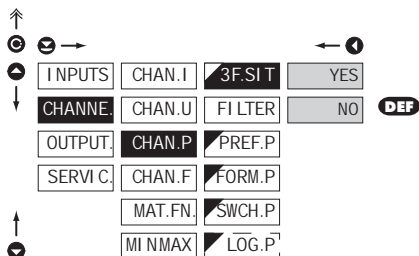

#### 3FGRI D Select calculation for 3-phase network

NO

Calculation is inactive

YES


Calculation is active

- value is calculated with presumption of balanced take-off in all phases
- for P, S Q the value is multiplied by 3x



Setting is identical for "CHAN. I"

## 6.2.4a SETTING OF PARAMETERS FOR "CHANNEL F"

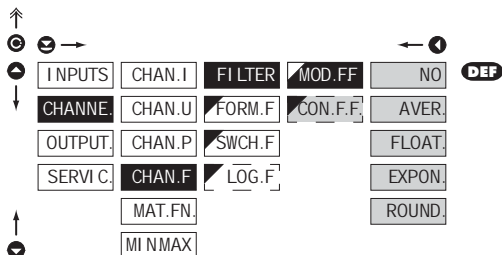**MOD.FF** Selection of digital filters

- at times it is useful for better user projection of data on display to modify it mathematically and properly, wherefore the following filters may be used:

**NO** Filters are off

**AVER.** Measured data average\*

- arithmetic average from given number [CON.FF] of measured values
- range 2..100

**FLOAT.** Selection of floating filter\*

- floating arithmetic average from given number [CON.FF] of measured data and updates with each measured value
- range 2..30

**EXPON.** Selection of exponential filter\*

- integration filter of first prvnihio grade with time constant [CON.FF] measurement
- range 2..100

**ROUND** Measured value rounding

- is entered by any number, which determines the projection step  
[e.g. "CON.FF"=2,5 > display 0, 2,5, 5,...]

**CON.FF** Setting constants


- this menu item is always displayed after selection of particular type of filter

**DEF** = 2

! Other settings are identical with settings for "Channel I"

## 6. SETTING PROFI

### 6.2.5a MATHEMATICAL FUNCTIONS - INPUT SELECTION

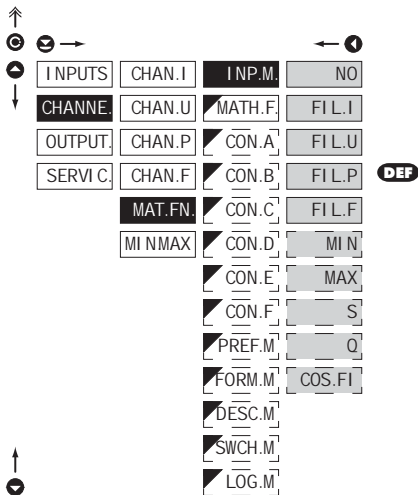


#### I N P . M Selecting the channel to be processed by mathematical function

- selecting the value from which the mathematical function will be calculated

NO	Mathematical functions are off
F I L . I	From „Channel I“ - current after digital filter
F I L . U	From „Channel U“ - voltage after digital filter
F I L . P	From „Channel P“ - power after digital filter
F I L . F	From „Channel F“ - frequency after digital filter
MI N	From "Min. value"
MAX	From "Max. value"
S	From "Apparent power"
Q	From "Idle power"
C O S . F I	From "Cos fi"

6.2.5a

MATHEMATIC FUNCTIONS

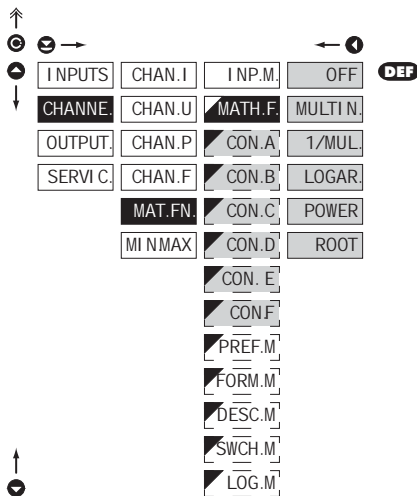

MATH. F.

Selection of mathematic functions

OFF

Mathematic functions are off

MULTI N.

Polynomial

$$Ax^5 + Bx^4 + Cx^3 + Dx^2 + Ex + F$$

1/MUL.

 $1/x$ 

$$\frac{A}{x^5} + \frac{B}{x^4} + \frac{C}{x^3} + \frac{D}{x^2} + \frac{E}{x} + F$$

LOGAR.

Logarithm

$$A \times \ln\left(\frac{Bx + C}{Dx + E}\right) + F$$

POWER

Power

$$A \times (Bx + C)^{(Dx + E)} + F$$

ROOT

Root

$$A \times \sqrt{\frac{Bx + C}{Dx + E}} + F$$

CON. -

Setting constants for calculation of mat.functions

- this menu is displayed only after selection of given mathematic function

## 6. SETTING PROFI

### 6.2.5c MATHEMATIC FUNCTIONS - SETTING MULTIPLYING CONSTANT

Navigation icons: ↑, Ⓞ, ☺, ←, Ⓚ, ↓, Ⓚ, Ⓞ

↑	Ⓞ	☺	←	Ⓚ
Ⓚ	I NPUTS	CHAN. I	I NP. M	m-MI LI
↓	CHANN.	CHAN. U	MATH. F	- NULL <b>DEF</b>
	OUTPUT	CHAN. P	CON. A	K-KI LO
	SERVI C.	CHAN. F	CON. B	
		MAT. FN.	CON. C	
		MI NMAX	CON. D	
			CON. E	
			CON. F	
			PREF. M	
			FORM. M	
			DESC. M	
			SWCH. M	
			LOG. M	

#### PREF. M Select multiplying constant

- the constant allows for another mathematical calculation with the option of extended projection of measuring units, display projection

m-MI LI Constant 0,001  
prefix "m" added

- NULL Constant 1  
without prefix

K-KI LO Constant 1000  
prefix "k" added

### 6.2.5d MATHEMATIC FUNCTIONS - POSITIONING OF DECIMAL POINT

Navigation icons: ↑, Ⓞ, ☺, ←, Ⓚ, ↓, Ⓚ, Ⓞ

↑	Ⓞ	☺	←	Ⓚ
Ⓚ	I NPUTS	CHAN. I	I NP. M	000000
↓	CHANN.	CHAN. U	MATH. F	00000.0
	OUTPUT	CHAN. P	CON. A	0000.00
	SERVI C.	CHAN. F	CON. B	000.000
		MAT. FN.	CON. C	00.0000
		MI NMAX	CON. D	0.00000
			CON. E	FLOA. P <b>DEF</b>
			CON. F	
			PREF. M	
			FORM. M	
			DESC. M	
			SWCH. M	
			LOG. M	

#### FORM. M Selection of decimal point

- the instrument can project numbers in a standard way incl. the decimal point, time formats and also floating decimal point which ensures the most accurate value projection when „FLOA. P.“ is selected

000000. Setting DP - XXXXXX.

00000.0 Setting DP - XXXXX.x

0000.00 Setting DP - XXXX.xx

000.000 Setting DP - XXX.xxx

FLOA. P. Floating DP

## 6.2.5e MATHEMATIC FUNCTIONS - MEASURING UNITS

↑

⊖ →

← ⊖

IN PUTS	CHAN. I	I NP. M	00
CHANNE.	CHAN. U	MATH. F	
OUT PUT.	CHAN. P	CON. A	
SERVI. C.	CHAN. F	CON. B	
	MAT. FN.	CON. C	
	MI NMAX	CON. D	
		CON. E	
		CON. F	
		PREF. M	
		FORM. M	
		DESC. M	
		SWCH. M	
		LOG. M	

↑

⊖

## DESC. M Setting projection of description for "MAT. FN."

- projection of measured data may be extended (at the expense of the number of displayed places) by two characters for description
- description is set by shifted ASCII code, when two first places show the set description and two last characters their code in period 0...95
- description is cancelled by code 00

DEF = 00 (no description)



Table of signs on page 77

## 6.2.5f MATHEMATIC FUNCTIONS - SELECTION OF CHANNEL PROJECTION UPON SWITCHING

↑

⊖ →

← ⊖

IN PUTS	CHAN. I	I NP. M	YES	DEF
CHANNE.	CHAN. U	MATH. F	NO	
OUT PUT.	CHAN. P	CON. A		
SERVI. C.	CHAN. F	CON. B		
	MAT. FN.	CON. C		
	MI NMAX	CON. D		
		CON. E		
		CON. F		
		PREF. M		
		FORM. M		
		DESC. M		
		SWCH. M		
		LOG. M		

↑

⊖

## SWI T.M Selection of channel rejection upon switching

- setting in this item enables the user to select individual measuring channels which will be displayed upon switching the channel functions 'SWIT. M'


NO Projection permitted

YES Projection restricted

## 6. SETTING PROFI

6.2.2d

MATHEMATIC FUNCTIONS - SELECTION OF STORING DATA INTO INSTRUMENT MEMORY

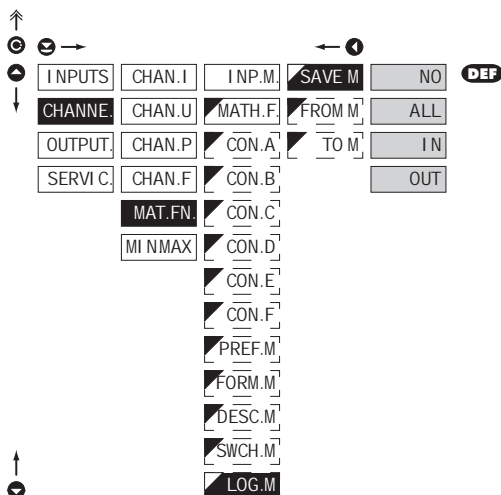

### SAVE M Selection of storing data into instrument memory

- by selection in this item you allow to register values into instrument memory
- another setting in item "OUTPUT. > MEMORY" (not in standard experiment)

**NO** Measured data is not stored

**ALL** Measured data is stored in memory

**IN** Only data measured within the set interval is stored in memory

**OUT** Only data measured outside the set interval is stored in memory

**FROM M** Setting the initial interval value


- setting range: -9999...9999

**TO M** Setting the final interval value

- setting range: -9999...9999



## 6.2.6 SELECTION OF EVALUATION OF MIN/MAX VALUE

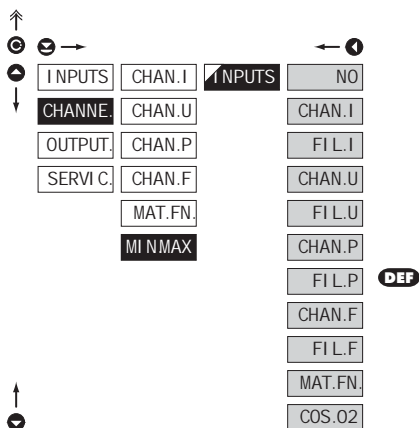

! "COS.02" is derived from "COS.FI." where for evaluation -1..1 range is converted to 0..2


## I NPUTS. Selection of evaluation of min/max value

- selection of value from which the min/max value will be calculated

NO	Evaluation of min/max value is off
CHAN.I	From „Channel I“ - current
FI L.I	From „Channel I“ - current after digital filter
CHAN.U	From „Channel U“ - voltage
FI L.U	From „Channel U“ - voltage after digital filter
CHAN.P	From „Channel P“ - power
FI L.P	From „Channel P“ - power after digital filter
CHAN.F	From „Channel F“
FI L.F	From „Channel F“ - frequency after digital filter
MAT.FN.	From "Mathematic function"
COS.FI	From "Cos fi"

## 6. SETTING PROFI


### 6.3 SETTING „PROFI“ - OUTPUTS



In this menu it is possible to set parameters of the instrument output signals

MEMORY	Setting data logging into memory
LIMITS	Setting type and parameters of limits
DATA	Setting type and parameters of data output
AN.OUT.	Setting type and parameters of analog output
DISP.	Setting display projection and brightness

### 6.3.1a SELECTION OF MODE OF DATA LOGGING INTO INSTRUMENT MEMORY

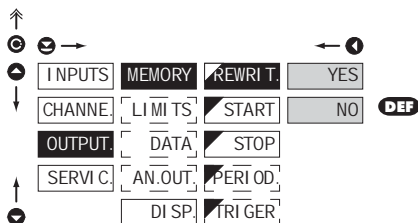


**REWRI T.** Selection of the mode of data logging

- selection of the mode in the event of full instrument memory

NO	Rewriting values prohibited
YES	Rewriting values permitted, the oldest get rewritten by the latest

## 6.3.1b SETTING DATA LOGGING INTO INSTRUMENT MEMORY - RTC



## RTC

The lowest recording rate possible is once a day, the highest is every second. Under exceptional circumstances it is possible to set the rate to 8 times per second by entering the recording period as 00:00:00. However, this mode is not recommended due to the memory overload. Recordings are realised in a timeframe of one day and are repeated periodically every following day. Recordings can take place either inside or outside of selected time intervals. The duration of re-writing can be determined by the number of channels recorded as well as by the recording rate.

**START** Start of data logging into instrument memory

- time format HH:MM:SS

**STOP** Stop data logging into instrument memory

- time format HH:MM:SS

**PERIOD** Period of data logging into instrument memory


- determines the period in which values will be logged in an interval delimited by the time set under items **START** and **STOP**

- time format HH:MM:SS

- records are made on a daily basis in selected interval and period

- item not displayed if "SAVE" is selected in menu (INPUT > EXT. IN.)

## 6.3.1c SETTING DATA LOGGING INTO INSTRUMENT MEMORY - FAST

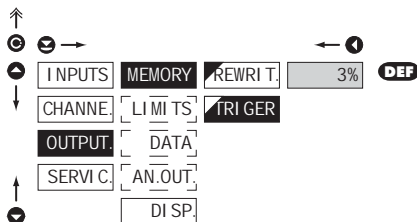

**TRIGGER** Setting logging data into inst. memory

- logging data into inst. memory is governed by the following selection, which determines how many percent of the memory is reserved for data logging prior to initiation of trigger impulse

- initialization is on ext. input or button

- setting in range 1...100 %

- when setting 100 %, datalogging works in the mode **ROLL** > data keep getting rewritten in cycles

## 1. Memory initialization

- clear memory (ext.input, button)

- LED "M" flashes, after reading **TRIGGER** [%] memory is permanently shining. In **ROLL** flashes constantly.

## 2. Triggering

- external input, button

- after the memory LED is full "M" turns off


- in the **ROLL** mode the trigger ends datalogging and LED turns off

## 3. Termination

- ext. input, button or reading data via RS

## FAST

The memory operates on the basis of memory oscilloscope. Select an area of 0...100% of the memory capacity. [100% represents 8 192 individual recordings for a single channel measurement]. This area is filled cyclically up to the point when the recording starts (activated by the front panel button or by an external input). When the remaining memory capacity fills up the recording stops. A new recording is possible after the deletion of the latest recording. It is possible to abort a recording before its completion by reading out the data.

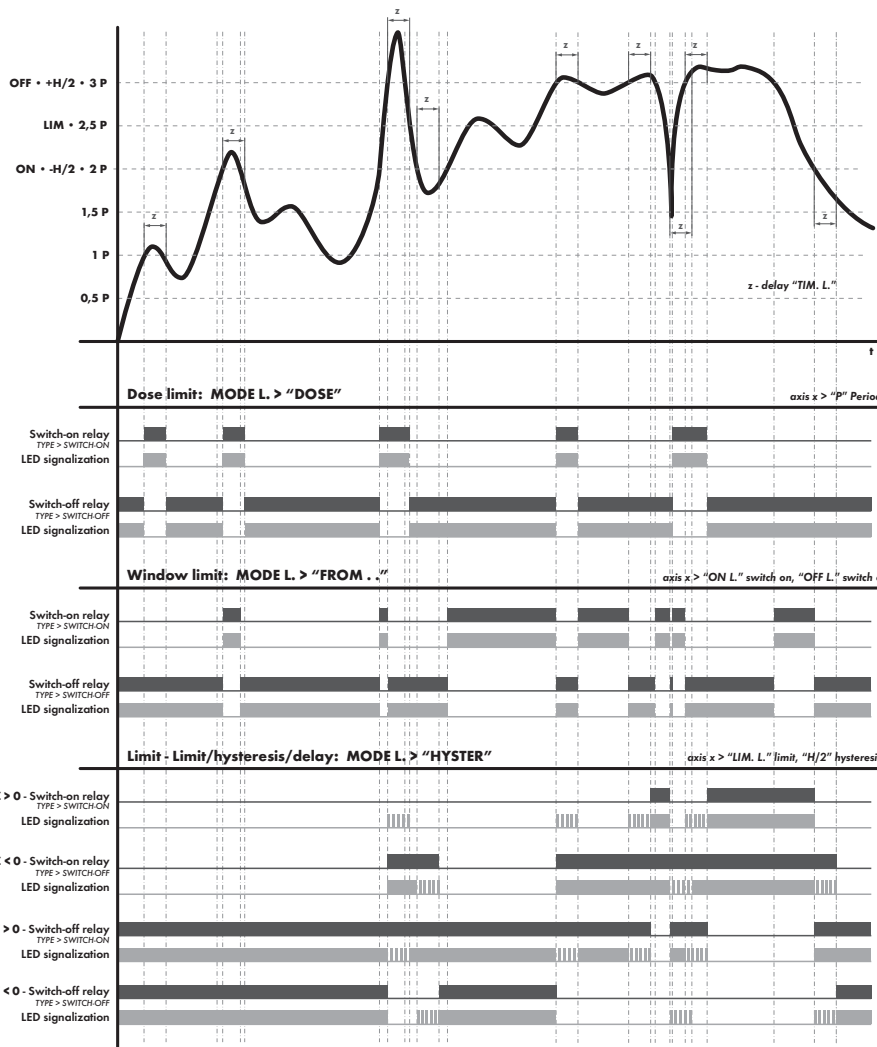

## 6.3.2a

## SELECTION OF INPUT FOR LIMITS EVALUATION

INPUTS	MEMORY	LIM 1	INP.L1	CHAN.I
CHANNE.	LIMITS	LIM 2	MOD.L1	FIL.I
OUTPUT.	DATA	LIM 3	TYP.L1	CHAN.U
SERVIC.	AN.OUT	LIM 4	LIM.L1	FIL.U
	DISP.	HYS.L1	ON.L1	CHAN.P
		OFF.L1	PER.L1	FIL.P
		TIM.L1	MAT.FN.	FIL.F
			COS.O2	CHAN.F
			MIN	FIL.F
			MAX	MAT.FN.

DEF

## INP.L1 Selection evaluation of limits

- selection of value from which the limit will be evaluated

CHAN.I	From „Channel I“ - current
FIL.I	From „Channel I“ - current after digital filter
CHAN.U	From „Channel U“ - voltage
FIL.U	From „Channel U“ - voltage after digital filter
CHAN.P	From „Channel P“ - power
FIL.P	From „Channel P“ - power after digital filter
CHAN.F	From „Channel F“
FIL.F	From „Channel F“ - frequency after digital filter
MAT.FN.	From "Mathematic function"
COS.FI	From "Cos fi"
MIN	From "Min. value"
MAX	From "Max. value"


Setting is identical for LIM 1, LIM 2, LIM 3 and LIM 4



"COS.O2" is derived from "COS.FI," where for evaluation -1..1 range is converted to 0..2

## 6. SETTING PROFI

### 6.3.2b SELECTION OF TYPE OF LIMIT

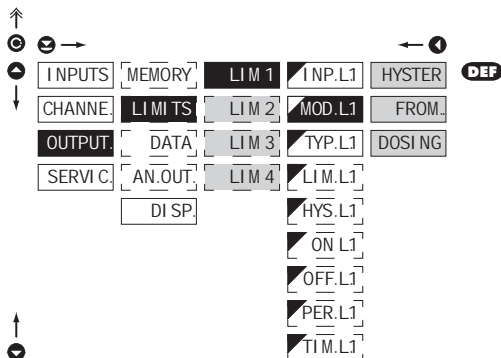

#### MOD.L1 Selection the type of limit

**HYSTER** Limit is in mode "Limit, hysteresis, delay"

- for this mode the parameters of "LIM.L1" are set, at which the limit will shall react, "HYS.L1" the hysteresis range around the limit [LIM  $\pm 1/2$  HYS] and time "TIM.L1" determining the delay of relay switch-on

**FROM..** Frame limit

- for this mode the parameters are set for interval "ON.L1" the relay switch-on and "OFF.L1" the relay switch-off


**DOSI NG** Dose limit (periodic)

- for this mode the parameters are set for "PER.L1" determining the limit value as well as its multiples at which the output is active and "TIM.L2" indicating the time during which is the output active



Setting is identical for LIM 1, LIM 2, LIM 3 and LIM 4

### 6.3.2c SELECTION OF TYPE OF OUTPUT

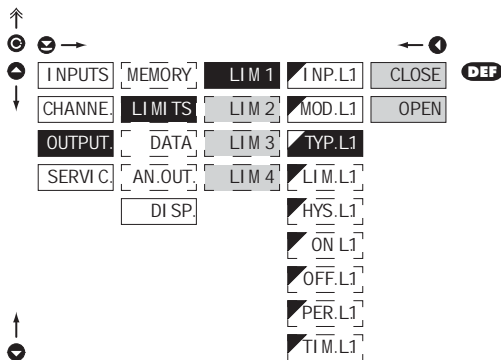

#### TYP.L1 Selection of type of output


**CLOSE** Output switches on when condition is met

**OPEN** Output switches off when condition is met



Setting is identical for LIM 1, LIM 2, LIM 3 and LIM 4

## 6.3.2d SETTING VALUES FOR LIMITS EVALUATION

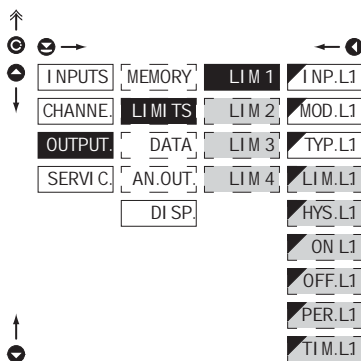**LIM.L1** Setting limit for switch-on

- for type "HYSTER"

**HYS.L1** Setting hysteresis

- for type "HYSTER"
- indicates the range around the limit (in both directions, LIM.  $\pm \sqrt{2}$  HYS.)

**ON.L1** Setting the outset of the interval of limit switch-on

- for type "FROM.."

**OFF.L1** Setting the end of the interval of limit switch-on

- for type "FROM.."

**PER.L1** Setting the period of limit switch-on

- for type "DOSING"

**TIM.L1** Setting the time switch-on of the limit

- for type "HYSTER" and "DOSING"
- setting within the range:  $\pm 0...99,9$  s
- positive time  $\rightarrow$  relay switches on after crossing the limit (LIM.L1) and the set time (TIM.L1)
- negative time  $\rightarrow$  relay switches off after crossing the limit (LIM.L1) and the set negative time (TIM.L1)

**!**  
Setting is identical for LIM 1, LIM 2, LIM 3 and LIM 4

## 6. SETTING PROFIBUS

### 6.3.3a SELECTION OF DATA OUTPUT BAUD RATE

Navigation icons: ↑, Ⓞ, ☺, →, ←, Ⓚ, ↓, Ⓢ, Ⓣ

↑	Ⓞ	☺	→		←	Ⓚ
↶	IN PUTS	MEMO RY	BA UD	600		
↓	CHAN NE	LI MI TS	ADR	1200		
	OUT PUT	DA TA	AD -MOD	2400		
	SERVI C	AN _OUT	ADR .PB	4800		
		DI SP	PR OT	9600	<b>DEF</b>	
				19200		
				38400		
				57600		
				115200		
				230400		

BAUD	Selection of data output baud rate
600	Rate - 600 Baud
1200	Rate - 1 200 Baud
2400	Rate - 2 400 Baud
4800	Rate - 4 800 Baud
9600	Rate - 9 600 Baud
19200	Rate - 19 200 Baud
38400	Rate - 38 400 Baud
57600	Rate - 57 600 Baud
115200	Rate - 115 200 Baud
230400	Rate - 230 400 Baud

### 6.3.3b SETTING INSTRUMENT ADDRESS


Navigation icons: ↑, Ⓞ, ☺, →, ←, Ⓚ, ↓, Ⓢ, Ⓣ

↑	Ⓞ	☺	→		←	Ⓚ
↶	IN PUTS	MEMO RY	BA UD	0		
↓	CHAN NE	LI MI TS	ADR			
	OUT PUT	DA TA	AD -MOD			
	SERVI C	AN _OUT	ADR .PB			
		DI SP	PR OT			

ADDR.	Setting instrument address
	- setting in range 0...31
<b>DEF</b>	= 00
ADDR.	Setting instrument address - MDDBUS
	- setting in range 1...247
<b>DEF</b>	= 1
ADR.PB.	Setting instrument address - PROFIBUS
	- setting in range 1...127
<b>DEF</b>	= 19



## 6.3.3c SELECTION OF DATA OUTPUT PROTOCOL

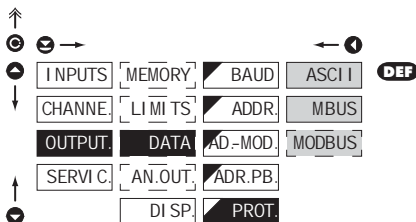**PROT.** Selection of the type of analog output


**ASCI I** Data protocol  
ASCI I

**M.BUS** Data protocol  
DIN MessBus

**MODBUS** Data protocol  
MODBUS-RTU

- option is available only for RS 485

## 6.3.4a SELECTION OF INPUT FOR ANALOG OUTPUT

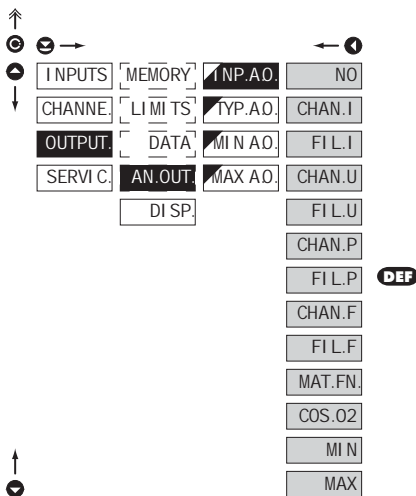**I NP.AO.** Selection evaluation analog output

- selection of value from which the analog output will be evaluated

**NO** Analogue output is off

**CHAN.I** From „Channel I“ - current

**FI L I** From „Channel I“ - current after digital filter

**CHAN.U** From „Channel U“ - voltage

**FI L U** From „Channel U“ - voltage after digital filter

**CHAN.P** From „Channel P“ - power

**FI L P** From „Channel P“ - power after digital filter

**CHAN.F** From „Channel F“

**FI L F** From „Channel F“ - frequency after digital filter

**MAT.FN.** From "Mathematic function"

**COS.FI** From "Cos fi"

**MI N** From "Min. value"

**MAX** From "Max. value"

**DEF** "Channel I" - FI L I

**DEF** "Channel U" - FI L U


**DEF** "Channel P" - FI L P



"COS. 02" is derived from "COS. FI," where for evaluation -1..1 range is converted to 0..2




## 6.3.5a SELECTION OF INPUT FOR DISPLAY PROJECTION

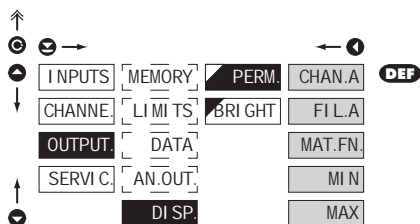**PERM.** Selection display projection

- selection of value which will be shown on the instrument display

CHAN.A	Projection of values from "Channel A"
FI L A	Projection of values from "Channel A" after digital filters processing
MAT.FN.	Projection of values from "Math.functions"
MI N	Projection of values from "Min.value"
MAX	Projection of values from "Max. value"

## 6.3.5b SELECTION OF DISPLAY BRIGHTNESS

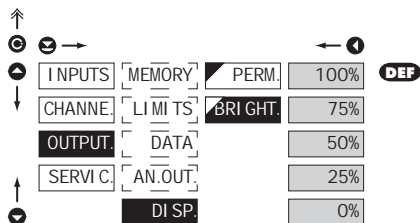
**BRI GHT** Selection of display brightness

- by selecting display brightness we may appropriately react to light conditions in place of instrument location

0%	Display is off
25%	Display brightness - 25 %
50%	Display brightness - 50 %
75%	Display brightness - 75 %
100%	Display brightness - 100 %

## 6. SETTING PROFI


### 6.4 SETTING "PROFI" - SERVIS



The instrument service functions are set in this menu

<b>MENU</b>	Selection of menu type LIGHT/PROFI
<b>RESTOR.</b>	Restore instrument manufacture setting and calibration
<b>LANG.</b>	Language version of instrument menu
<b>N.PASS.</b>	Setting new access password
<b>I DENT.</b>	Instrument identification

#### 6.4.1 SELECTION OF TYPE OF PROGRAMMING MENU

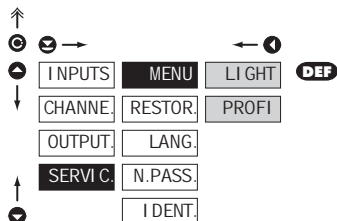

**MENU** Selection of menu type - LIGHT/PROFI

- enables setting the menu complexity according to user needs and skills

**LI GHT** Active LIGHT menu

- simple programming menu, contains only items necessary for configuration and instrument setting
- linear menu > items one after another



**PROFI** Active PROFI menu

- complete programming menu for expert users
- tree menu



Change of setting is valid upon next access into menu

## 6.4.2 RESTORATION OF MANUFACTURE SETTING

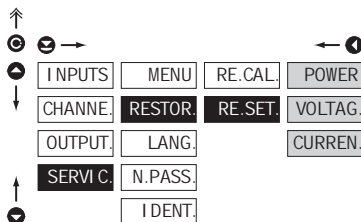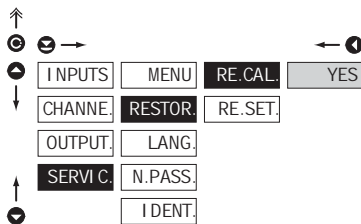**RESTOR.** Restoration of manufacture setting

- in the event of error setting or calibration, manufacture setting may be restored.

**RE.CAL.** Restoration of manufacture calibration of the instrument

- prior executing the changes you will be asked to confirm your selection ,YES'

**RE.SET.** Restoration of instrument manufacture setting

- in the event of error setting or calibration it is possible to return to manufacture setting. Prior to execution of changes you will be asked to confirm your selection (YES)
- reading manufacture calibration and primary setting of items in menu (DEF)

## Presetting constants and evaluation

- presetting "source" for further evaluation (e.g.: select "VOLTAGE" > evaluation of limits, analog, min/max. value, etc... from "Channel U"

**POWER** Setting for measurement of power output - "Channel P"

**VOLTAG.** Setting for measurement of voltage - "Channel U"

**CURREN.** Setting for measurement of current - "Channel I"




After restoration the instrument switches off for couple seconds

JOBS PERFORMED	RESTORE	
	CALIBRATION	SETTING
cancels USER menu rights	✓	✓
deletes table of items order in USER - LIGHT menu	✓	✓
adds items from manufacture to LIGHT menu	✓	✓
deletes data stored in FLASH	✓	✓
cancels or linearization tables	✓	✓
clears tare	✓	✓
restore manufacture calibration	✓	✗
restore manufacture setting	✗	✓

## 6. SETTING PROFI


### 6.4.3 SELECTION OF INSTRUMENT MENU LANGUAGE VERSION

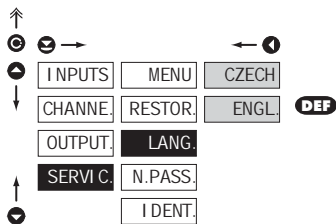

#### LANG. Selection of instrument menu language version

- CZECH Instrument menu is in Czech
- ENGL. Instrument menu is in English


### 6.4.4 SETTING NEW ACCESS PASSWORD

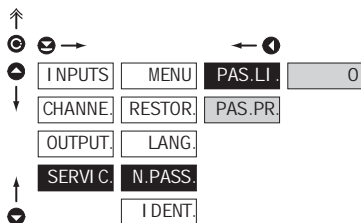

#### N.PASS. Setting new password for access to LIGHT and PROFi menu

- this option allows to change the numeric code, which blocks the access into LIGHT and PROFi menu.
- numerical code range: 0...9999
- universal passwords in the event of loss:  
LIGHT Menu > „8177”  
PROFI Menu > „7915”

### 6.4.5 INSTRUMENT IDENTIFICATION

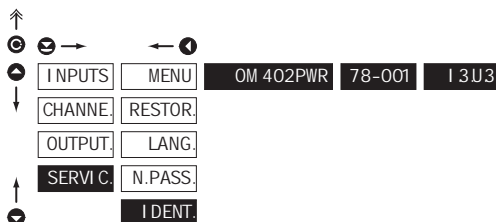

#### I DENT. Projection of instrument SW version

- display shows type identification of the instrument, SW number, SW version and current input setting (Mode)
- if the SW version reads a letter on first position, it is a customer SW

IDENT.	Pos.	Description
	1.	type of instrument
	2.	SW: number - version
	3.	the input type





# SETTING USER


For user operation

Menu items are set by the user (Profi/Light) as per request


Access is not password protected

Optional menu structure either tree (PROFI) or linear (LIGHT)

## 7.0 SETTING ITEMS INTO "USER" MENU

- **USER** menu is designed for users who need to change only several items of the setting without the option to change the primary instrument setting (e.g. repeated change of limit setting)
- there are no items from manufacture permitted in **USER** menu
- on items indicated by inverse triangle  LIM 1
- setting may be performed in **LIGHT** or **PROFI** menu, with the **USER** menu then overtaking the given menu structure

### Setting



**NO**

item will not be displayed in USER menu

**YES**

item will be displayed in USER menu with editing option

**SHOW**

item will be solely displayed in USER menu



## Setting sequence of items in "USER" menu


In compiling USER menu from active LIGHT menu the items (max. 10) may be assigned a sequence, in which they will be projected in the menu

setting projection sequence



## Example of ranking the order of menu items in the "USER" menu

In this example we want to have a direct access to menu items Limit 1 and Limit 2 (example show is for the Light menu, but can equally be used in the Profi menu).

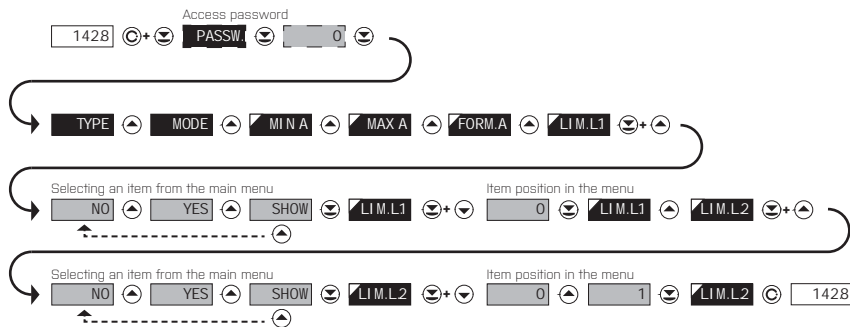

The result of this setting is that when the  $\odot$  button is pressed, the display will read „LIM L.1“. By pressing  $\odot$  button you confirm your selection and then you can set the desired limit value, or by pressing the  $\odot$  button you can go to setting of „LIM. L.2“ where you can proceed identically as with Limit one.

You can exit the setting by pressing the  $\odot$  button by which you store the latest setting and pressing the  $\odot$  button will take you back to the measuring mode

## 8. DATA PROTOCOL



The instruments communicate via serial line RS232 or RS485. For communication they use the ASCII protocol. Communication runs in the following format:

ASCII: 8 bit, no parity, one stop bit

DIN MessBus: 7 bit, even parity, one stop bit

The transfer rate is adjustable in the instrument menu. The instrument address is set in the instrument menu in the range of 0 ÷ 31. The manufacture setting always presets the ASCII protocol, rate of 9600 Baud, address 00. The type of line used - RS232 / RS485 - is determined by an output board automatically identified by the instrument.

The commands are described in specifications you can find at [www.orbit.merret.eu](http://www.orbit.merret.eu) or software OM Link.

### DETAILED DESCRIPTION OF COMMUNICATION VIA SERIAL LINE

EVENT	TYPE	PROTOCOL	TRANSMITTED DATA	
Data solicitation (PC)	232	ASCII	# A A <CR>	
		MessBus	No - data is transmitted permanently	
	485	ASCII	# A A <CR>	
		MessBus	<SADR> <ENQ>	
Data transmission (Instrument)	232	ASCII	> D [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <CR>	
		MessBus	<STX> D [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <ETX> <BCC>	
	485	ASCII	> D [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <CR>	
		MessBus	<STX> D [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <ETX> <BCC>	
Confirmation of data acceptance (PC) - OK	485	MessBus	<DLE> 1	
Confirmation of data acceptance (PC) - Bad			<NAK>	
Sending address (PC) prior command			<EADR> <ENQ>	
Confirmation of address (Instrument)			<SADR> <ENQ>	
Command transmission (PC)	232	ASCII	# A A A N P [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <CR>	
		MessBus	<STX> S N P [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <ETX> <BCC>	
	485	ASCII	# A A A N P [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <CR>	
		MessBus	<STX> S N P [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] [D] <ETX> <BCC>	
Command confirmation (Instrument)	232	ASCII	OK   A A A <CR>	
			Bad ? A A A <CR>	
		Messbus	No - data is transmitted permanently	
			485	ASCII
	Bad ? A A A <CR>			
	Mess-Bus	OK <DLE> 1		
		Bad <NAK>		
	Instrument identification			# A A A 1 Y <CR>
HW identification			# A A A 1 Z <CR>	
One-time transmission			# A A A 7 X <CR>	
Repeated transmission			# A A A 8 X <CR>	

## LEGEND

SIGN	RANGE	DESCRIPTION
#	35 23 <sub>H</sub>	Command beginning
A A	0...31	Two characters of instrument address (sent in ASCII - tens and units, e.g. "01", "99" universal)
<CR>	13 00 <sub>H</sub>	Carriage return
<SP>	32 20 <sub>H</sub>	Space
N, P		Number and command - command code
D		Data - usually characters "0"... "9", "*", ".", ";", ":", "[] - dp. and {} may prolong data
R	30 <sub>H</sub> ...3F <sub>H</sub>	Relay and tare status
!	33 21 <sub>H</sub>	Positive confirmation of command (ok)
?	63 3F <sub>H</sub>	Negative confirmation of command (point)
>	62 3E <sub>H</sub>	Beginning of transmitted data
<STX>	2 02 <sub>H</sub>	Beginning of text
<ETX>	3 03 <sub>H</sub>	End of text
<SADR>	adresa +60 <sub>H</sub>	Prompt to send from address
<EADR>	adresa +40 <sub>H</sub>	Prompt to accept command at address
<END>	5 05 <sub>H</sub>	Terminate address
<DLE>1	16 49 10 <sub>H</sub> 31 <sub>H</sub>	Confirm correct statement
<NAK>	21 15 <sub>H</sub>	Confirm error statement
<BCC>		Check sum -XOR

## RELAY, TARE

SIGN	RELAY 1	RELAY 2	TARE	CHANGE RELAY 3/4
P	0	0	0	0
Q	1	0	0	0
R	0	1	0	0
S	1	1	0	0
T	0	0	1	0
U	1	0	1	0
V	0	1	1	0
W	1	1	1	0
p	0	0	0	1
q	1	0	0	1
r	0	1	0	1
s	1	1	0	1
t	0	0	1	1
u	1	0	1	1
v	0	1	1	1
w	1	1	1	1

Relay status is generated by command #AAGX <CR>.

The instrument immediately returns the value in the format >HH <CR>, where HH is value in HEX format and range 00<sub>H</sub>...FF<sub>H</sub>. The lowest bit stands for „Relay 1“, the highest for „Relay 8“

## 9. ERROR STATEMENTS



ERROR	CAUSE	ELIMINATION
E.DI S_ <u>  </u>	Number is too small (large negative) to be displayed	change DP setting, channel constant setting
E.DI S:-	Number is too large to be displayed	change DP setting, channel constant setting
E.TAB_ <u>  </u>	Number is outside the table range	increase table values, change input setting (channel constant setting)
E.TAB:-	Number is outside the table range	increase table values, change input setting (channel constant setting)
E.I NP_ <u>  </u>	Input quantity is smaller than permitted input quantity range	change input signal value or input (range) setting
E.I NP:-	Input quantity is larger than permitted input quantity range	change input signal value or input (range) setting
E.HW.	A part of the instrument does not work properly	send the instrument for repair
E.EE.	Data in EEPROM corrupted	perform restoration of manufacture setting, upon repeated error statement send instrument for repair
E.SET.	Data in EEPROM outside the range	perform restoration of manufacture setting, upon repeated error statement send instrument for repair
E.CLR	Memory was empty (presetting carried out)	upon repeated error statement send instrument for repair, possible failure in calibration
E.OUT.	Analogue output current loop disconnected	check wire connection



The instrument allows to add two descriptive characters to the classic numeric formats (at the expense of the number of displayed places). The setting is performed by means of a shifted ASCII code. Upon modification the first two places display the entered characters and the last two places the code of the relevant symbol from 0 to 95. Numeric value of given character equals the sum of the numbers on both axes of the table.

Description is cancelled by entering characters with code 00

	0	1	2	3	4	5	6	7		0	1	2	3	4	5	6	7
0		Q	"	&	\$	%	&	'	0	!	"	#	\$	%	&	'	
8	:	:	#	+	,	-	.	/	8	(	)	*	+	,	-	.	/
16	0	1	2	3	4	5	6	7	16	0	1	2	3	4	5	6	7
24	8	9	VA	Vr	<	=	>	?	24	8	9	VA	Vr	<	=	>	?
32	P	R	B	C	D	E	F	G	32	@	A	B	C	D	E	F	G
40	H	I	J	K	L	M	N	O	40	H	I	J	K	L	M	N	O
48	P	Q	R	S	T	U	V	W	48	P	Q	R	S	T	U	V	W
56	X	Y	Z	[	\	]	^	_	56	X	Y	Z	[	\	]	^	_
64	`	a	b	c	d	e	f	g	64	`	a	b	c	d	e	f	g
72	h	i	j	k	l	m	n	o	72	h	i	j	k	l	m	n	o
80	p	q	r	s	t	u	v	w	80	p	q	r	s	t	u	v	w
88	x	y	z	{		}	~		88	x	y	z	{		}	~	

## 11. TECHNICAL DATA



### INPUT

range is adjustable in according to order

Voltage:	0...10 V	150 kΩ	Input 2 - U
	0...120 V	930 kΩ	Input 3 - U
	0...250 V	730 kΩ	Input 2 - U
	0...450 V	930 kΩ	Input 3 - U

Current:	0...60 mV	21 kΩ	Input 1 - I
	0...150 mV	21 kΩ	Input 1 - I
	0...300 mV	21 kΩ	Input 1 - I
	0...1 A	< 150 mV	Input 1 - I
	0...2,5 A	< 150 mV	Input 1 - I
	0...5 A	< 150 mV	Input 1 - I

input frequency: 0...400 Hz (amplitude max. 8 V)

Meas. quantities	Voltage ( $V_{\text{meas}}$ )
	Current ( $A_{\text{meas}}$ )
with calculation	Active power (P)
	Frequency (Hz)
	Idle power (Q)
	Apparent power (S)
	Power factor (cos φ)

### PROJECTION

Display:	999999, intensive red or green 14-ti segment LED, digit height 14mm
Projection:	-9999...9999
Decimal point:	adjustable - in menu
Brightness:	adjustable - in menu

### INSTRUMENT ACCURACY

TC:	50 ppm/°C	
Accuracy:	±0,3% of range + 1 digit	U, I, P, F
	±0,6% of range + 1 digit	S
	±0,9% of range + 1 digit	Q, Cos φ
Rate:	0,6...5 measurements/s	

Overload capacity: 10x (t < 100 ms) not for 250 V and 5 A, 2x (long-term)

Linearisation: by linear interpolation in 38 points - solely via OM Link

Digital filters: Averaging, Floating average, Exponential filter, Rounding

Functions: Tare - display resetting  
Hold - stop measuring (at contact)  
Lock - control key locking  
MM - min/max value  
Mathematic functions

OM Link: company communication interface for setting, operation and update of instrument SW

Watch-dog: reset after 400 ms

Calibration: at 25°C and 40% of r.h.

### COMPARATOR

Type:	digital, adjustable in menu
Mode:	Hysteresis, From, Dosing
Limita:	-9999...9999
Hysteresis:	0...999999
Delay:	0...99,9 s
Outputs:	2x relays with switch-on contact (Form A) (230 VAC/30 VDC, 3 A)* 2x relays with switch-off contact (Form C) (230 VAC/50 VDC, 3 A)* 2x SSR (250 VAC/ 1 A)* 2x/4x open NPN collector (30 VDC/100 mA) 2x bistabil relays (250 VAC/250 VDC, 3 A/0,3 A)*
Relay:	1/8 HP 277 VAC, 1/10 HP 125 V, Pilot Duty D300

### DATA OUTPUTS

Protocols:	ASCII, DIN MessBus, MODBUS, PROBUS
Data format:	8 bit + no parity + 1 stop bit (ASCII) 7 bit + even parity + 1 stop bit (MessBus)
Rate:	600...230 400 Baud 9 600 Baud...12 Mbaud (PROFIBUS)
RS 232:	isolated, two-way communication
RS 485:	isolated, two-way communication, addressing (max. 31 instruments)
PROFIBUS	Data protocol SIEMENS

### ANALOG OUTPUTS

Type:	isolated, programmable with 16 bits D/A converter, analogoutput corresponds with displayed data, type and range are adjustable
Non-linearity:	0,1% of range
TC:	15 ppm/°C
Rate:	response to change of value < 1 ms
Voltage:	0...2 V/5 V/10 V/±10 V
Current:	0...5/20 mA/4...20 mA - compensation of conduct to 500 Ω/12 V or 1 000 Ω/24 V

### MEASURED DATA RECORD

Type RTC:	time-controlled logging of measured data into instrument memory, allows to log up to 250 000 values
Type FAST:	fast data logging into instrument memory, allows to log up to 8 000 values at a rate of 40 records/s
Transmission:	via data output RS 232/485 or via OM Link

\* values apply for resistance load

**POWER SUPPLY**

Options:	10...30 V AC/DC, 13,5 VA PF $\geq$ 0,4, $I_{LTP} < 40$ A/1 ms, isolated fuse inside [T 4000 mA]
	80...250 V AC/DC, 13,5 VA PF $\geq$ 0,4, $I_{LTP} < 40$ A/1 ms, isolated fuse inside [T 630 mA]

**MECHANIC PROPERTIES**

Material:	Noryl GFN2 SE1, incombustible UL 94 V-1
Dimensions:	96 x 48 x 120 mm
Panel cut-out:	90,5 x 45 mm


**OPERATING CONDITIONS**

Connection:	connector terminal board, conductor cross-section $< 1,5$ mm <sup>2</sup> / $< 2,5$ mm <sup>2</sup>
Stabilisation period:	within 15 minutes after switch-on
Working temp.:	-20°...60°C
Storage temp.:	-20°...85°C
Cover:	IP64 (front panel only)
Construction:	safety class I
Dielectric strength:	4 kVAC after 1 min between supply and input 4 kVAC after 1 min between supply and data/ analog output 4 kVAC after 1 min between supply and relay output 2,5 kVAC after 1 min between supply and data/ analog output
Overvoltage cat.:	EN 61010-1, A2
Insulation resist.:	for pollution degree II, measurement cat. III instrum.power supply > 670 V [PI], 300 V [DI] Input/output > 300 V [PI], 150 V [DI]
EMC:	EN 61326-1


## 12. INSTRUMENT DIMENSIONS AND INSTALLATION




**Front view**



**Panel cut**





**Side view**



Panel thickness: 0,5...20 mm

### INSTRUMENT INSTALLATION

1. insert the instrument into the panel cut-out
2. fit both travellers on the box
3. press the travellers close to the panel

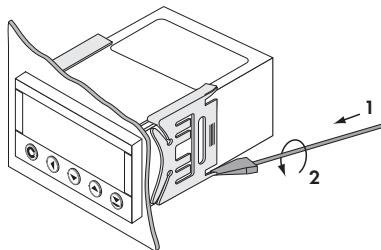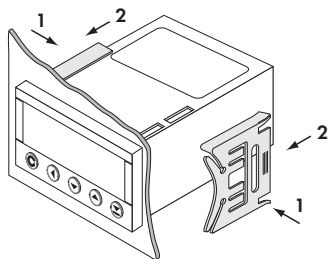

### INSTRUMENT DISASSEMBLY

1. slide a screw driver under the traveller wing
2. turn the screw driver and remove the traveller
3. take the instrument out of the panel



Product **DM 402PWR**  
 Type .....  
 Manufacturing No. ....  
 Date of sale .....

# GUARANTEE

A guarantee period of 60 months from the date of sale to the user applies to this instrument.  
 Defects occurring during this period due to manufacture error or due to material faults shall be eliminated free of charge.

For quality, function and construction of the instrument the guarantee shall apply provided that the instrument was connected and used in compliance with the instructions for use.

The guarantee shall not apply to defects caused by:

- mechanic damage
- transportation
- intervention of unqualified person incl. the user
- unavoidable event
- other unprofessional interventions

The manufacturer performs guarantee and post.guarantee repairs unless provided for otherwise.

Y E A R S

Stamp, signature

NOTE





NOTE



**Company:** **ORBIT MERRET, spol. s r.o.**  
Klánova 81/141, 142 00 Prague 4, Czech Republic, IDNo.: 00551309

**Manufactured: ORBIT MERRET, spol. s r.o.**  
Vodňanská 675/30, 198 00 Prague 9, Czech Republic

declares at its explicit responsibility that the product presented hereunder meets all technical requirements, is safe for use when utilised under the terms and conditions determined by ORBIT MERRET, spol.s r.o. and that our company has taken all measures to ensure conformity of all products of the types referred-to hereunder, which are being brought out to the market, with technical documentation and requirements of the appurtenant Czech statutory orders.

**Product:** Programmable panel instrument

**Type** **DM 402**

**Version:** UNI, PWR

**That has been designed and manufactured in line with requirements of:**

Statutory order no. 17/2003 Coll., on low-voltage electrical equipment (directive no. 73/23/EHS)  
Statutory order no. 616/2006 Coll., on electromagnetic compatibility (directive no. 2004/108/EHS)

**The product qualities are in conformity with harmonized standard:**

El. safety: EN 61010-1  
EMC: EN 61326-1  
Electronic measuring, control and laboratory devices – Requirements for EMC "Industrial use"  
EN 50131-1, chap. 14 and chap. 15, EN 50130-4, chap. 7, EN 50130-4, chap. 8, [EN 61000-4-11, ed. 2],  
EN 50130-4, chap. 9 [EN 61000-4-2], EN 50130-4, chap. 10, [EN 61000-4-3, ed. 2], EN 50130-4, chap. 11 [EN 61000-4-6],  
EN 50130-4, chap. 12, [EN 61000-4-4, ed. 2], EN 50130-4, chap. 13 [EN 61000-4-5], EN 61000-4-8, EN 61000-4-9,  
EN 61000-6-1, EN 61000-6-2, EN 65022, chap. 5 and chap. 6

The product is furnished with CE label issued in 2006.

**As documentation serve the protocols of authorized and accredited organizations:**

EMC: MO CR, Testing institute of technical devices, protocol no. 80/6-46/2006 of 03/03/2006  
MO CR, Testing institute of technical devices, protocol no. EMI.80/6-333/2006 of 15/01/2007

Place and date of issue: Prague, 19. Juli 2010

Miroslav Hackl  
Company representative

Assessment of conformity pursuant to §22 of Act no. 22/1997 Coll. and changes as amended by Act no.71/2000 Coll. and 205/2002 Coll