



# OMD 202UNI

---

**4/6 DIGIT PROGRAMMABLE  
UNIVERSAL LAGRE DISPLAY**

DC VOLTMETER/AMMETER

PROCESS MONITOR


OHMMETER

THERMOMETER FOR PT 100/500/1 000

THERMOMETER FOR NI 1 000

THERMOMETER FOR THERMOCOUPLES

DISPLAYS FOR LIN. POTENTIOMETERS

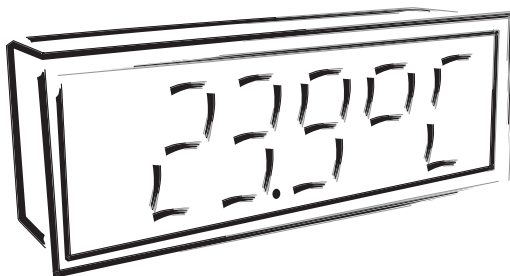



## SAFETY INSTRUCTIONS

Please, read the enclosed safety instructions carefully and observe them!  
These instruments should be safeguarded by isolated or common fuses (breakers)  
For safety information the EN 61 010-1 + A2 standard must be observed.  
This instrument is not explosion-safe!

## TECHNICAL DATA

Measuring instruments of the OMD 202 series conform to the European regulation 89/336/EWG.

The instruments are up to the following European standards:  
EN 55 022, class B  
EN 61000-4-2, -4, -5, -6, -8, -9, -10, -11

The instruments are applicable for unlimited use in agricultural and industrial areas.

## CONNECTION

Supply of energy from the main line has to be isolated from the measuring leads.



### ORBIT MERRET, spol. s r.o.

Vodnanská 675/30  
198 00 Prague 9  
Czech Republic

Tel: +420 - 281 040 200  
Fax: +420 - 281 040 299  
e-mail: orbit@merret.cz  
www.orbit.merret.cz



<b>1. CONTENTS</b> .....	<b>3</b>
<b>2. INSTRUMENT DESCRIPTION</b> .....	<b>4</b>
<b>3. INSTRUMENT CONNECTION</b> .....	<b>6</b>
Measuring ranges .....	6
Termination of RS 485 communication line .....	6
Instrument connection .....	7
Recommended connection of sensors .....	8
<b>4. INSTRUMENT SETTING</b> .....	<b>10</b>
Symbols used in the instructions .....	12
Setting the DP and the {} sign .....	12
Control keys function .....	13
Setting/permitting items into 'USER' menu .....	13
<b>5. SETTING "LIGHT" MENU</b> .....	<b>14</b>
5.0 Description "LIGHT" menu .....	15
Setting input - Type "DC" .....	18
Setting input - Type "PM" .....	20
Setting input - Type "OHM" .....	22
Setting input - Type "RTD - Pt" .....	24
Setting input - Type "RTD - Ni" .....	26
Setting input - Type "T/C" .....	28
Setting input - Type "DU" .....	20
Setting input - Type "RTD - Cu" .....	32
Setting Limits .....	34
Setting analog output .....	36
Setting display colors .....	38
Setting the address of IR remote control .....	40
Selection of programming menu „LIGHT"/„PROFI" .....	40
Restoration of manufacture setting .....	40
Calibration - input range [DU] .....	41
Selection of instrument menu language version .....	42
Setting new access password .....	43
Instrument identification .....	43
<b>6. SETTING "PROFI" MENU</b> .....	<b>44</b>
6.0 Description of "PROFI" menu .....	44
6.1 "PROFI" menu - INPUT .....	44
6.1.1 Resetting internal values .....	48
6.1.2 Setting measuring type, range, mode, rate, ... ..	49
6.1.3 Setting the Real Time .....	53
6.1.4 External input function selection .....	53
6.1.5 Optional accessory functions of the keys ..	54
6.2 "PROFI" menu - CHANNEL .....	58
6.2.1 Setting measuring parameters [projection, filters, decimal point, description] .....	58
6.2.2 Setting mathematic functions .....	61
6.2.3 Selection of evaluation of min/max. value ..	63
6.3 "PROFI" menu - OUTPUT .....	65
6.3.1 Setting Limits .....	65
6.3.2 Setting data output .....	69
6.3.3 Setting analog output .....	69
6.3.4 Selection of display projection .....	71
6.4 "PROFI" menu - SERVICE .....	74
6.4.1 Setting the address of IR remote control ..	74
6.4.2 Selection of programming menu „LIGHT"/„PROFI" .....	75
6.4.3 Restoration manufacture setting .....	76
6.4.4 Calibration - input range [DU] .....	77
6.4.5 Selection of instr. menu language version ..	77
6.4.6 Setting new access password .....	78
6.4.7 Instrument identification .....	78
<b>7. SETTING ITEMS INTO "USER" MENU</b> .....	<b>80</b>
<b>8. METHOD OF MEASURING OF THE COLD JUNCTION</b> ..	<b>82</b>
<b>9. DATA PROTOCOL</b> .....	<b>83</b>
<b>10. ERROR STATEMENTS</b> .....	<b>86</b>
<b>11. TABLE OF SYMBOLS</b> .....	<b>87</b>
<b>12. TECHNICAL DATA</b> .....	<b>88</b>
<b>13. INSTRUMENT DIMENSIONS AND INSTALATION</b> ...	<b>90</b>
<b>14. CERTIFICATE OF GUARANTEE</b> .....	<b>91</b>
<b>DECLARATION OF CONFORMITY</b> .....	<b>92</b>

## 2. INSTRUMENT DESCRIPTION



### 2.1 DESCRIPTION

The OMD 202 model series are 4/6 digit large panel programmable displays designed for maximum efficiency and user comfort while maintaining their favourable price. It comes either with a 3-colour LED display (red/green/orange) or with High Brightness LEDs (red or green with brightness of 1 300 mcd).

Type OMD 202UNI is a multifunction instrument with the option of configuration for 8 various input options, easily configurable in the instrument menu. By further options of input modules it is feasible to measure larger ranges of DC voltage and current or increase the number of inputs up to 4 (applies for PM).

The instrument is based on an 8-bit microcontroller with a multichannel 24-bit sigma-delta converter, which secures high accuracy, stability and easy operation of the instrument.

### THE OMD 202 IS A MULTIFUNCTION INSTRUMENT AVAILABLE IN FOLLOWING TYPES AND RANGES

<b>UNI</b>	DC:	$\pm 60/\pm 150/\pm 300/\pm 1200$ mV
	PM:	0..5 mA/0..20 mA/4..20 mA/ $\pm 2$ V/ $\pm 5$ V/ $\pm 10$ V/ $\pm 40$ V
	OHM:	0..100 /0..1 k/0..10 k/0..100 k
	RTD-Pt:	Pt 50/100/Pt 500/Pt 1 000
	RTD-Cu:	Cu 50/Cu 100
	RTD-Ni:	Ni 1 000/Ni 10 000
	T/C:	J/K/T/E/B/S/R/N/L
	DU:	Linear potentiometer [min. 500 ]
<b>UNI - A</b>	DC:	$\pm 0,1$ A/ $\pm 0,25$ A/ $\pm 0,5$ A/ $\pm 2$ A/ $\pm 5$ A/ $\pm 100$ V/ $\pm 250$ V/ $\pm 500$ V
<b>UNI - B</b>	PM:	3x 0..5 mA/0..20 mA/4..20 mA/ $\pm 2$ V/ $\pm 5$ V/ $\pm 10$ V/ $\pm 40$ V

### PROGRAMMABLE PROJECTION

Selection:	of type of input and measuring range
Measuring range:	adjustable as fixed or with automatic change
Setting:	manual, optional projection on the display may be set in the menu for both limit values of the input signal, e.g. input 0..20 mA > 0...850,0
Projection:	-9999...9999 [-99999...999999]

### COMPENSATION

of conduct:	in the menu it is possible to perform compensation for 2-wire connection
of conduct in probe:	internal connection (conduct resistance in measuring head)
of CJC (T/C):	manual or automatic, in the menu it is possible to perform selection of the type of thermocouple and compensation of cold junctions, which is adjustable or automatic (temperature at the brackets)

### LINEARIZATION

Linearization:*	by linear interpolation in 50 points (solely via DM Link)
-----------------	---

### DIGITAL FILTERS

Floating average:	from 2...30 measurements
Exponen.average:	from 2...100 measurements
Rounding:	setting the projection step for display

### MATHEMATIC FUCTIONS

Min/max. value:	registration of min./max. value reached during measurement
Tare:	designed to reset display upon non-zero input signal
Peak value:	the display shows only max. or min. value
Mat. operations:	polynome, 1/x, logarithm, exponential, power, root, sin x

\* only for types DC, PM, DU

**EXTERNAL CONTROL**

Lock:	control keys blocking
Hold:	display/instrument blocking
Tare:	tare activation/resetting tare to zero
Resetting MM:	resetting min/max value

**2.2 OPERATION**

The instrument is set and controlled by IR Remote control. All programmable settings of the instrument are performed in three adjusting modes:

<b>LIGHT</b>	<b>Simple programming menu</b> - contains solely items necessary for instrument setting and is protected by optional number code
<b>PROFI</b>	<b>Complete programming menu</b> - contains complete instrument menu and is protected by optional number code
<b>USER</b>	<b>User programming menu</b> - may contain arbitrary items selected from the programming menu (LIGHT/PROFI), which determine the right (see or change) - access without password

All programmable parameters are stored in the EEPROM memory (they hold even after the instrument is switched off).



Complete instrument operation and setting may be performed via OMLink communication interface, which is a standard equipment of all instruments.

The operation program is freely accessible ([www.orbit.merret.cz](http://www.orbit.merret.cz)) and the only requirement is the purchase of OML cable to connect the instrument to PC. It is manufactured in version RS 232 and USB and is compatible with all ORBIT MERRET instruments. Another option for connection is with the aid of data output RS 232 or RS 485 (without the need of the OML cable).

The program OMLINK in „Basic“ version will enable you to connect one instrument with the option of visualization and archiving in PC. The OMLINK „Standard“ version has no limitation of the number of instruments connected.

**2.3 OPTIONS**

**Excitation** is suitable for supplying power to sensors and transmitters. It has a galvanic separation.

**Comparators** are assigned to monitor one, two, three or four limit values with relay output. The user may select limits regime: LIMIT/DOSING/FROM-TD. The limits have adjustable hysteresis within the full range of the display as well as selectable delay of the switch-on in the range of 0...99,9 s. Reaching the preset limits is signalled by LED and simultaneously by the switch-on of the relevant relay.

**Data outputs** are for their rate and accuracy suitable for transmission of the measured data for further projection or directly into the control systems. We offer an isolated RS232 and RS485 with the ASCII or DIN MessBus protocol.

**Analog outputs** will find their place in applications where further evaluating or processing of measured data is required in external devices. We offer universal analog output with the option of selection of the type of output - voltage/current. The value of analog output corresponds with the displayed data and its type and range are selectable in Menu.

### 3. INSTRUMENT CONNECTION



The instrument supply leads should not be in proximity of the incoming low-potential signals.

Contactors, motors with larger input power should not be in proximity of the instrument.

The leads into the instrument input (measured quantity) should be in sufficient distance from all power leads and appliances. Provided this cannot be secured it is necessary to use shielded leads with connection to ground (bracket E).

The instruments are tested in compliance with standards for use in industrial area, yet we recommend to abide by the above mentioned principles.

#### MEASURING RANGES

TYPE	INPUT I	INPUT U
DC		0...60/150/300/1 200 mV
PM	0...5/20 mA/4...20 mA	±2/±5/±10/±40 V
DHM	0...100 Ω/1 kΩ/10 kΩ/100 kΩ/Auto	
RTD-Pt	Pt 50/100/Pt 500/ Pt 1 000	
RTD-Cu	Cu 50/100	
RTD-Ni	Ni 1 000/10 000	
T/C	J/K/T/E/B/S/R/N/L	
DU	Linear potentiometer (min. 500 Ω)	

#### OPTION "A"

TYPE	INPUT I	INPUT U
DC	±0.1 A/±0.25 A/±0.5 A profi GND [C] ±2 A/±5 A profi GND [E]	±100 V/±250 V/±500 V profi GND [C]

#### OPTION "B"


TYPR	INPUTS 2, 3, 4/I	INPUTS 2, 3, 4/U
PM	0...5/20 mA/4...20 mA	±2/±5/±10/±40 V


#### Termination of RS 485 communication line

##### X3 - Termination of communication line RS 485

Full	Significance	Default	Recommendation
1-2	connect L+ to (+) source	terminalconnected	connect at the end of line do not disconnect
3-4	termination of line 120 Ohm	disconnected	
5-6	connect L- to (-) source	terminalconnected	

RS 485 line should have a linear structure - wires (ideally shielded and twisted) should lead from one device to another.



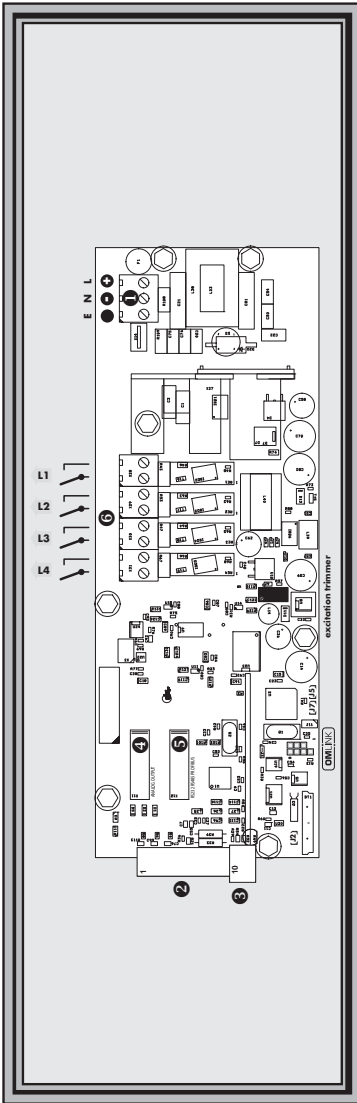


**1 Power supply**



**4 Analog output**



**2 Input**



**5 Data output**



**6 Relays**



**3 INPUT - Option**



**Jumpers**

- J2 backup battery
- J5 hardware test
- J7 "cold" lead of instrument's FW



Maximum of 250 mA may be connected to "INPUT - I" (bracket no. 21), i.e. 10-times range overload.  
Mind the correct connection/mistaking of current - voltage input.  
Destruction of measuring resistance in current input [15R] may occur.

**FWK**



**Option A**



**Option B**



**RD, CHM, NI**




**DC FW**



**RxD/L+**




**GND**




### 3. INSTRUMENT CONNECTION

Example connection of a 2-wire sensor with current signal output powered by instrument's excitation

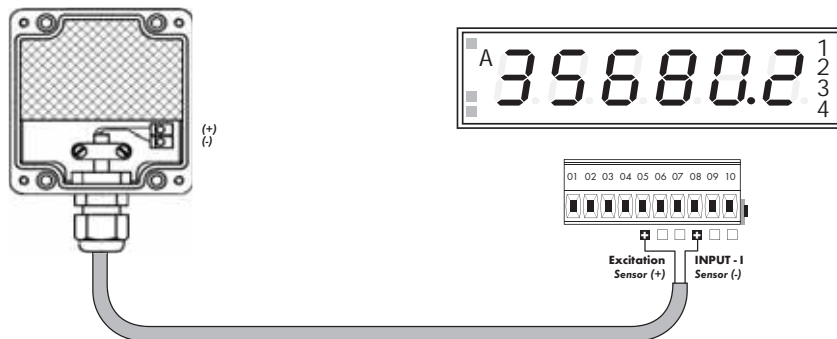


Example connection of a 3-wire sensor with current signal output powered by instrument's excitation

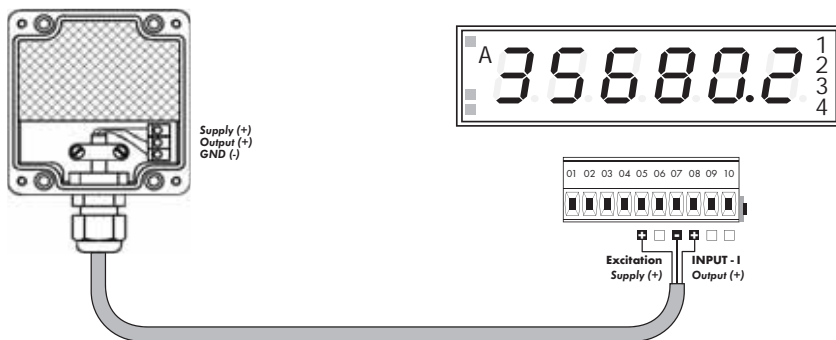




Example connection of 3-wire sensor with voltage signal output powered by instrument's excitation

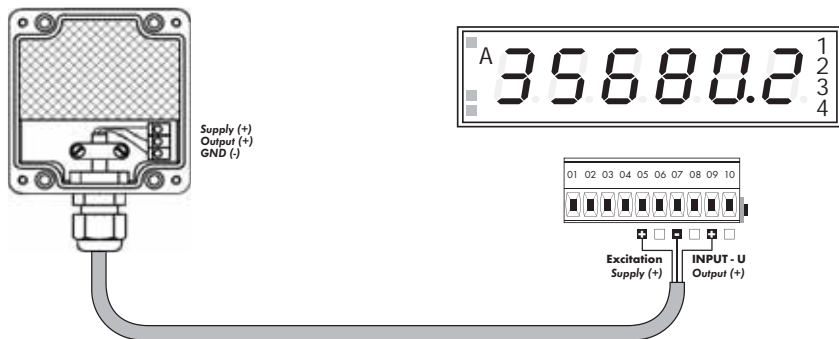

Example connection of resistance measurement using 4 wires

By connecting resistor  $R^*$  we eliminate error message E. I.O.V. (input overflow) when the measured resistance is disconnected

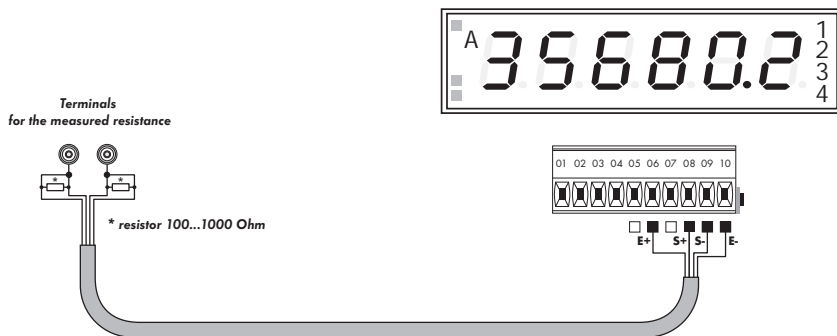



## SETTING **PROFI**

For expert users

Complete instrument menu

Access is password protected

Possibility to arrange items of the **USER MENU**

Tree menu structure

## SETTING **LIGHT**

For trained users

Only items necessary for instrument setting

Access is password protected

Possibility to arrange items of the **USER MENU**

Linear menu structure

## SETTING **USER**

For user operation

Menu items are set by the user (Profi/Light) as per request

Access is not password protected

Optional menu structure either tree (PROFI) or linear (LIGHT)

## 4.1 SETTING


The instrument is set and controlled by IR Remote control. All programmable settings of the instrument are performed in three adjusting modes:

- LIGHT**      **Simple programming menu**  
 - contains solely items necessary for instrument setting and is protected by optional number code
- PROFI**      **Complete programming menu**  
 - contains complete instrument menu and is protected by optional number code
- USER**        **User programming menu**  
 - may contain arbitrary items selected from the programming menu (LIGHT/PROFI), which determine the right (see or change)  
 - access without password

Complete instrument operation and setting may be performed via OMLink communication interface, which is a standard equipment of all instruments.


The operation program is freely accessible ([www.orbit.merret.cz](http://www.orbit.merret.cz)) and the only requirement is the purchase of OML cable to connect the instrument to PC. It is manufactured in version RS 232 and USB and is compatible with all ORBIT MERRET instruments. Another option for connection is with the aid of data output RS 232 or RS 485 (without the need of the OML cable).

## Scheme of processing the measured signal

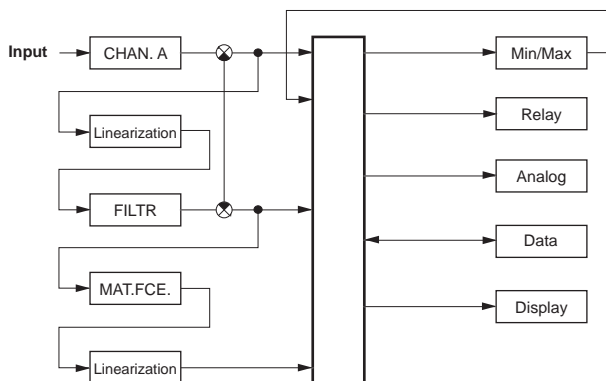

## 4. INSTRUMENT SETTING

Setting and controlling the instrument is performed by means of the Remote control. With the aid of the Remote control it is possible to browse through the operation menu and to select and set the required values.

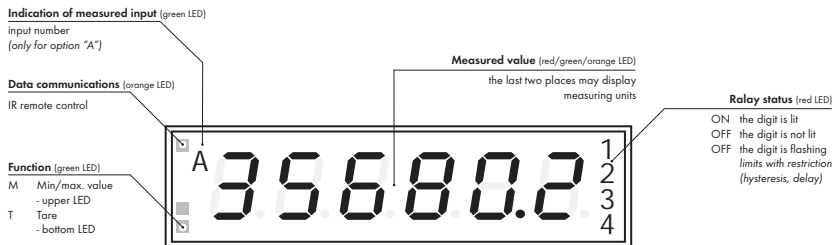

### Symbols used in the instructions



Indicates the setting for given type of instrument



values preset from manufacture



symbol indicates a flashing light (symbol)



inverted triangle indicates the item that can be placed in USER menu



broken line indicates a dynamic item, i.e. it is displayed only in particular selection/version



after pressing the key the set value will not be stored



after pressing the key the set value will be stored



continues on page 30

### Setting the decimal point and the minus sign

#### DECIMAL POINT

Its selection in the menu, upon modification of the number to be adjusted it is performed by the control key with transition beyond the highest decade, when the decimal point starts flashing. Positioning is performed by .

#### THE MINUS SIGN

Setting the minus sign is performed by the key on higher decade. When editing the item subtraction must be made from the current number (e.g.: 013 > , on class 100 > -87)

## Control keys functions

KEY	MEASUREMENT	MENU	SETTING NUMBERS/SELECTION
	access into USER menu	exit menu	quit editing
	programmable key function	back to previous level	move to higher decade*
	programmable key function	move to previous item	move down*
	programmable key function	move to next item	move up*
	programmable key function	confirm selection	confirm setting/selection
	access into LIGHT/PROFI menu		
>3 s 	direct access into PROFI menu		
		configuration of an item for "USER" menu	
		determine the sequence of items in "USER - LIGHT" menu	
	cancellation of address instrument/remote controller		

\* alternatively, the setting may be done from the numeric keys of the remote control by selecting directly the number required

## Setting items into „USER“ menu

- in **LIGHT** or **PROFI** menu
- no items permitted in **USER** menu from manufacture
- on items marked by inverted triangle

## USER

legend is flashing - current setting is displayed



- NO item will not be displayed in USER menu
- YES item will be displayed in USER menu with the option of setting
- SHOW item will be solely displayed in USER menu



# SETTING LIGHT

For trained users

Only items necessary for instrument setting

Access is password protected

Possibility to arrange items of the **USER MENU**

Linear menu structure

### Preset from manufacture

Password	"0"
Menu	LIGHT
USER menu	off
Setting the items	<b>DEF</b>

Access password  
 1428  PASSW

Type of instruments      Measuring range  
 TYPE       MODE

! Upon delay exceeding 60 s the programming mode is automatically discontinued and the instrument itself restores the measuring mode

**RTD OHM**  
 CONNEC       FORM.A

Selecting projection and connection

**Y/C**  
 CONNEC       C.J.TEM       FORM.A

**DC PM OHM DU**  
 MIN.A       MAX.A       FORM.A

**U.M.L.1**       **U.M.L.2**       **U.M.L.3**       **U.M.L.4**

Option - comparator

**TYP.A.O.**       **MIN.A.O.**       **MAX.A.O.**

Option - Analog output

Primary color      First color limit      Color beyond first limit      Second color limit  
**COL.0**       **DI.S.L1**       **COL.1**       **DI.S.L2**

Color beyond second limit      Remote controller address  
**COL.2**       **ADR.I.r.**

Menu type      Return to manu. calibration      Return to manufacture setting  
**MENU**       **RE.CAL.**       **RE.SET.**

Calibration - only for "DU"  
**DU**  
**C.MIN**       **C.MAX**

Language selection      New password      Identification      Type instrument      SW version      Input  
**LANG.**       **PAS.LI.**       **I.DENT.**                  

Return to measuring mode

## 5. SETTING LIGHT

1428



PASSW

0

Entering access password for access into the menu

**PASSW. Access into instrument menu**

**PAS = 0**

- access into menu is unrestricted, after releasing keys you automatically move to first item of the menu

**PAS > 0**

- access into menu is protected by number code

Set "Password" = 42 Example

0 1 2 02 12 22

32 42 TYPE

TYPE

DC PM OHM RTD- Pt RTD-Ni TC

DU RTD- Cu

**TYPE Selection of the type of instrument**

- primary selection of the type of instrument
- performs default setting **DEF** of values from manufacture, incl. calibration

Menu	Type of instrument
DC	DC voltmeter
PM	Process monitor
OHM	Ohmmeter
RTD-Pt	Thermometer for sensors Pt
RTD-Ni	Thermometer for sensors Ni
TC	Thermometer for thermocouples
DU	Display for lin. potentiometer
RTD-Cu	Thermometer for sensors Cu

Type "PM" Example

DC PM MODE


Type „DC“	18
Type "PM"	20
Type "OHM"	22
Type "RTD-Pt"	24
Type "RTD-Ni"	26
Type "TC"	28
Type "DU"	30
Type "RTD-Cu"	32





## 5. SETTING LIGHT

MEASURING MODE > DC

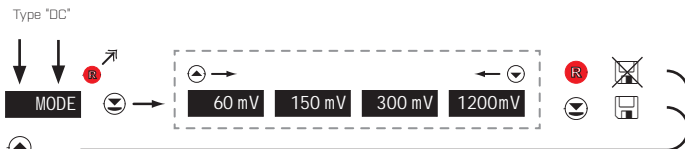

**MODE** Selection of the instrument measuring range

**DEF** = 60 mV

**DEF** = 500 V\*

\* only for option "A"

	Menu	Measuring range
<b>MOD</b>	60 mV	±60 mV
	150 mV	±150 mV
	300 mV	±300 mV
	1200mV	±1.2 V
<b>MOD - A</b>	100 V	±100 V
	250 V	±250 V
	500 V	±500 V
	0.10 A	±0.1 A
	0.25 A	±0.25 A
	0.50 A	±0.5 A
	1.00 A	±1 A
	5.00 A	±5 A

Range ±150 mV Example

60 mV 150 mV MIN A



**MIN A** Setting display projection for minimum value of input signal

- range of the setting is -99999...999999
- position of the DP does not affect display projection

- the DP is automatically shifted after the value is confirmed

**DEF** = 0

Projection for 0 mV > MIN A = 0 Example

0 MAX A




**MAX A** Setting display projection for maximum value of input signal

- the DP is automatically shifted after the value is confirmed
- range of the setting is -99999...999999
- position of the DP does not affect display projection

**DEF** = 100

Projection for 150 mV > MAX A = 3500 Example

100	100	100	200	300	400
500	0500	1500	2500	3500	FORM A

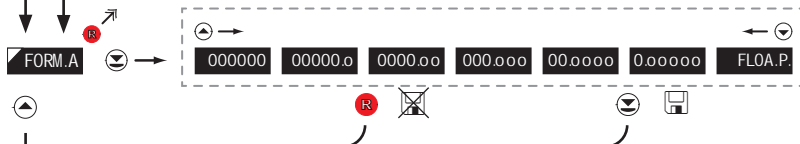

**FORM.A** Setting projection of the decimal point

**DEF** = 0000.00

- positioning of the DP is set here in the measuring mode

Projection of DP on display > 00000.0 Example

0000.00	00000.0	COL 0
---------	---------	-------

\*subsequent item on the menu depends on instrument equipment

## 5. SETTING LIGHT

MEASURING MODE > PM

Type "PM"

MODE

0-5mA 0-20mA 4-20mA ... 0-10 V 0-40 V Er4-20

MODE Selection of the instrument measuring range

DEF = 4 - 20 mA

Menu	Range
0-5mA	0...5 mA
0-20mA	0...20 mA
4-20mA	4...20 mA
0-2 V	±2 V
0-5 V	±5 V
0-10 V	±10 V
0-40 V	±40 V
Er4-20	4...20 mA, with error statement of „underfl ow“ upon signal smaller than 3,36 mA

Range 0...20 mA Example

4-20mA 0-20 mA MNA

MNA Setting for minimum input signal

0

MNA Setting display projection for minimum value of input signal

- range of the setting is -99999...99999
- position of the DP does not affect display projection
- the DP is automatically shifted after the value is confirmed

DEF = 0

Projection for 0 mA > MIN A = -25 Example

0	1	2	3	4	5
0.5	1.5	2.5	3.5	4.5	5.5

MAX A




**MAX A** Setting display projection for maximum value of input signal

- the DP is automatically shifted after the value is confirmed
- range of the setting is -99999...999999
- position of the DP does not affect display projection

**DEF** = 100

Projection for 20 mA > MAX A = 2500 Example

100	100	100	200	300	400
500	0500	1500	2500	FORM.A	

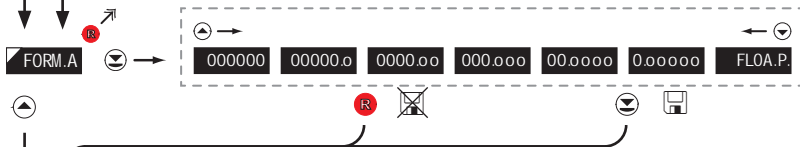

**FORM.A** Setting projection of the decimal point

- positioning of the DP is set here in the measuring mode

**DEF** = 0000.00


Projection of DP on display > 00000.0 Example

0000.00	00000.0	COL.0
---------	---------	-------

\*subsequent item on the menu depends on instrument equipment

## 5. SETTING LIGHT

MEASURING MODE > OHM

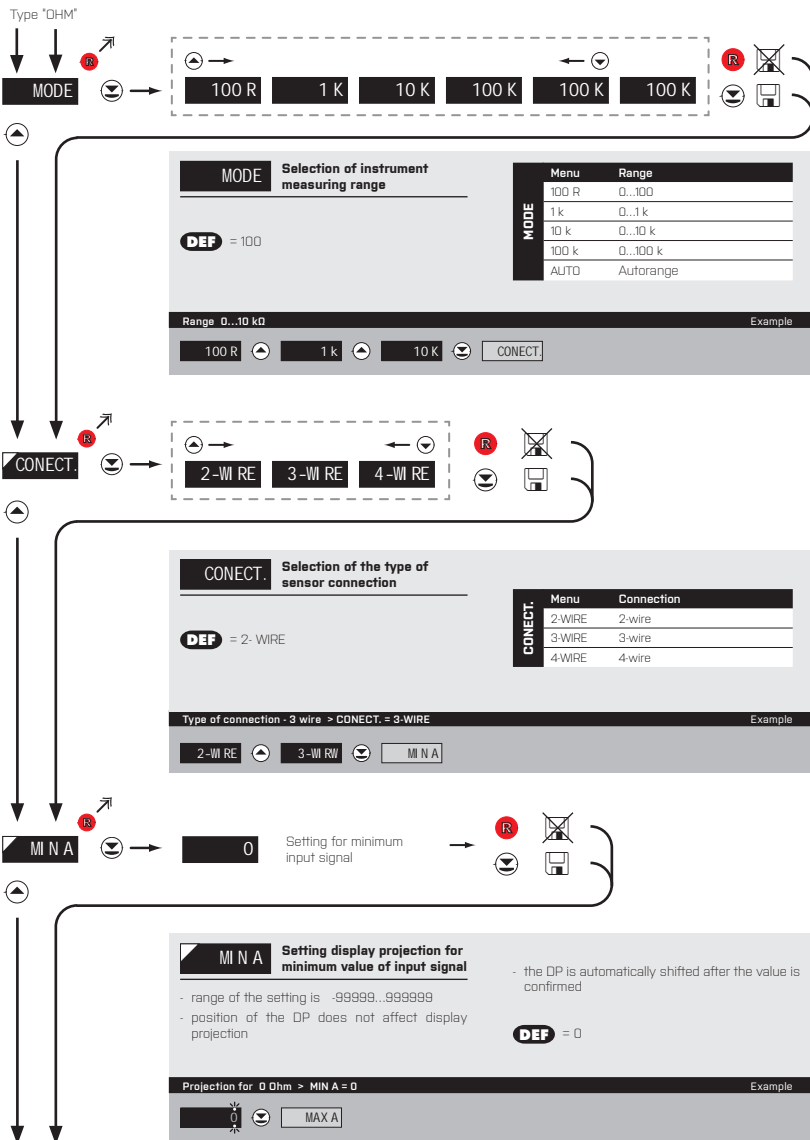




**MAX A** Setting display projection for maximum value of input signal

- the DP is automatically shifted after the value is confirmed
- range of the setting is -99999..999999
- position of the DP does not affect display projection

**DEF** = 100

Projection for 10 kOhm > MAX A = 10000 Example

100	100	100	000	0000	00000	000000
00000	FORM.A					

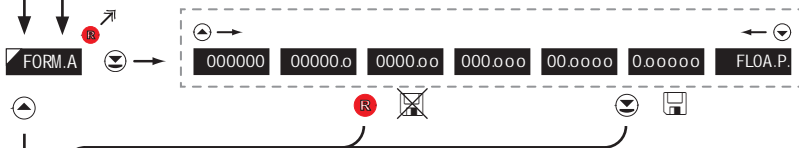

**FORM.A** Setting projection of the decimal point

- positioning of the DP is set here in the measuring mode

**DEF** = 0000.00

Projection of DP on display > 00000.0 Example

0000.00	00000.0	COL.0
---------	---------	-------

\*subsequent item on the menu depends on instrument equipment

## 6. SETTING PROFI

MEASURING MODE > RTD-Pt



**MODE** Selection of instrument measuring range

**DEF** = Pt 100

MODE	Menu	Range
	EU-100	Pt 100 (3 850 ppm/°C)
	EU-500	Pt 500 (3 850 ppm/°C)
	EU-1k0	Pt 1000 (3 850 ppm/°C)
	US-100	Pt 100 (3 920 ppm/°C)
	RU-50	Pt 50 (3 910 ppm/°C)
	RU-100	Pt 100 (3 910 ppm/°C)

Range - Pt 1000 > MODE = EU-1k0 Example

EU-100 EU-500 **EU-1k0** CONECT



**CONNECT.** Selection of the type of sensor connection


**DEF** = 2-WIRE

CONNECT.	Menu	Connection
	2-WIRE	2-wire
	3-WIRE	3-wire
	4-WIRE	4-wire

Type of connection - 3 wire > CONNEC = 3-WIRE Example


2-WIRE 3-WIRE **3-WIRE** FORMLA




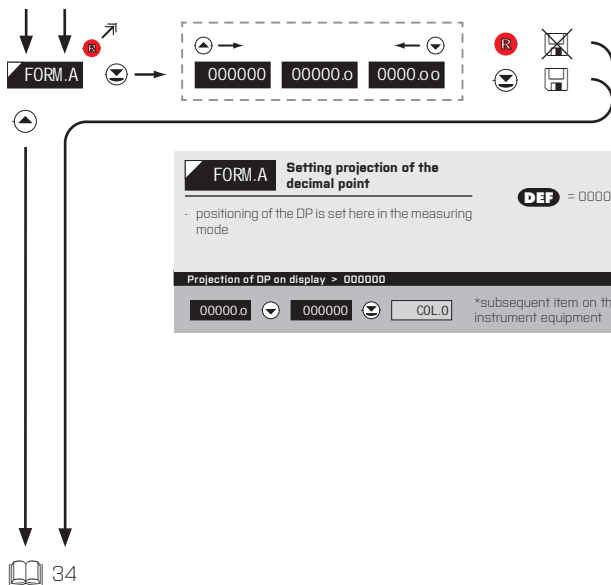

## 5. SETTING LIGHT


MEASURING MODE > RTD-NI

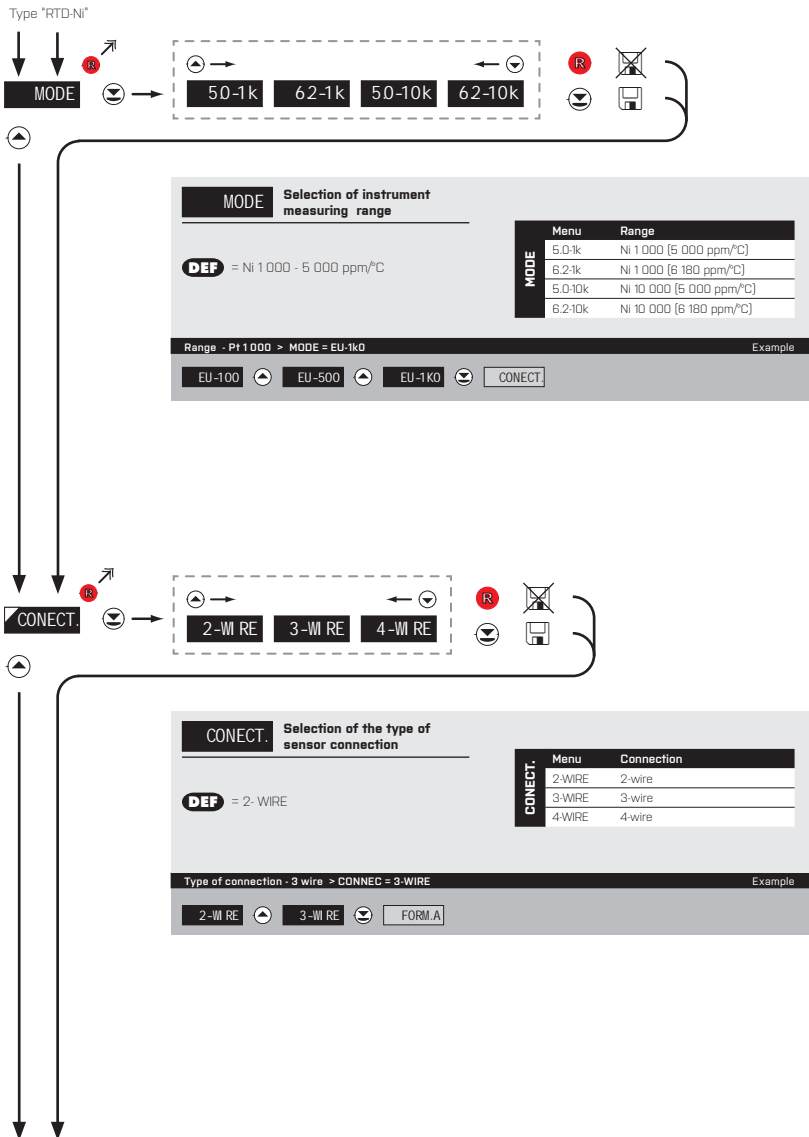


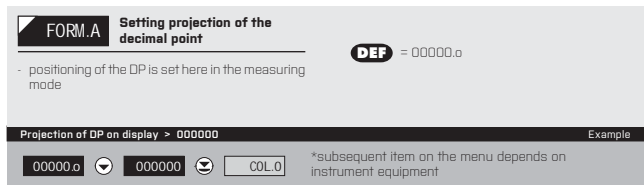

## 5. SETTING LIGHT

MEASURING MODE > T/C

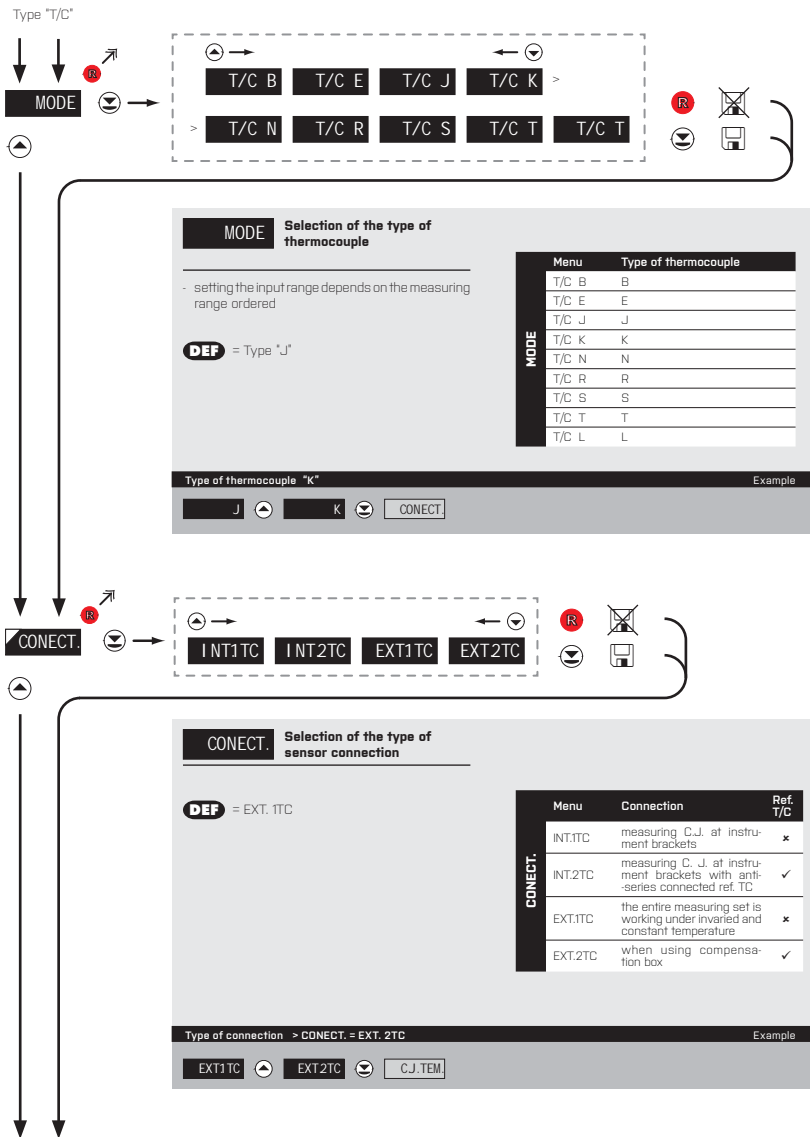

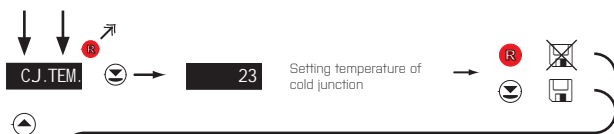

Setting temperature of cold junction

**C.J. TEM.** Setting temperature of cold junction

- range 0...99°C with compensation box

**DEF** = 23

Setting temperature of cold junction > C.J. TEM. = 35 Example

23 24 25 25 35 FORM A



**FORM.A** Setting projection of the decimal point

- positioning of the DP is set here in the measuring mode

**DEF** = 00000.0

Projection of DP on display > 000000 Example

00000.0 000000 COL.0 \*subsequent item on the menu depends on instrument equipment

! For thermocouple type "B" the items **CONNECT.** and **C.J. TEM.** are not available

! Method and procedure of setting the cold junctions is described in separate chapter on page 80

## 5. SETTING LIGHT

MEASURING MODE > DU



**MIN A** **Setting display projection for minimum value of input signal**

- range of the setting is -99999...999999
- position of the DP does not affect display projection

- the DP is automatically shifted after the value is confirmed

**DEF** = 0

Projection for the beginning > MIN A = 0 Example




**MAX A** **Setting display projection for maximum value of input signal**

- range of the setting is -99999...999999
- position of the DP does not affect display projection

- the DP is automatically shifted after the value is confirmed

**DEF** = 100

Projection for the end > MAX A = 5000 Example

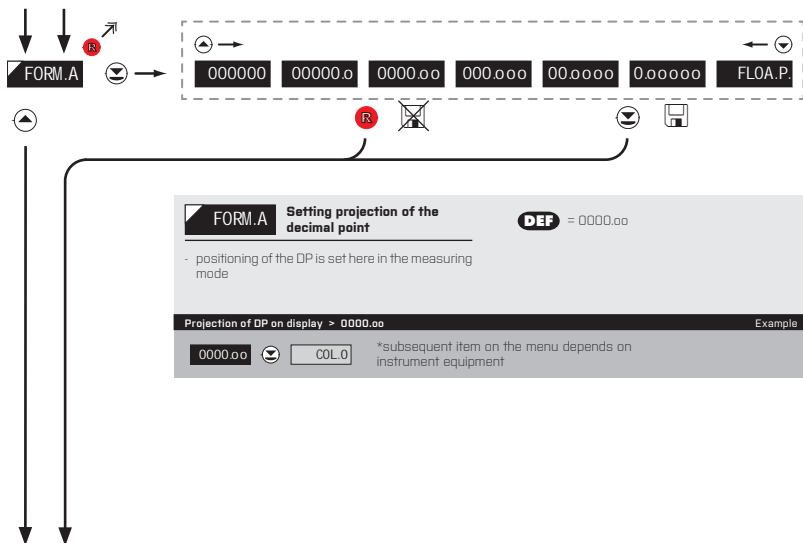

34

Calibration of the beginning and the end of range of linear potentiometer is on page 41

## 5. SETTING LIGHT

MEASURING MODE > RTD-Cu

Type 'RTD-Cu'

MODE

428-50 428-01 426-50 426-01

⏪ ⏩

⏴ ⏵

⏶ ⏷

⏸ ⏹

⏺ ⏻

**MODE** Selection of instrument measuring range

**DEF** = Cu 50/4 280 ppm

Menu	Range
428-50	Cu 50 (4 285 ppm/°C)
428-100	Cu 100 (4 285 ppm/°C)
426-50	Cu 50 (4 260 ppm/°C)
426-100	Cu 100 (4 260 ppm/°C)

Range - Cu-50/4 280 ppm > MODE = 426-50 Example

428-50 ⏴ 428-01 ⏵ 426-50 ⏶ ⏷ **CONNECT**

CONNECT

2-WIRE 3-WIRE 4-WIRE

⏪ ⏩

⏴ ⏵

⏶ ⏷

⏸ ⏹

⏺ ⏻

**CONNECT.** Selection of the type of sensor connection


**DEF** = 2-WIRE

Menu	Connection
2-WIRE	2-wire
3-WIRE	3-wire
4-WIRE	4-wire

Type of connection - 3 wire > CONNEC = 3-WIRE Example

2-WIRE ⏴ 3-WIRE ⏵ **FORMULA**



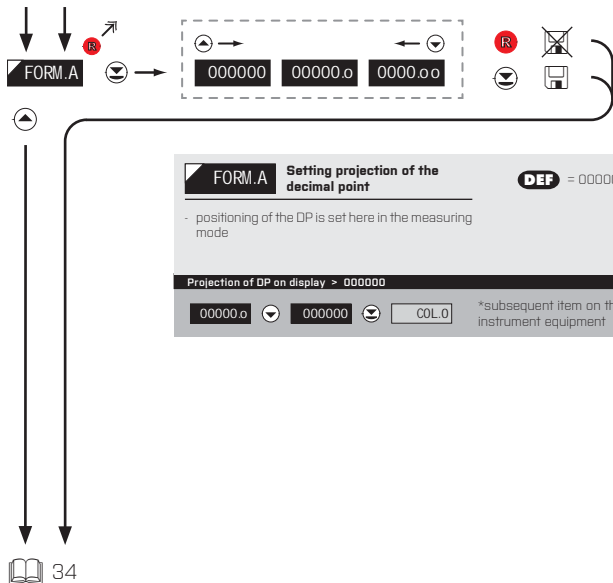

## 5. SETTING LIGHT

DISPLAYED ONLY WITH OPTIONS > COMPARATORS

UML1

↕

20

Setting boundary for limit 1

→

R

↕

↩

↵

UML1

**Setting boundary for limit 1**

- range of the setting is -99999...999999
- contingent modification of hysteresis or delay may be performed in 'PROF' menu

**DEF** = 20

**DEF** „Hysteresis“=0, „Delay“=0

Setting limit 1 > L1 = 32 Example

20

21

22

23

24

25

COL\_0

UML2

↕

40

Setting boundary for limit 2

→

R

↕

↩

↵

UML2

**Setting boundary for limit 2**

- range of the setting is -99999...999999
- contingent modification of hysteresis or delay may be performed in 'PROF' menu

**DEF** = 40

**DEF** „Hysteresis“=0, „Delay“=0

Setting limit 2 > L2 = 53.1 Example

40

41

42

43

44

45

51

52

531

54

551

56

571

58

591

000531


000532

000533

COL\_0

\* subsequent item on the menu depends on instrument equipment

**!** Items for 'Limits' and 'Analog output' are accessible only if incorporated in the instrument.

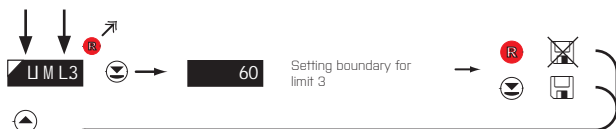


**U M L3** Setting boundary for limit 3

- range of the setting is -99999...999999
- contingent modification of hysteresis or delay may be performed in "PROF" menu

**DEF** = 60  
**DEF** „Hysteresis“=0, „Delay“=0

**Setting limit 3 > L 3 = 85** Example

60	61	62	63	64	65
65	75	85	COL.0	* subsequent item on the menu depends in instrument equipment	



**U M L4** Setting boundary for limit 4

- range of the setting is -99999...999999
- contingent modification of hysteresis or delay may be performed in "PROF" menu

**DEF** = 80  
**DEF** „Hysteresis“=0, „Delay“=0

**Setting limit 4 > L 4 = 103** Example

80	81	82	83	83	93
03	003	103	COL.0	* subsequent item on the menu depends on instrument equipment	

## 5. SETTING LIGHT

DISPLAYED ONLY WITH OPTIONS > ANALOG OUTPUT

**TYP.A.O.** Setting the type of analog output

Menu	Range	Description
0-20mA	0...20 mA	
Er.4-T	4...20 mA	signaling interrupted current loop and displaying an error message [-3.6 mA]
4-20 T	4...20 mA	signaling broken current loop [-3.6 mA]
Er.4-20mA	4...20 mA	with indication of error statement [-3.6 mA]
4-20mA	4...20 mA	
0-5mA	0...5 mA	
0-2 V	0...2 V	
0-5 V	0...5 V	
0-10 V	0...10 V	
+10 V	±10 V	

**DEF** = 4...20 mA

Type of analog output - 0...10 V > TYP. A.O. = 0-10 V Example

4-20mA 0-5mA 0-2 V 0-5 V 0-10 V MIN A.O.

**MIN A.O.** Assigning the display value to the beginning of the AO range

**DEF** = 0

- range of the setting is -99999...999999

Display value for the beginning of the AO range > MIN A.O. = 0 Example

0 MAX A.O.

**!**

Items for 'Limits' and 'Analog output' are accessible only if incorporated in the instrument.



**MAX A.O.** Assigning the display value to the end of the AD range

- range of the setting is -99999...999999

**DEF** = 100


Display value for the end of the AD range > MAX A.O. = 120 Example

100 100 110 120 COL.0

DISPLAYED ONLY WITH OPTIONS ^ ANALOG OUTPUT

## 5. SETTING LIGHT

APPLICABLE ONLY TO 3-COLOUR DISPLAY

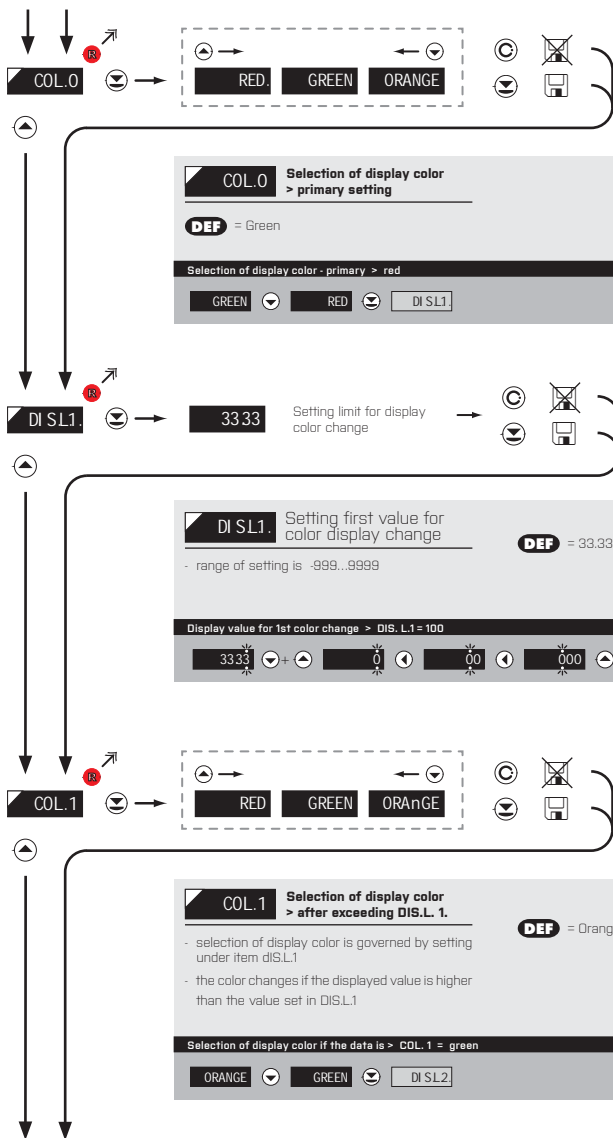



**DIS.L.2.** Setting second value for display color change **DEF** = 66.67

- range of setting is -999..9999

Display value for 1st color change > DIS. L.2 = 400 Example

66.67	+	0	-	00	-	000
200	+	300	+	400	-	COL.2



**COL.2** Selection of display color > after exceeding DIS.L. 2 **DEF** = Red


- selection of display color is governed by setting under item DIS.L.2

- the color changes if the displayed value is higher than the value set in DIS.L.2


Selection of display color if the data is > DIS.L.2 > orange Example

RED	-	ORANGE	-	ADR 1 R
-----	---	--------	---	---------

## 5. SETTING LIGHT

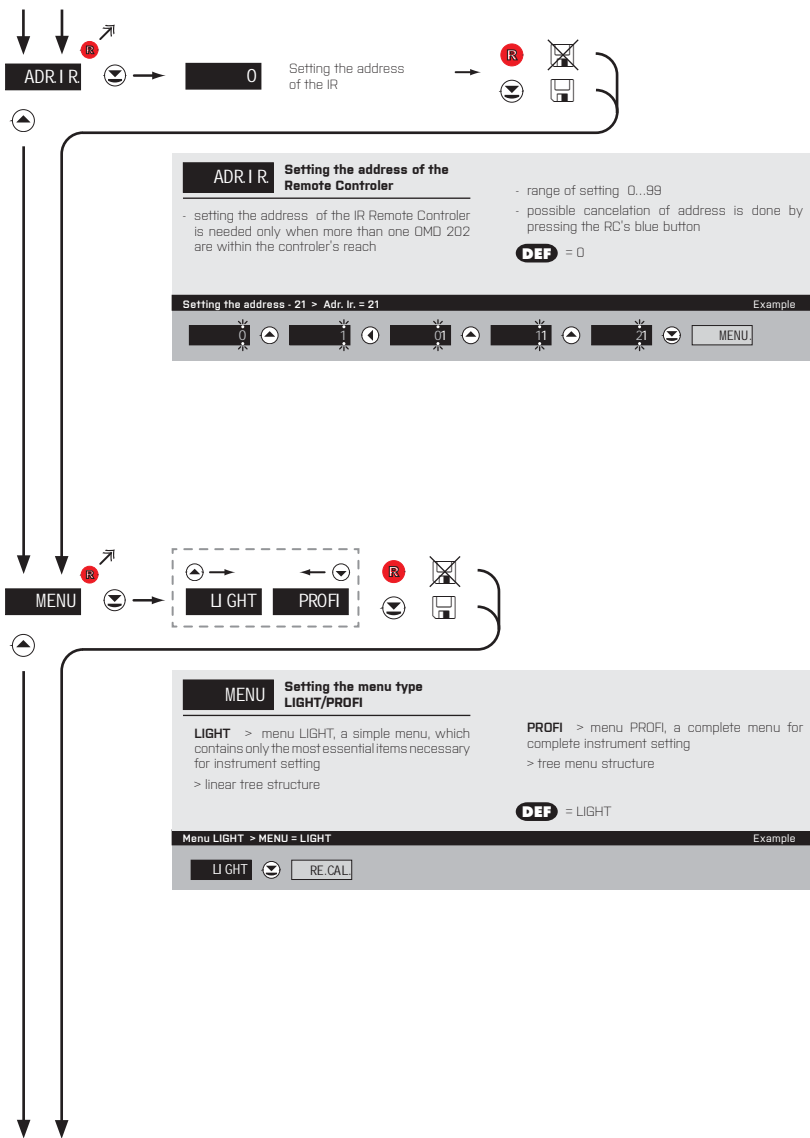



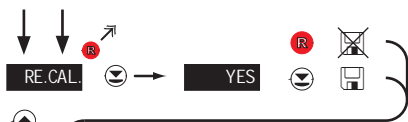


**RE.CAL.** Restoration of manufacture calibration

- In the event of error calibration it is feasible to restore manufacture calibration. Prior to execution of any modifications you will be asked to confirm your selection. [YES]

Restoration of manufacture setting > RE.CAL. Example

RE.CAL. ◀ YES ▶ RE.SET



**RE.SET.** Restoration of manufacture instrument setting

- In the event of error setting the manufacture setting may be restored
- restoration is performed for the currently selected type of the instrument input (select "TYPE")
- provided you stored your user setting in the "PROF" menu, it may also be restored (select "USER")
- loading manufacture calibration and primary setting of items on the menu [DEF]


Restoration of manufacture setting > RE.SET. Example

RE.SET. ◀ TYPE ▶ LANG

\* subsequent item on the menu depends on instrument type, for 'DU' > 'D. MIN'

Type „DC“		43
Type "PM"		43
Type "OHM"		43
Type "RTD-Pr"		43
Type "RTD-Ni"		43
Type "T/C"		43
Type "DU"		42
Type "RTD-Cu"		43



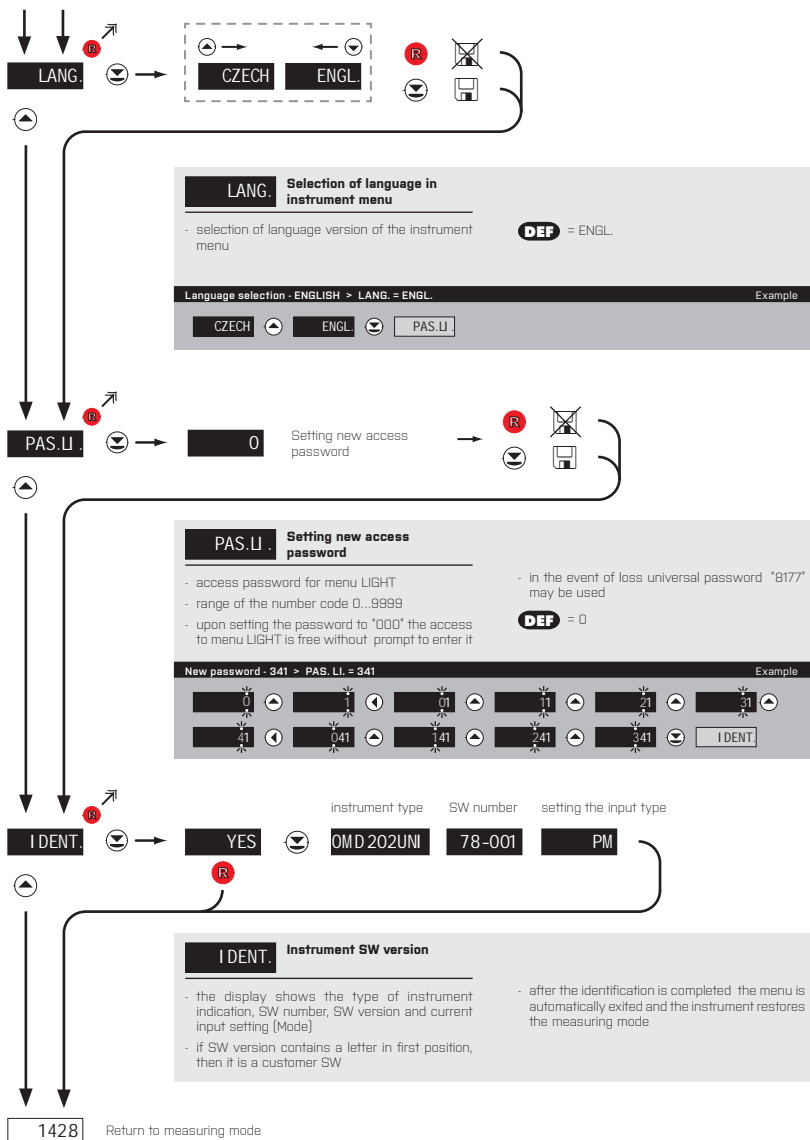



# SETTING **PROFI**

For expert users

Complete instrument menu

Access is password protected

Possibility to arrange items of the **USER MENU**

Tree menu structure

### 6.0

#### SETTING "PROFI"

##### **PROFI**

##### **Complete programming menu**

- contains complete instrument menu and is protected by optional number code
- designed for expert users
- preset from manufacture is menu **LIGHT**

#### Switching over to "PROFI" menu

>3 s



- access to **PROFI** menu
- authorization for access to **PROFI** menu does not depend on setting under item SERVIC. > MENU
- password protected access (unless set as follows under the item SERVIC. > N. PASS. > **PROFI** =0)




- access to menu selected under item SERVIC. > MENU > LIGHT/PROFI
- password protected access (unless set as follows under the item SERVIC. > N. PASS. > **LIGHT** =0)
- for access to **LIGHT** menu passwords for **LIGHT** and **PROFI** menu may be used




## 6. SETTING PROFI

Programming sch

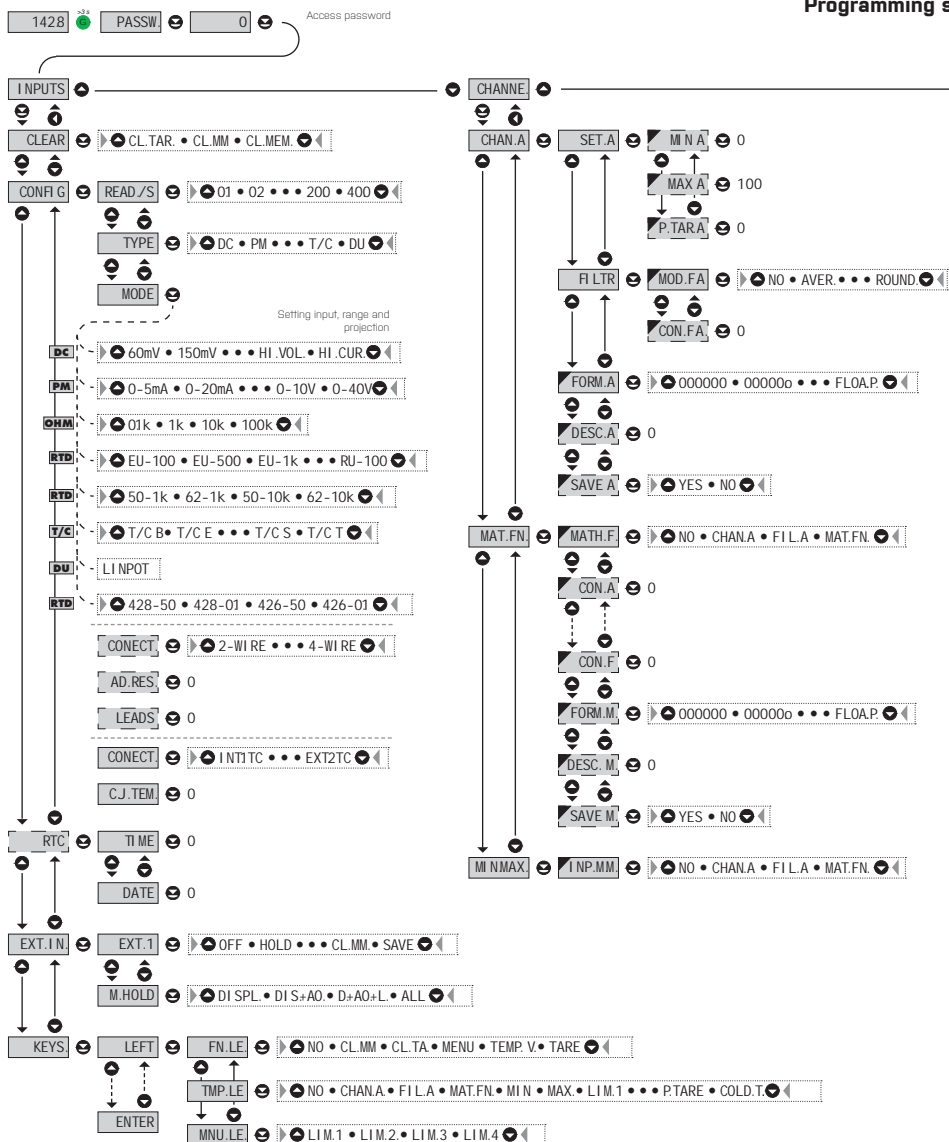


## HOME PROFI MENU

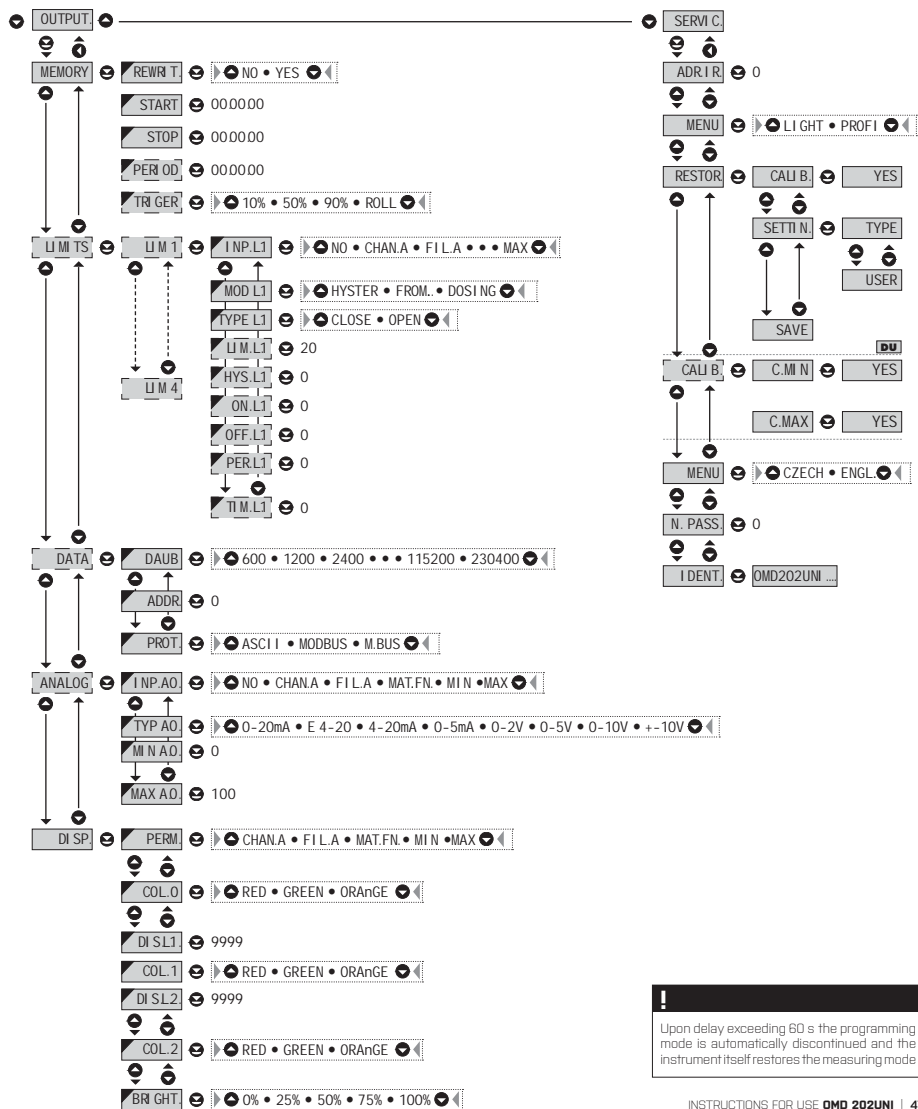

Upon delay exceeding 60 s the programming mode is automatically discontinued and the instrument itself restores the measuring mode

## 6. SETTING PROFI


### 6.1 SETTING "PROFI" - INPUT



The primary instrument parameters are set in this menu

CLEAR	Resetting internal values
CONF G.	Selection of measuring range and parameters
EXT. I N.	Setting external inputs functions
KEYS	Assigning further functions to keys on the instrument

### 6.1.1 RESETTING INTERNAL VALUES



CLEAR	Resetting internal values
CL.TAR.	Tare resetting
CL.MM.	Resetting min/max value

- resetting memory for the storage of minimum and maximum value achieved during measurement



## 6.1.2a SELECTION OF MEASURING RATE

↑

⊖ ⊕ →

← ⊖

INPUTS	CLEAR	READ/S	40.0	DEF
CHANNE.	CONFI G.	TYPE	20.0	
OUTPUT.	EXT.I.N.	MODE	10.0	
SERVI C.	KEYS	CONECT.	5.0	
		C.J.TEM.	2.0	
		AD.RES.	1.0	
		LEADS	05	
			02	
			01	

↑

⊖

## READ/S Selection of measuring rate

40.0	40,0 measurements/s
20.0	20,0 measurements/s
10.0	10,0 measurements/s
5.0	5,0 measurements/s
2.0	2,0 measurements/s
1.0	1,0 measurement/s
0.5	0,5 measurements/s
0.2	0,2 measurements/s
0.1	0,1 measurements/s

## 6.1.2b SELECTION OF „INSTRUMENT“ TYPE

↑

⊖ ⊕ →

← ⊖

INPUTS	CLEAR	READ/S	DC	DEF
CHANNE.	CONFI G.	TYPE	PM	
OUTPUT.	EXT.I.N.	MODE	OHM	
SERVI C.	KEYS	CONECT.	RTD-Pt	
		C.J.TEM.	RTD-Ni	
		AD.RES.	TC	
		LEADS	DU	
			RTD-Cu	

↑

⊖

## TYPE Selection of „instrument“ type

- selection of particular type of "instrument" is bound to relevant dynamic items

DC	DC voltmeter
PM	Process monitor
OHM	Ohmmeter
RTD-Pt	Thermometer for Pt xxx
RTD-Ni	Thermometer for Ni xxxx
TC	Thermometer for thermocouples
DU	Display for linear potentiometers
RTD-Cu	Thermometer for Cu xxx

## 6. SETTING PROFI

6.1.2c

SELECTION OF MEASURING RANGE

↑

⊖ →

⊕ ←

↓

I NPUTS	CLEAR	READ./S	DC 60mV	OHM 100 R	DEF
CHANNE.	CONFI G.	TYPE	150mV	1 k	
OUTPUT.	EXT.I N.	MODE	300mV	10 k	
SERVI C.	KEYS	CONNECT.	1200mV	100 k	
		C.J.TEM.		AUTO	
		AD.RES.			
		LEADS.			

DC - A	PM
100 V	0-5mA
250 V	0-20mA
DEF	DEF
500 V	4-20mA
010 A	0-2 V
025 A	0-5 V
050 A	0-10 V
100 A	0-40 V
500 A	Er4-20

RTD-Pt	RTD-Cu
EU-100	428-50
EU-500	428-01
EU-1 k0	426-50
US-100	426-01
RU-50	
RU-100	

RTD-Ni	T/C
50-1k	T/C B
62-1k	T/C E
50-10k	T/C J
62-10k	T/C K
DEF	DEF
	T/C N
	T/C R
	T/C S

DU	T/C
LI NPOT.	T/C T
DEF	

**!**

Switching in the mode  
AUTO - "OHM"



0.1 > 1 k	0.101 k
1 k > 10 k	1.010 k
10 k > 100 k	10.10 k
100 > 10 k	9.900 k
10 k > 1 k	0.990 k
1 k > 0.1 k	0.099 k

When selecting the "AUTO" range, the items "MIN.", "MAX.", "P. TAR. A" will not be displayed in the "CHAN. A" setting

	MODE	Selection of instrument measuring range
DC	Menu	Measuring range
		60 mV ±60 mV
		150 mV ±150 mV
		300 mV ±300 mV
DC - A		1200mV ±12 V
		100 V ±100 V
		250 V ±250 V
		500 V ±500 V
PM		0.10 A ±0.1 A
		0.25 A ±0.25 A
		0.50 A ±0.5 A
		1.00 A ±1 A
OHM		5.00 A ±5 A
	Menu	Measuring range
		0.5mA 0..5 mA
		0.20mA 0..20 mA
RTD-PT		4.20mA 4..20 mA
		0.2 V ±2 V
		0.5 V ±5 V
		0.10 V ±10 V
RTD-NI		0.40 V ±40 V
		Er4:20 4..20 mA, with error statement of „underflow“ upon signal smaller than 3.36 mA
	Menu	Measuring range
		100 R 0..100
RTD-CU		1 k 0..1 k
		10 k 0..10 k
		100 k 0..100 k
		AUTO Autorange
T/C	Menu	Measuring range
		EU100 Pt 100 (3 850 ppm/°C)
		EU500 Pt 500 (3 850 ppm/°C)
		EU1k0 Pt 1000 (3 850 ppm/°C)
T/C		US100 Pt 100 (3 920 ppm/°C)
		RU50 Pt 50 (3 910 ppm/°C)
		RU100 Pt 100 (3 910 ppm/°C)
	Menu	Measuring range
	5.0:1k Ni 1 000 (5 000 ppm/°C)	
	6.2:1k Ni 1 000 (5 180 ppm/°C)	
	5.0:10k Ni 10 000 (5 000 ppm/°C)	
	6.2:10k Ni 10 000 (5 180 ppm/°C)	
T/C	Menu	Measuring range
		428-50 Cu 50 (4 280 ppm/°C)
		428-01 Cu 1 00 (4 280 ppm/°C)
		428-50 Cu 50 (4 280 ppm/°C)
	428-01 Cu 100 (4 280 ppm/°C)	
T/C	Menu	Type of thermocouple
		T/C B B
		T/C E E
		T/C J J
	T/C K K	
	T/C N N	
	T/C R R	
	T/C S S	
	T/C T T	
	T/C L L	

## 6.1.2d SELECTION OF TYPE OF SENSOR CONNECTION

RTD OHM T/C

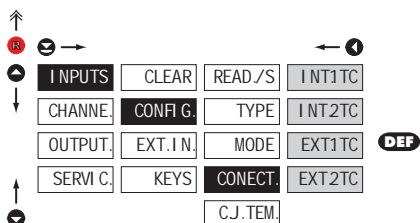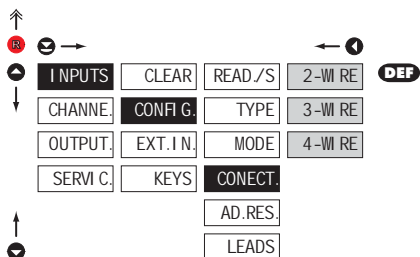**CONNECT.** Selection of type of sensor connection**RTD OHM**

- 2-W RE 2-wire connection
- 3-W RE 3-wire connection
- 4-W RE 4-wire connection

**T/C**

- INT.1TC Measurement without reference thermocouple
- measuring cold junction at instrument brackets
- INT2TC Measurement with reference thermocouple
- measuring cold junction at instrument brackets with anti-series connected reference thermocouple
- EXT1TC Measurement without reference thermocouple
- the entire measuring set is working under invaried and constant temperature
- EXT2TC Measurement with reference thermocouple
- when using compensation box



Method and procedure of setting the cold junctions is described in separate chapter on page 80




For thermocouple type "B" the items CONECT. and C.J. TEM. are not available

## 6. SETTING PROFI



### 6.1.2e SETTING TEMPERATURE OF COLD JUNCTION

T/C

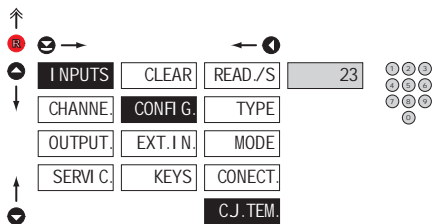


#### C.J. TEM. Setting temperature of cold junction

- range 0...99°C with compensation box
- **DEF** = 23°C

### 6.1.2f COMPENSATION OF 2-WIRE CONDUCT

RTD OHM

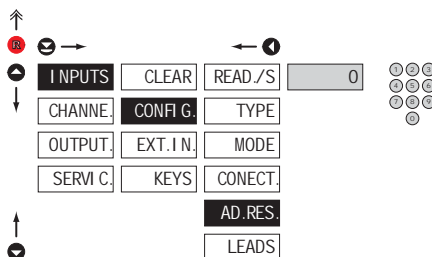


#### AD.RES. Offset of the beginning of the measuring range

- in cases when it is necessary to offset the beginning of the range by certain value, e.g. while using sensor in measuring head
- entered directly in Ohm (0...9999)
- **DEF** = 0

### 6.1.2g COMPENSATION OF 2-WIRE CONDUCT


RTD OHM

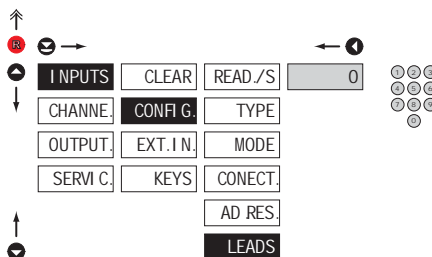

#### LEADS Compensation of 2-wire conduct

- for measurement accuracy it is necessary to perform compensation of conduct always in case of 2-wire connection
- prior confirmation of the displayed prompt „YES“ it is necessary to substitute the sensor at the end of the conduct by a short-circuit
- **DEF** = 0

## 6.1.3a EXTERNAL INPUT FUNCTION SELECTION

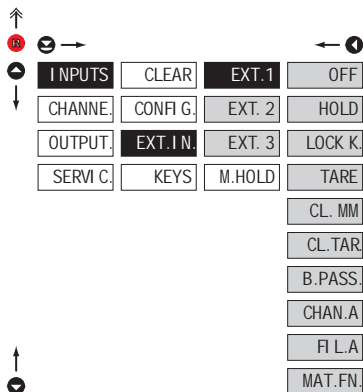

## EXT. 1 N. External input function selection

OFF	Input is off
HOLD	Activation of HOLD
LOCK K.	Locking keys on the instrument
TARE	Tare activation
CL. MM	Resetting min/max value
CL. TAR	Tare resetting
B. PASS.	Activation of locking access into programming menu
CHAN. A	Displaying value of "Channel A"
FI L. A	Displaying value of "Channel A" after being processed by digital filters
MAT. FN.	Displaying value of "Mathematical function"


- **DEF** EXT. 1 > HOLD
- **DEF** EXT. 2 > LOCK K.
- **DEF** EXT. 3 > TARE

## \*

Setting procedure is identical for EXT. 2 and EXT. 3

## 6. SETTING PROFI


### 6.1.3b SELECTION OF FUNCTION "HOLD"

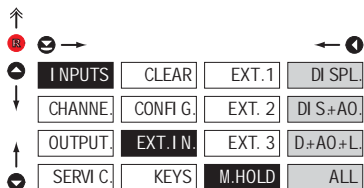

#### M.HOLD Selection of function "HOLD"

DI SPL.	"HOLD" locks only the value displayed
DI S+AO.	"HOLD" locks the value displayed and on AD
D+AO+L.	"HOLD" locks the value displayed, on AD and limit evaluation
ALL	"HOLD" locks the entire instrument

### 6.1.4a OPTIONAL ACCESSORY FUNCTIONS OF THE KEYS

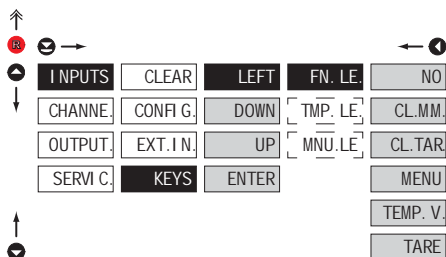

#### FN. LE. Assigning further functions to instrument keys

- .FN. LE." > executive functions
- .TMP. LE." > temporary projection of selected values
- .MNU. LE." > direct access into menu on selected item

NO	Key has no further function
CL.MM.	Resetting min/max value
CL.TAR.	Tare resetting
MENU	Direct access into menu on selected item
TEMP. V.	Temporary projection of selected values
TARE	Tare function activation


Setting is identical for LEFT, DOWN, UP and ENTER

#### ! Preset values of the control keys **DEF**

LEFT	Show Tare
UP	Show Max. value
DOWN	Show Min. value
ENTER	w/o function

## 6.1.4b

## OPTIONAL ACCESSORY FUNCTIONS OF THE KEYS - TEMPORARY PROJECTION

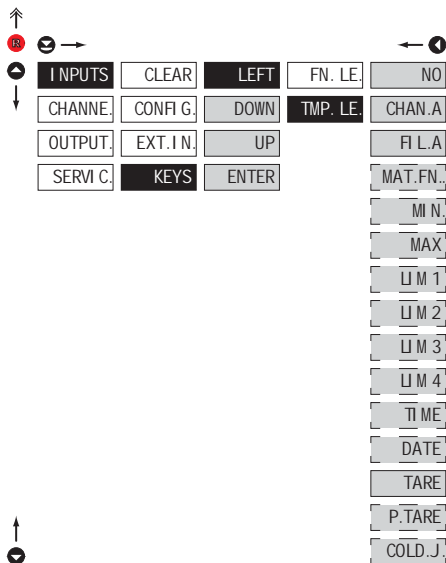**TMP. LE.** Temporary projection of selected item

- "Temporary" projection of selected value is displayed for the time of keystroke
- "Temporary" projection may be switched to permanent by pressing **R** + "Selected key", this holds until the stroke of any key








NO	Temporary projection is off
CHAN. A	Temporary projection of "Channel A" value
FI L. A	Temporary projection of "Channel A" value after processing digital filters
MAT. FN.	Temporary projection of "Mathematic functions" value
M I N	Temporary projection of "Min. value"
MAX	Temporary projection of "Max. value"
LIM 1	Temporary projection of "Limit 1" value
LIM 2	Temporary projection of "Limit 2" value
LIM 3	Temporary projection of "Limit 3" value
LIM 4	Temporary projection of "Limit 4" value
TIME	Temporary projection of "TIME" value
DATE	Temporary projection of "DATE" value
TARE	Temporary projection of "TARE" value
P. TARE	Temporary projection of "P. TARE" value
COLD. J.	Temporary projection of "C-JC" value

Setting is identical for LEFT, DOWN, UP and ENTER

## 6. SETTING PROFI

6.1.5c

OPTIONAL ACCESSORY FUNCTIONS OF THE KEYS - DIRECT ACCESS TO ITEM

      	INPUTS	CLEAR	LEFT	FN. LE.	LIM 1
	CHANNE.	CONFI G.	DOWN	MNU.LE.	LIM 2
	OUTPUT.	EXT.I N.	UP		LIM 3
	SERVIC.	KEYS	ENTER		LIM 4
					HYS.1
					HYS.2
					HYS.3
					HYS.4
					ON 1
					ON 2
					ON 3
					ON 4
					OFF 1
					OFF 2
					OFF 3
					OFF 4

MNU.LE.	Assigning access to selected menu item
LIM 1	Direct access to item "LIM 1"
LIM 2	Direct access to item "LIM 2"
LIM 3	Direct access to item "LIM 3"
LIM 4	Direct access to item "LIM 4"
HYS.1	Direct access to item "HYS. 1"
HYS.2	Direct access to item "HYS. 2"
HYS.3	Direct access to item "HYS. 3"
HYS.4	Direct access to item "HYS. 4"
ON 1	Direct access to item "ON 1"
ON 2	Direct access to item "ON 2"
ON 3	Direct access to item "ON 3"
ON 4	Direct access to item "ON 4"
OFF 1	Direct access to item "OFF 1"
OFF 2	Direct access to item "OFF 2"
OFF 3	Direct access to item "OFF 3"
OFF 4	Direct access to item "OFF 4"




Setting is identical for LEFT, DOWN, UP and ENTER





## 6. SETTING PROFI

### 6.2 SETTING "PROFI" - CHANNELS




The primary instrument parameters are set in this menu

CHAN. A	Setting parameters of measuring "Channel"
MAT. FN.	Setting parameters of mathematic functions
MI NMAX	Selection of access and evaluation of Min/max value

### 6.2.1a DISPLAY PROJECTION

**DC PM DU OHM**

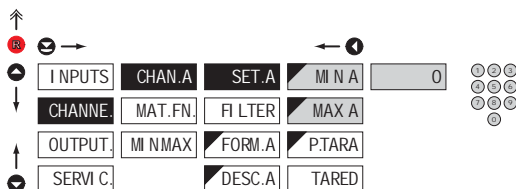

#### SET. A Setting display projection


**MI N A** Setting display projection for minimum value of input signal

- range of the setting is : -99999...999999
- **DEF** = 0

**MAX A** Setting display projection for maximum value of input signal

- range of the setting is : -99999...999999
- **DEF** = 100


### 6.2.1b SETTING FIXED TARE

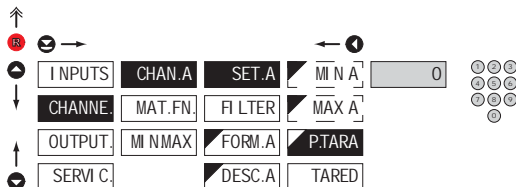

#### P. TARA Setting "Fixed tare" value

- setting is designed for the event when it is necessary to firmly shift the beginning of the range by known size
- when setting [P. TARA ≠ 0] is in effect, display does not show the "T" symbol
- range of the setting is: -99999...999999
- **DEF** = 0


## 6.2.1b SETTING FIXED TARE

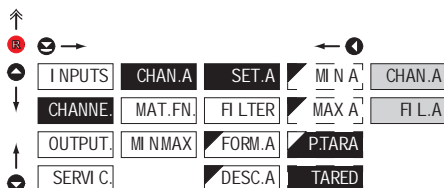**TARED** Selecting the position of tare

**CHAN. A** The value will be tared before linearisation and digital filter

**FI L. A** The value will be tared after linearisation and digital filter

## 6.2.1c DIGITAL FILTERS

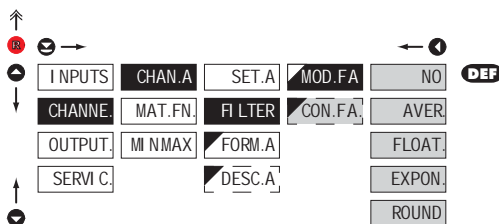**MOD. FA** Selection of digital filters

- at times it is useful for better user projection of data on display to modify it mathematically and properly, wherefore the following filters may be used:

**NO** Filters are off

**AVER** Measured data average

- arithmetic average from given number [„CON. F. A.”] of measured values
- range 2...100

**FLOAT.** Selection of floating filter

- floating arithmetic average from given number [„CON. F. A.”] of measured data and updates with each measured value
- range 2...30

**EXPON.** Selection of exponential filter

- integration filter of first prvniho grade with time constant [„CON. F. A.”] measurement
- range 2...100


**ROUND** Measured value rounding

- is entered by any number, which determines the projection step (e.g. „CON. F. A.”=2,5 > display 0, 2,5, 5,...)

**CON. F. A.** Setting constants

- this menu item is always displayed after selection of particular type of filter

**DEF** = 2

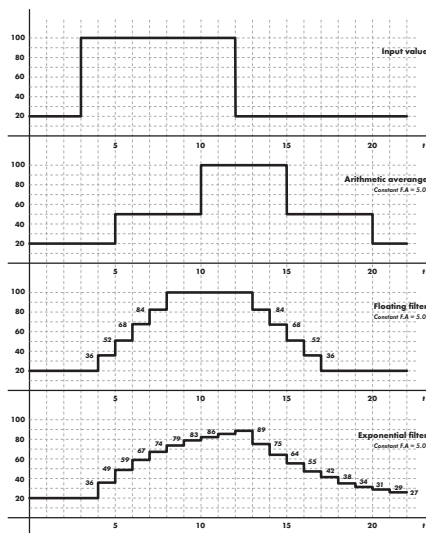






## 6. SETTING PROFI

### 6.2.2b MATHEMATIC FUNCTIONS - DECIMAL POINT

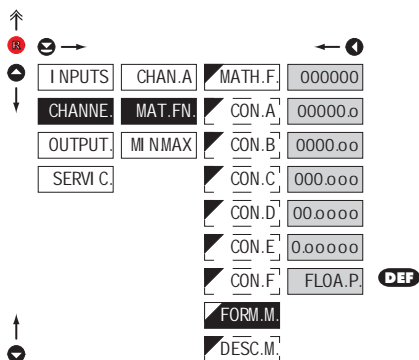


#### FORM.M. Selection of decimal point

- the instrument allows for classic projection of a number with positioning of the DP as well as projection with floating DP, allowing to display a number in its most exact form „FLOA.P.“

000000.	Setting DP - XXXXXX.
00000.0	Setting DP - XXXXX.x
0000.00	Setting DP - XXXX.xx
000.000	Setting DP - XXX.xxx
00.0000	Setting DP - XX.xxxx
0.00000	Setting DP - X.xxxxx
FLOA.P.	Floating DP

### 6.2.2c MATHEMATIC FUNCTIONS - MEASURING UNITS

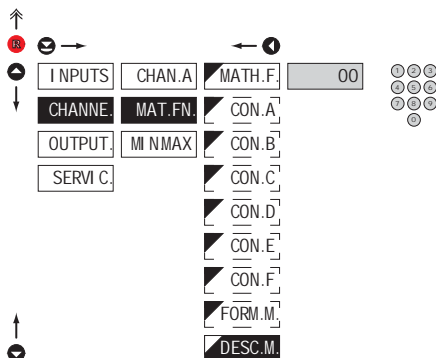


#### DESC.M. Setting projection of description for "MAT.FN"

- projection of measured data may be extended (at the expense of the number of displayed places) by two characters for description
- description is set by shifted ASCII code, when two first places show the set description and two last characters their code in period 0...95
- description is cancelled by code 00

- **DEF** = no description

**!**  
Table of signs on page 83

## 6.2.3 SELECTION OF EVALUATION OF MIN/MAX VALUE

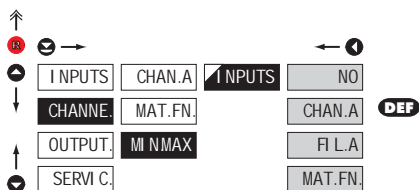

## I NPUTS Selection of evaluation of min/max value

- selection of value from which the min/max value will be calculated

NO Evaluation of min/max value is off


CHAN. A From "Channel A"

FI L. A From "Channel A" after digital filters processing

MAT. FN. From "Mathematic functions"

## 6. SETTING PROFI


### 6.3 SETTING „PROFI“ - OUTPUTS



In this menu it is possible to set parameters of the instrument output signals

LIMITS	Setting type and parameters of limits
DATA	Setting type and parameters of data output
AN.OUT	Setting type and parameters of analog output
DISP	Setting display projection and brightness

#### 6.3.1a SELECTION OF INPUT FOR LIMITS EVALUATION

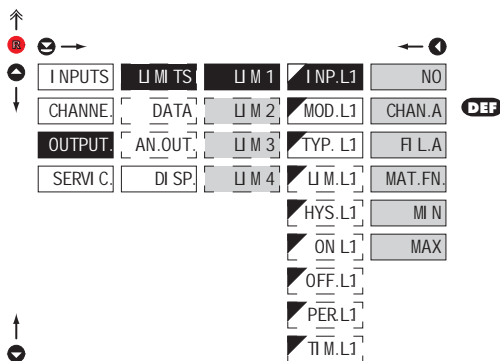


#### INP.L1 Selection evaluation of limits

- selection of value from which the limit will be evaluated

NO	Limit evaluation is off
CHAN.A	Limit evaluation from "Channel A"
FLA	Limit evaluation from "Channel A" after digital filters processing
MAT.FN	Limit evaluation from "Mathematic functions"
MIN	Limit evaluation from "Min. value"
MAX	Limit evaluation from "Max. value"

Setting is identical for LIM 2, LIM 3 and LIM 4



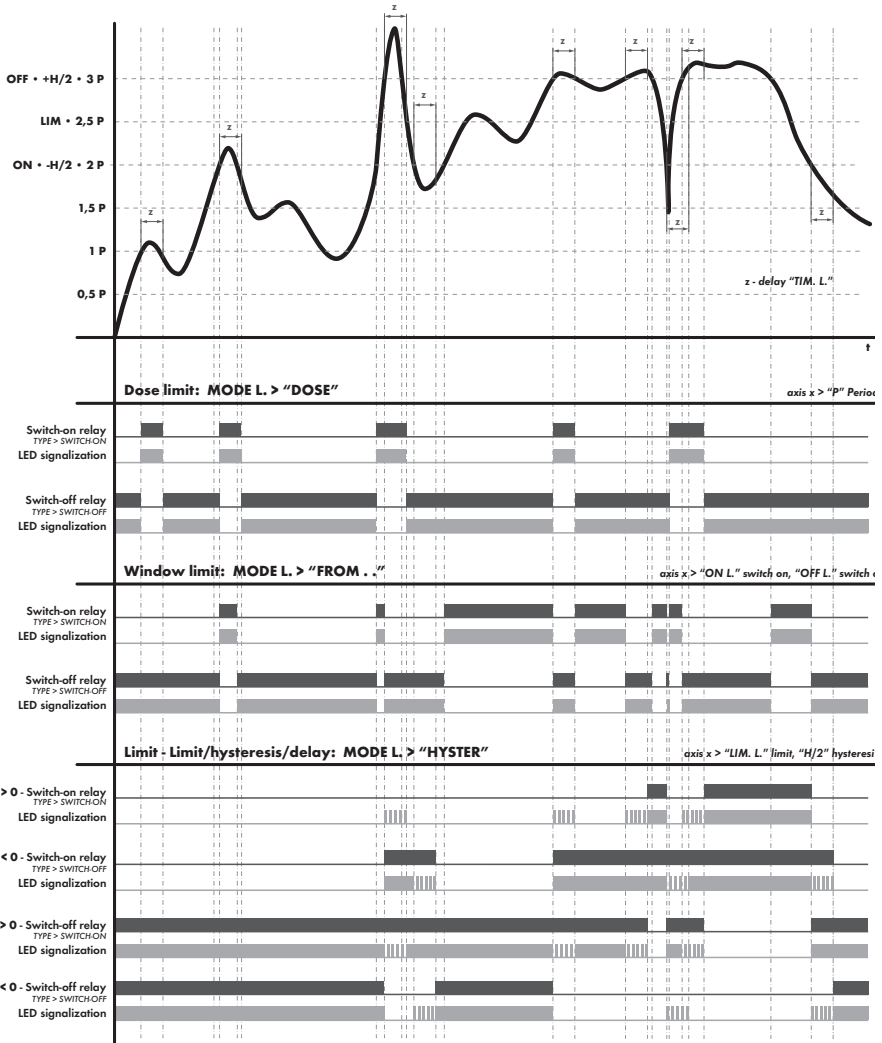

## 6. SETTING PROFI

### 6.3.1b SELECTION OF TYPE OF LIMIT

↑	←	→	DEF
↑	←	→	DEF
↓	←	→	DEF
↑	←	→	DEF
↓	←	→	DEF

INPUTS	LIMITS	LIM 1	INP.L1	HYSTER
CHANNE.	DATA	LIM 2	MOD.L1	FROM..
OUTPUT.	AN_OUT.	LIM 3	TYP.L1	DOSI NG
SERVIC.	DI SP.	LIM 4	LIM.L1	
			HYS.L1	
			ON.L1	
			OFF.L1	
			PER.L1	
			TIM.L1	

#### MOD.L1 Selection the type of limit

**HYSTER** Limit is in mode "Limit, hysteresis, delay"

- for this mode the parameters of "LIM. L." are set, at which the limit will shall react, "HYS. L." the hysteresis range around the limit [LIM+1/2 HYS] and time "TIM. L." determining the delay of relay switch-on

**FROM..** Frame limit

- for this mode the parameters are set for interval "ON. L." the relay switch-on and "OFF. L." the relay switch-off

**DOSI NG** Dose limit (periodic)

- for this mode the parameters are set for "PER. L." determining the limit value as well as its multiples at which the output is active and "TIM. L." indicating the time during which is the output active

Setting is identical for LIM 2, LIM 3 and LIM 4

### 6.3.1c SELECTION OF TYPE OF OUTPUT

↑	←	→	DEF
↑	←	→	DEF
↓	←	→	DEF
↑	←	→	DEF
↓	←	→	DEF

INPUTS	LIMITS	LIM 1	INP.L1	CLOSE
CHANNE.	DATA	LIM 2	MOD.L1	OPEN
OUTPUT.	AN_OUT.	LIM 3	TYP.L1	
SERVIC.	DI SP.	LIM 4	LIM.L1	
			HYS.L1	
			ON.L1	
			OFF.L1	
			PER.L1	
			TIM.L1	

#### TYP.L1 Selection of type of output


**CLOSE.** Output switches on when condition is met

**OPEN** Output switches off when condition is met

Setting is identical for LIM 2, LIM 3 and LIM 4

## 6.3.1d

## SETTING VALUES FOR LIMITS EVALUATION

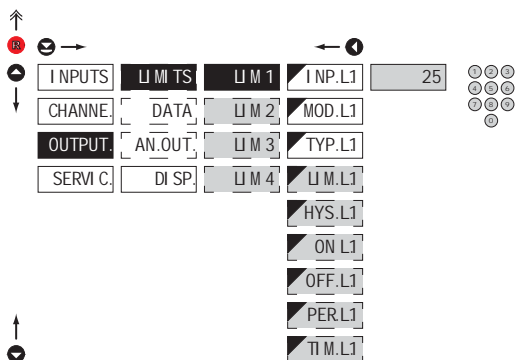

### LIM.L1

Setting limit for switch-on

- for type "HYSTER."

### HYS.L1

Setting hysteresis

- for type "HYSTER."
- indicates the range around the limit (in both directions,  $LIM \pm 1/2 HYS$ )

### ON L1

Setting the outset of the interval of limit switch-on

- for type "FROM."

### OFF L1

Setting the end of the interval of limit switch-on

- for type "FROM."

### PER.L1

Setting the period of limit switch-on

- for type "DOSING"

### TIM.L1

Setting the time switch-on of the limit

- for type "HYSTER." and "DOSING"
- setting within the range:  $\pm 99,9$  s
- positive time > relay switches on after crossing the limit (LIM.L1) and the set time (TIM.L1)
- negative time > relay switches off after crossing the limit (LIM.L1) and the set negative time (TIM.L1)



Setting is identical for LIM 2, LIM 3 and LIM 4

## 6. SETTING PROFIBUS

### 6.3.2a SELECTION OF DATA OUTPUT BAUD RATE

Navigation diagram showing menu options and values:

- Inputs: LIMITS
- Channel: DATA
- Output: AN\_OUT
- Service: DI SP
- BAUD: 600
- ADDR: 1200
- AD\_MOD: 2400
- PROT: 4800
- 9600 (DEF)
- 19200
- 38400
- 57600
- 115200
- 230400

BAUD	Selection of data output baud rate
600	Rate - 600 Baud
1200	Rate - 1 200 Baud
2400	Rate - 2 400 Baud
4800	Rate - 4 800 Baud
9600	Rate - 9 600 Baud
19200	Rate - 19 200 Baud
38400	Rate - 38 400 Baud
57600	Rate - 57 600 Baud
115200	Rate - 115 200 Baud
230400	Rate - 230 400 Baud


### 6.3.2b SETTING INSTRUMENT ADDRESS

Navigation diagram showing menu options and values:

- Inputs: LIMITS
- Channel: DATA
- Output: AN\_OUT
- Service: DI SP
- BAUD: 0
- ADDR: 0
- AD\_MOD: 2400
- PROT: 4800
- ADr\_PB: 19

ADDR	Setting instrument address
-	- setting in range 0...31
DEF	= 00
ADDR	Setting instrument address - MDDBUS
-	- setting in range 1...247
DEF	= 1
ADr_PB	Setting instrument address - PROFIBUS
-	- setting in range 1...127
DEF	= 19

## 6.3.2c SELECTION OF DATA OUTPUT PROTOCOL

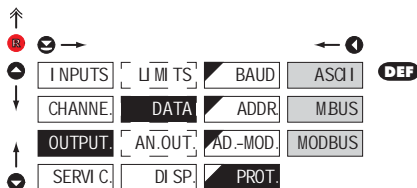

## PROT. Selection of the type of analog output


ASQ I Data protocol ASCII

M.BUS Data protocol DIN MessBus

MODBUS Data protocol MODBUS-RTU

- option is available only for RS 485

## 6.3.3a SELECTION OF INPUT FOR ANALOG OUTPUT

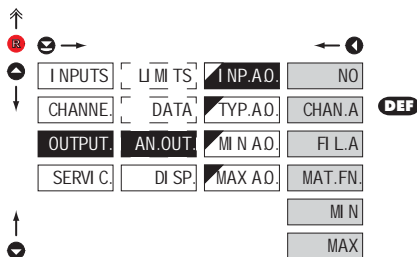

## I NP.A.O. Selection evaluation analog output

- selection of value from which the analog output will be evaluated

NO AD evaluation is off

CHAN.A AD evaluation from "Channel A"

F I L.A AD evaluation from "Channel A" after digital filters processing


M AT.FN. AD evaluation from "Math.functions"

M I N AD evaluation from "Min.value"

M AX AD evaluation from "Max.value"

## 6. SETTING PROFI

### 6.3.3b SELECTION OF THE TYPE OF ANALOG OUTPUT

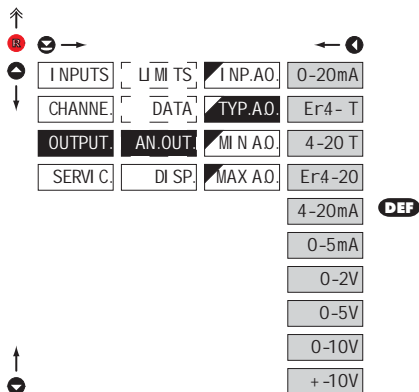

#### TYP. A.O. Selection of the type of analog output

0-20mA Type: 0...20 mA

Er4-T Type: 4...20 mA, with broken loop detection and indication of error statement (< 3,0 mA)

4-20 T Type: 4...20 mA, with broken loop detection (< 3,0 mA)

Er4-20 Type: 4...20 mA, with indic. of error statement (< 3,0 mA)

4-20mA Type: 4...20 mA

0-5mA Type: 0...5 mA


0-2V Type: 0...2 V

0-5V Type: 0...5 V

0-10V Type: 0...10 V

+ -10V Type:  $\pm$ 10 V

### 6.3.3c SETTING THE ANALOG OUTPUT RANGE

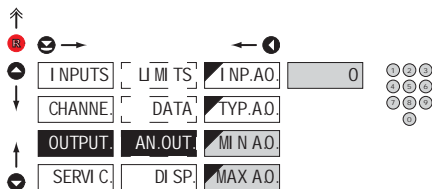

#### AN. OUT. Setting the analog output range

- analog output is isolated and its value corresponds with displayed data. It is fully programmable, i.e. it allows to assign the AO limit points to two arbitrary points of the entire measuring range

**MI N A.O.** Assigning the display value to the beginning of the

AO range

- range of the setting is -99999...999999


- **DEF** = 0

**MAX A.O.** Assigning the display value to the end of the AO range

- range of the setting is -99999...999999

- **DEF** = 100

## 6.3.4a SELECTION OF INPUT FOR DISPLAY PROJECTION

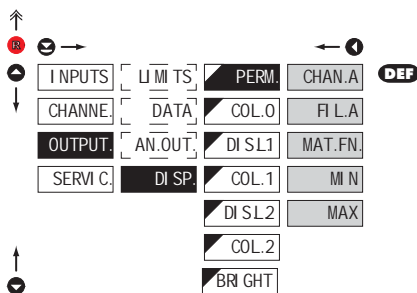**PERM.** Selection display projection

- selection of value which will be shown on the instrument display

**CHAN. A** Projection of values from "Channel A"


**FI L. A** Projection of values from "Channel A" after digital filters processing

**MAT. FN.** Projection of values from "Math.functions"

**MI N.** Projection of values from "Min.value"

**MAX** Projection of values from "Max.value"

## 6.3.4b SELECTION OF DISPLAY COLOR

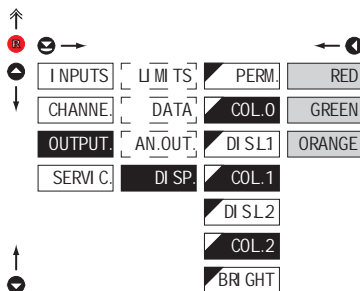**COL.-** Selection of display color

- the color selection is governed by setting under items "DIS. L.1" and "DIS. L.2"

**RED** Red color

**GREEN** Green color

**ORANGE** Orange color

- "COL. 0." **DEF** = Green


- "COL. 1." **DEF** = Orange

- "COL. 2." **DEF** = Red

! If the instrument is in the Hi Brightness LEDs execution, this menu item is not accessible

## 6. SETTING PROFI

### 6.3.4c SELECTION OF DISPLAY COLOR CHANGE

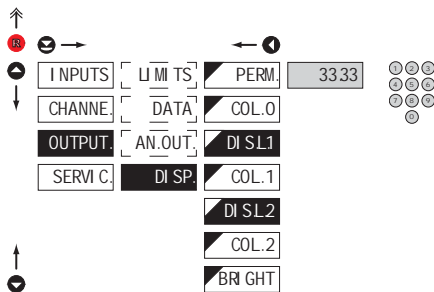

#### DI SL.- Selection of display color change

- under items "DIS. L.1" and "DIS. L.2" the limit is set for the time when the display color shall change


- "DIS. L.1" **DEF** = 9999

- "DIS. L.2" **DEF** = 9999



If the instrument is in the Hi Brightness LEDs execution, this menu item is not accessible

### 6.3.4d SELECTION OF DISPLAY BRIGHTNESS

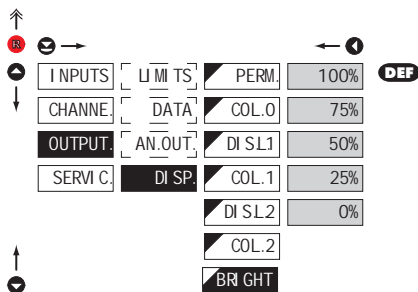

#### BR GHT Selection of display brightness

- by selecting display brightness we may appropriately react to light conditions in place of instrument location

0% Display is off

- after keystroke display turns on for 10 s

25% Display brightness - 25%

50% Display brightness - 50%

75% Display brightness - 75%


100% Display brightness - 100%





## 6. SETTING PROFI


### 6.4 SETTING "PROFI" - SERVICE



The instrument service functions are set in this menu

ADR.I.R.	Nastavení adresy IR ovládní
MENU	Selection of menu type LIGHT/PROFI
RESTOR.	Restore instrument manufacture setting and calibration
CALL B.	Input range calibration for „DU“ version
LANG.	Language version of instrument menu
N.PASS.	Setting new access password
I DENT.	Instrument identification

#### 6.4.1 SETTING THE ADDRESS OF IR REMOTE CONTROL

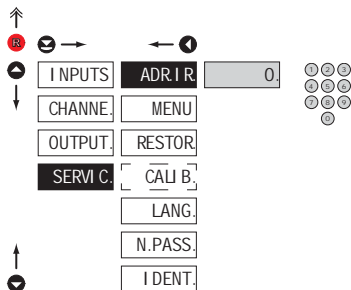


#### ADR.I.R. Setting the address of IR remote control

- setting the remote control address is inevitable only in case there are other large displays DMD 202 within the reach of IR remote control
- range of the setting is 0...99

DEF = 0

## 6.4.2 SELECTION OF TYPE OF PROGRAMMING MENU

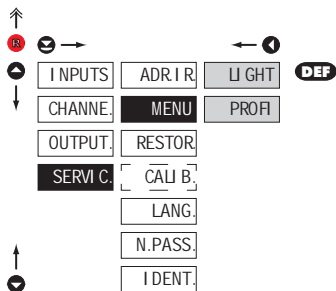**MENU** Selection of menu type - LIGHT/PROFI

- enables setting the menu complexity according to user needs and skills

**LI GHT** Active LIGHT menu

- simple programming menu, contains only items necessary for configuration and instrument setting
- linear menu > items one after another

**PROFI** Active PROFI menu



- complete programming menu for expert users
- free menu



Change of setting is valid upon next access into menu

## 6. SETTING PROFI

### 6.4.3 RESTORATION OF MANUFACTURE SETTING

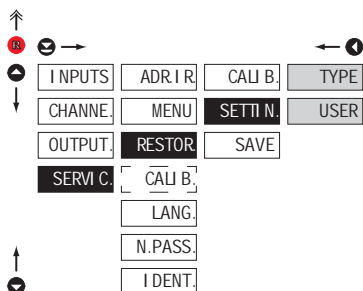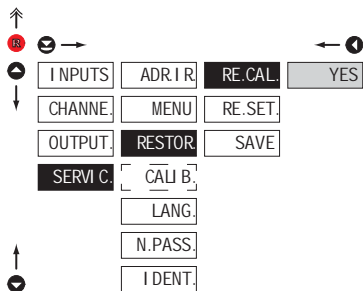

#### RESTOR. Restoration of manufacture setting

- in the event of error setting or calibration, manufacture setting may be restored

#### RE.CAL. Restoration of manufacture calibration of the instrument

- prior executing the changes you will be asked to confirm you selection ,YES'

#### RE.SET. Restoration of instrument manufacture setting

##### TYPE Restoration of instrument manufacture setting

- generating the manufacture setting for currently selected type of instrument (items marked DEF)

##### USER Restoration of instrument user setting

- generating the instrument user setting, i.e. setting stored under SERVIC./RESTOR./SAVE

##### SAVE Save instrument user setting

- storing the user setting allows the operator to restore it in future if needed



After restoration the instrument switches off for couple seconds


#### JOBS PERFORMED

#### RESTORE

	CALIBRATION	SETTING
cancels USER menu rights	✓	✓
deletes table of items order in USER - LIGHT menu	✓	✓
adds items from manufacture to LIGHT menu	✓	✓
deletes data stored in FLASH	✓	✓
cancels or linearization tables	✓	✓
clears tare	✓	✓
restore manufacture calibration	✓	✗
restore manufacture setting	✗	✓


## 6.4.4 CALIBRATION - INPUT RANGE

DU

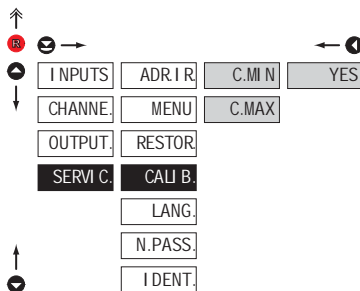**CALI B.** Input range calibration

- when "C. MIN" is displayed, move the potentiometer traveller to the required minimum position and confirm by „Enter“, calibration is confirmed by „YES“
- when "C. MAX" is displayed, move the potentiometer traveller to required maximum position and confirm by „Enter“, calibration is confirmed by „YES“


## 6.4.5 SELECTION OF INSTRUMENT MENU LANGUAGE VERSION

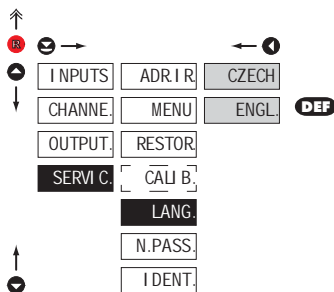**LANG.** Selection of instrument menu language version

- CZECH Instrument menu is in Czech
- ENGL. Instrument menu is in English

## 6. SETTING PROFI


### 6.4.6 SETTING NEW ACCESS PASSWORD

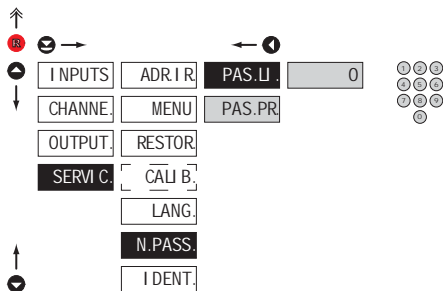

#### N.PASS. Setting new password for access to LIGHT and PROFI menu

- this option allows to change the numeric code, which blocks the access into LIGHT and PROFI Menu.
- numeric code range: 0...9999
- universal passwords in the event of loss:  
LIGHT Menu > „8177”  
PROFI Menu > „7915”

### 6.4.7 INSTRUMENT IDENTIFICATION

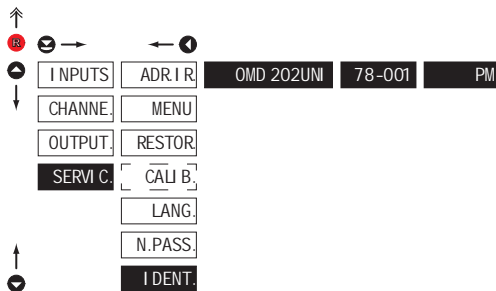

#### I DENT. Projection of instrument SW version

- display shows type identification of the instrument, SW number, SW version and current input setting [Mode]
- if the SW version reads a letter on first position, it is a customer SW

	Blok	Description
I DENT.	1.	Instrument
	2.	no. of SW version
	3.	type/input mode





# SETTING USER

For user operation

Menu items are set by the user (Profi/Light) as per request


Access is not password protected

Optional menu structure either tree (PROFI) or linear (LIGHT)

## 7.0 SETTING ITEMS INTO "USER" MENU

- **USER** menu is designed for users who need to change only several items of the setting without the option to change the primary instrument setting (e.g. repeated change of limit setting)
- there are no items from manufacture permitted in **USER** menu
- on items indicated by inverse triangle  L 1
- setting may be performed in **LIGHT** or **PROFI** menu, with the **USER** menu then overtaking the given menu structure

### Setting



**NO** item will not be displayed in USER menu

**YES** item will be displayed in USER menu with the option of setting

**SHOW** item will be solely displayed in USER menu



## Setting items into „USER“ menu


When setting up the USER menu out of active LIGHT menu it is possible to rank the menu items [max. 10] in the order we want them to appear in the menu.

Setting up the ranking order



## Example of setting up menu items into "USER" menu


As an example we are going to use a direct access into menu items Limit1 and Limit2 (the given example is for Light menu but can be applied also in Profi menu).

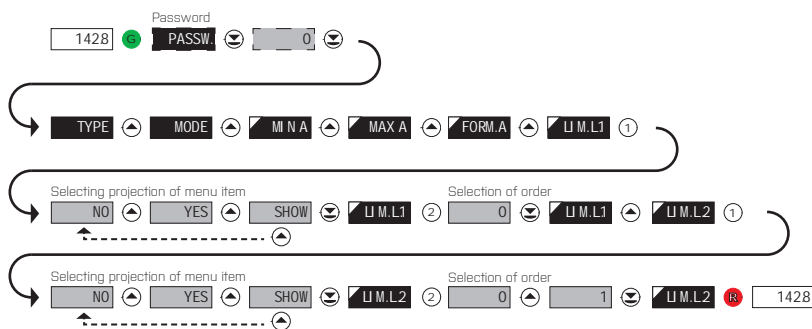

The resulting setting is as follows: After pressing button **(R)** „LIM.L1“ is projected. By pressing **(☺)** you confirm this and you set the desired limit value, alternatively by pressing button **(☹)** you can go over to setting of „LIM.L.2“ where you repeat the procedure. You can finish the setting up by pressing the **(☺)** button, by which you save the latest setting and by pressing the **(R)** you return to the operating mode.

## 8. METHOD OF MEASURING THE CJC

Instrument with input for temperature measurement with thermocouple allows to set two types of measurement of cold junction.

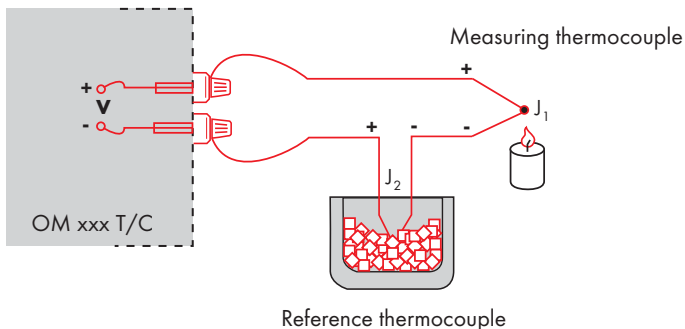

### WITH REFERENCE THERMOCOUPLE

- a reference thermocouple may be located in the same place as the measuring instrument or in place with stable temperature/compensation box
- when measuring with reference thermocouple set **CONNECT** in the instrument menu to **INT2TC** or **EXT2TC**
- when using a thermostat [a compensation box or environment with constant temperature] set in the instrument menu **CJCTEM**, its temperature (applies for setting **CONNECT** to **EXT2TC**)
- if the reference thermocouple is located in the same environment as the measuring instrument then set in the instrument menu **CONNECT** to **INT2TC**. Based on this selection the measurement of the ambient temperature is performed by a sensor located in the instrument terminal board.

### WITHOUT REFERENCE THERMOCOUPLE

- inaccuracy originating from the creation of dissimilar thermocouples on the transition point terminal/conductor of the thermocouple is not compensated for in the instrument
- when measuring without reference thermocouple set **CONNECT** in the instrument menu to **INT1TC** or **EXT1TC**
- when measuring temperature without reference thermocouple the error in measured data may be as much as 10°C (applies for setting **CONNECT** to **EXT1TC**)

The instruments communicate via serial line RS232 or RS485. For communication they use the ASCII protocol. Communication runs in the following format:

ASCII: 8 bit, no parity, one stop bit  
 DIN MessBus: 7 bit, even parity, one stop bit

The transfer rate is adjustable in the instrument menu. The instrument address is set in the instrument menu in the range of 0 ÷ 31. The manufacture setting always presets the ASCII protocol, rate of 9600 Baud, address 00. The type of line used - RS232 / RS485 - is determined by an output board automatically identified by the instrument.

The commands are described in specifications you can find at [na www.orbit.merret.cz/rs](http://na.www.orbit.merret.cz/rs) or in the OM Link program.

## DETAILED DESCRIPTION OF COMMUNICATION VIA SERIAL LINE

EVENT	TYPE		PROTOCOL										TRANSMITTED DATA									
Data solicitation (PC)	232	ASCII	#	A	A	A	<CR>															
		MessBus	No - data is transmitted permanently																			
	485	ASCII	#	A	A	A	<CR>															
		MessBus	<SADR>	<END>																		
Data transmission (instrument)	232	ASCII	>	D	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<CR>		
		MessBus	<STX>	D	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<ETX>	<BCC>
	485	ASCII	>	D	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<CR>	
		MessBus	<STX>	D	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<ETX>	<BCC>
Confirmation of data acceptance (PC) OK	485	MessBus	<DLE>	1																		
Confirmation of data acceptance (PC) Bad			<NAK>																			
Sending address (PC) prior command			<EADR>	<ENQ>																		
Confirmation of address (instrument)			<SADR>	<ENQ>																		
Command transmission (PC)	232	ASCII	#	A	A	N	P	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<CR>		
		MessBus	<STX>	S	N	P	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<ETX>	<BCC>	
	485	ASCII	#	A	A	N	P	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<CR>		
		MessBus	<STX>	S	N	P	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	[D]	<ETX>	<BCC>	
Command confirmation (instrument)	232	ASCII	OK	!	A	A	<CR>															
			Bad	?	A	A	<CR>															
		Messbus	No - data is transmitted permanently																			
	485	ASCII	OK	!	A	A	<CR>															
			Bad	?	A	A	<CR>															
		Mess-Bus	OK	<DLE>	1																	
			Bad	<NAK>																		
Instrument identification			#	A	A	1	Y	<CR>														
HW identification			#	A	A	1	Z	<CR>														
One-time transmission			#	A	A	7	X	<CR>														
Repeated transmission			#	A	A	8	X	<CR>														



## LEGEND

SIGN	RANGE	DESCRIPTION
#	35 23 <sub>H</sub>	Command beginning
A A	0...31	Two characters of instrument address (sent in ASCII - tens and units, e.g. "01", "99" universal)
<CR>	13 00 <sub>H</sub>	Carriage return
<SP>	32 20 <sub>H</sub>	Space
N, P		Number and command - command code
D		Data - usually characters "0"..."9", "*", ".", ";", ":", "D" - dp, and ( ) may prolong data
R	30 <sub>H</sub> ...3F <sub>H</sub>	Relay and tare status
!	33 21 <sub>H</sub>	Positive confirmation of command (ok)
?	63 3F <sub>H</sub>	Negative confirmation of command (point)
>	62 3E <sub>H</sub>	Beginning of transmitted data
<STX>	2 02 <sub>H</sub>	Beginning of text
<ETX>	3 03 <sub>H</sub>	End of text
<SADR>	adresa +60 <sub>H</sub>	Prompt to send from address
<EADR>	adresa +40 <sub>H</sub>	Prompt to accept command at address
<END>	5 05 <sub>H</sub>	Terminate address
<DLE>1	16 49 10 <sub>H</sub> 31 <sub>H</sub>	Confirm correct statement
<NAK>	21 15 <sub>H</sub>	Confirm error statement
<BCC>		Check sum -XDR

## RELAYS, TARE

SIGN	RELAY 1	RELAY 2	TARE	CHANGE RELAY 3/4
P	0	0	0	0
Q	1	0	0	0
R	0	1	0	0
S	1	1	0	0
T	0	0	1	0
U	1	0	1	0
V	0	1	1	0
W	1	1	1	0
p	0	0	0	1
q	1	0	0	1
r	0	1	0	1
s	1	1	0	1
t	0	0	1	1
u	1	0	1	1
v	0	1	1	1
w	1	1	1	1

Relay status is generated by command #A6X <CR>.

The instrument immediately returns the value in the format >HH <CR>, where HH is value in HEX format and range 00H...FFH. The lowest bit stands for „Relay 1“, the highest for „Relay 8“



## 10. ERROR STATEMENTS



ERROR	CAUSE	ELIMINATION
E.D.UN.	Number is too small (large negative) to be displayed	change DP setting, channel constant setting
E.D.OV.	Number is too large to be displayed	change DP setting, channel constant setting
E.T.UN.	Number is outside the table range	increase table values, change input setting (channel constant setting)
E.T.OV.	Number is outside the table range	increase table values, change input setting (channel constant setting)
E.I.UN.	Input quantity is larger than permitted input quantity range	change input signal value or input (range) setting
E.I.OV.	Input quantity is larger than permitted input quantity range	change input signal value or input (range) setting
E.HW.	A part of the instrument does not work properly	send the instrument for repair
E.EE	Data in EEPROM corrupted	perform restoration of manufacture setting, upon repeated error statement send instrument for repair
E.SET.	Data in EEPROM outside the range	perform restoration of manufacture setting, upon repeated error statement send instrument for repair
E.CLR.	Memory was empty (presetting carried out)	upon repeated error statement send instrument for repair, possible failure in calibration
E.OUT.	Analogue output current loop disconnected	check wire connection

The instrument allows to add two descriptive characters to the classic numeric formats (at the expense of the number of displayed places). The setting is performed by means of a shifted ASCII code. Upon modification the first two places display the entered characters and the last two places the code of the relevant symbol from 0 to 95. Numeric value of given character equals the sum of the numbers on both axes of the table.

Description is cancelled by entering characters with code 00

	0	1	2	3	4	5	6	7		0	1	2	3	4	5	6	7
0		7	"	#	\$	%	&	'	0	!	"	#	\$	%	&	'	
8	:	;	#	+	,	-	.	/	8	(	)	*	+	,	-	.	/
16	0	1	2	3	4	5	6	7	16	0	1	2	3	4	5	6	7
24	8	9	VA	Vr	<	=	>	?	24	8	9	VA	Vr	<	=	>	?
32	P	Q	R	S	T	U	V	W	32	@	A	B	C	D	E	F	G
40	H	I	J	K	L	M	N	O	40	H	I	J	K	L	M	N	O
48	P	Q	R	S	T	U	V	W	48	P	Q	R	S	T	U	V	W
56	X	Y	Z	[	\	]	^	_	56	X	Y	Z	[	\	]	^	_
64	`	a	b	c	d	e	f	g	64	`	a	b	c	d	e	f	g
72	h	i	j	k	l	m	n	o	72	h	i	j	k	l	m	n	o
80	p	q	r	s	t	u	v	w	80	p	q	r	s	t	u	v	w
88	x	y	z	{		}	~		88	x	y	z	{		}	~	

## 12. TECHNICAL DATA



### INPUT

range is adjustable

±60 mV	>100 MΩ	<b>DC</b>
±150 mV	>100 MΩ	Input U
±300 mV	>100 MΩ	Input U
±1200 mV	>100 MΩ	Input U

range is adjustable

±0,1 A	< 300 mV	<b>DC - option "A"</b>
±0,25 A	< 300 mV	Input I
±0,5 A	< 300 mV	Input I
±1 A	< 30 mV	Input I
±5 A	< 150 mV	Input I
±100 V	20 MΩ	Input U
±250 V	20 MΩ	Input U
±500 V	20 MΩ	Input U

range is adjustable

0/4...20 mA	< 400 mV	<b>PM</b>
±2 V	1 MΩ	Input U
±5 V	1 MΩ	Input U
±10 V	1 MΩ	Input U
±40 V	1 MΩ	Input U

range is adjustable

0...100 Ω		<b>OHM</b>
0...1 kΩ		
0...10 kΩ		
0...100 kΩ		
Autorange		
Connection:	2, 3 or 4 wire	

Connection:

2, 3 or 4 wire

Pt xxxx

-200°...850°C

**RTD**

Pt xxxx/3910 ppm

-200°...1100°C

Ni xxxx

-50°...250°C

Cu/4260 ppm

-50°...200°C

Cu/4280 ppm

-200°...200°C

Type Pt:

EU > 100/500/1 000 Ω, with 3 850 ppm/°C

US > 100 Ω, with 3 920 ppm/°C

RU > 50/100 Ω, with 3 910 ppm/°C

Type Ni:

Ni 1 000/ Ni 10 000 with 5 000/6 180 ppm/°C

Type Cu:

Cu 50/Cu 100 with 4 260/4 280 ppm/°C

Connection:

2, 3 or 4 wire

range is adjustable in configuration menu

Type:

J (Fe-CuNi)	-200°...300°C	<b>T/C</b>
K (NiCr-Ni)	-200°...1 300°C	
T (Cu-CuNi)	-200°...400°C	
E (NiCr-CuNi)	-200°...690°C	
B (PtRh30-PtRh6)	300°...1 820°C	
S (PtRh10-Pt)	-50°...1 760°C	
R (Pt13Rh-Pt)	-50°...1 740°C	
N (OmegaII alloy)	-200°...1 300°C	
L (Fe-CuNi)	-200°...300°C	

Voltage of lin. pot.

2,5 VDC/6 mA

min. potentiometer resistance is 500 Ω

### PROJECTION

Display:

9999999,  
4 (100/125 mm) or 6 digit (57/100/125 mm)  
Three-color 7 segment LED - red/green/orange  
High bright singles LED - red or green  
(1300 mcd)

Projection:

-999...9999 or -99999...999999

Decimal point:

adjustable - in menu

Brightness:

adjustable - in menu

### INSTRUMENT ACCURACY

TC:

50 ppm/°C

Accuracy:

±0,1% of range + 1 digit

±0,15% of range + 1 digit

±0,3% of range + 1 digit

**RTD, T/C**

**PWR**

**Above accuracies apply for projection 9999**

Resolution:

0,01°/0,1°/°

**RTD**

Rate:

0,1, 4L measurements/s\*\*

Overload capacity:

10x (t < 100 ms) not for 500 V and 5 A,

2x (long-term)

Linearisation:

by linear interpolation in 50 points

- solely via DM Link

Digital filters:

Averaging, Floating average, Exponential filter,

Rounding

Comp. of conduct:

max. 40 Ω/100 Ω

**RTD**

Comp. of cold junct.:

adjustable

**T/C**

0°...99°C or automatic

Functions:

Tare - display resetting

Hold - stop measuring [at contact]

Lock - control key locking

MM - min/max value

Mathematic functions

DM Link:

company communication interface for setting,

operation and update of instrument SW

reset after 400 ms

Watch-dog:

at 25°C and 40% of rh.

### COMPARATOR

Type:

digital, adjustable in menu

Mode:

Hysteresis, From, Dosing

Limita:

-99999...999999

Hysteresis:

0...999999

Delay:

0...99,9 s

Outputs:

4x relays with switch-on contact [Form A]

[230 VAC/30 VDC, 3 A]\*

4x open collectors [30 VDC/100 mA]

Relay:

1/8 HP 277 VAC, 1/10 HP 125 V, Pilot Duty D300

\* values apply for resistance load



**DATA OUTPUTS**

Protocols:	ASCII, DIN MessBus, MODBUS, PROBUS
Data format:	8 bit + no parity + 1 stop bit (ASCII) 7 bit + even parity + 1 stop bit (MessBus)
Rate:	600...230 400 Baud 9 600 Baud...12 Mbaud (PROFIBUS)
RS 232:	isolated, two-way communication
RS 485:	isolated, two-way communication, addressing [max. 31 instruments]
PROFIBUS	Data protocol SIEMENS

**ANALOG OUTPUT**

Type:	isolated, programmable with 12 bits D/A converter, analog output corresponds with displayed data, type and range are adjustable
Non-linearity:	0,1% of range
TC:	15 ppm/°C
Rate:	response to change of value < 1 ms
Voltage:	0...2 V/5 V/10 V/±10 V
Current:	0...5/20 mA/4...20 mA - compensation of conduct to 500 Ω /12 V or 1 000 Ω/24 V

**EXCITATION**

Adjustable:	5...24 VDC/max. 1,2 W, isolated
-------------	---------------------------------

**POWER SUPPLY**

Options:	10...30 V AC/DC, max. 27 VA, isolated PF ≥ 0,4, I <sub>trip</sub> > 75 A/2 ms fuse inside [T 4A]
	80...250 V AC/DC, max. 27 VA, isolated PF ≥ 0,4, I <sub>trip</sub> > 475 A/2 ms fuse inside [T 4A]

**MECHANIC PROPERTIES**

Material:	anodized aluminum, black
Dimensions:	see chapter 13
Panel cut-out:	see chapter 13

**OPERATING CONDITIONS**


Connection:	through cable bushings to terminal boards inside the instrument, conductore section up to < 1,5 mm² /< 2,5 mm²
Stabilisation period:	within 15 minutes after switch-on
Working temp.:	-20°...60°C
Storage temp.:	-20°...85°C
Cover:	IP64
Construction:	safety class I
Overvoltage cat.:	EN 61010-1, A2
Dielectric strength:	4 kVAC after 1 min between supply and input 4 kVAC after 1 min between supply and analog output 4 kVAC after 1 min between supply and relay output 2,5 kVAC after 1 min between supply and analog output
Insulation resist.:	for pollution degree II, measurement category III instrum.power supply > 670 V [PI], 300 V [DI] Input/output > 300 V [PI], 150 [DI]
EMC:	EN 61326-1

\*\*Table of rate of measurement in relation to number of inputs


Channels/Rate	40	20	10	5	2	1	0,5	0,2	0,1
No.of channels: 1 [Type: DC, PM, DU]	40,00	20,00	10,00	5,00	2,00	1,00	0,50	0,20	0,10
No.of channels: 2	5,00	2,50	1,25	1,00	0,62	0,38	0,22	0,09	0,05
No.of channels: 3	3,33	1,66	0,83	0,66	0,42	0,26	0,14	0,06	0,03
No.of channels: 4	2,50	1,25	0,62	0,50	0,31	0,19	0,11	0,05	0,02
No.of channels: 1 [Type: OHM, RTD, T/C]	5,00	2,50	1,25	1,00	0,62	0,38	0,22	0,09	0,05
No.of channels: 2	3,33	1,066	0,83	0,66	0,42	0,26	0,14	0,06	0,03
No.of channels: 3	2,50	1,25	0,62	0,50	0,31	0,19	0,11	0,05	0,02
No.of channels: 4	2,00	1,00	0,50	0,40	0,25	0,15	0,08	0,04	0,02

## 13. INSTRUMENT DIMENSIONS AND INSTALLATION


**Front view**

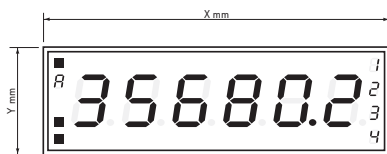

**Side view**



**Panel cutout**

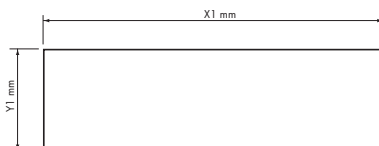


Panel thickness: 0,5 ... 50 mm

Height	X	Y	X1	Y1
<b>57-6</b>	375	119	367	111
<b>100-4</b>	465	181	457	173
<b>100-6</b>	651	181	643	173
<b>125-4</b>	539	237	531	228
<b>125-6</b>	754	237	746	228

### Wall mounting

Our large displays are supplied along with a wall mount holder as shown in the the drawing.

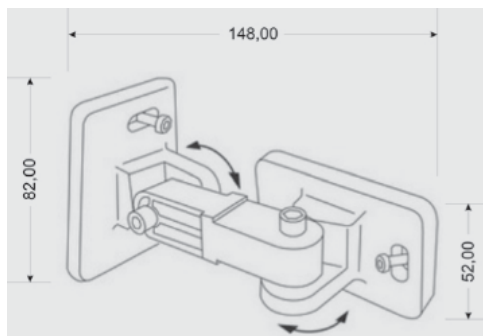



Product                   **OMD 202RS**                   **A B**  
Type                   .....  
Manufacturing No.   .....  
Date of sale           .....

# GUARANTEE

A guarantee period of 60 months from the date of sale to the user applies to this instrument.  
Defects occurring during this period due to manufacture error or due to material faults shall be eliminated free of charge.

For quality, function and construction of the instrument the guarantee shall apply provided that the instrument was connected and used in compliance with the instructions for use.

The guarantee shall not apply to defects caused by:

- mechanic damage
- transportation
- intervention of unqualified person incl. the user
- unavoidable event
- other unprofessional interventions

The manufacturer performs guarantee and post.guarantee repairs unless provided for otherwise.

# YEARS

Stamp, signature



**Company:** **ORBIT MERRET, spol. s r.o.**  
Klánova 81/141, 142 00 Prague 4, Czech Republic, IDNo: 00551309

**Manufactured:** **ORBIT MERRET, spol. s r.o.**  
Vodňanská 675/30, 198 00 Prague 9, Czech Republic

declares at its explicit responsibility that the product presented hereunder meets all technical requirements, is safe for use when utilised under the terms and conditions determined by ORBIT MERRET, spol.s r.o. and that our company has taken all measures to ensure conformity of all products of the types referred-to hereunder, which are being brought out to the market, with technical documentation and requirements of the appurtenant Czech statutory orders.

**Product:** 4/6-digit programmable large display

**Type:** **OMD 202**

**Version:** UNI, PWR, UQC, RS

**This has been designed and manufactured in line with requirements of:**

Statutory order no. 17/2003 Coll., on low-voltage electrical equipment (directive no. 73/23/EHS)  
Statutory order no. 616/2006 Coll., on electromagnetic compatibility (directive no. 2004/108/EHS)

**The product qualities are in conformity with harmonized standard:**

El. safety: EN 61010-1  
EMC: EN 61326-1  
Electronic measuring, control and laboratory devices – Requirements for EMC "Industrial use"  
EN 50131-1, cap. 14 and cap. 15, EN 61000-4-2, EN 61000-4-3, EN 61000-4-4, EN 61000-4-5, EN 61000-4-6, EN 61000-4-8, EN 61000-4-11, EN 61000-3-2, EN 61000-3-3, EN 55022, cap. 5 and cap. 6

The product is furnished with CE label issued in 2001.

**As documentation serve the protocols of authorized and accredited organizations:**

EMC VTÚE Praha, experimental laboratory No. 1158, protocol No. 08-041/2001 of 24/11/2001  
VTÚPV Vyškov, experimental laboratory No. 1103, protocol No. 730-325/2001 of 02/05/2001  
VTÚPV Vyškov, experimental laboratory No. 1103, protocol No. 730-350/2001 of 07/05/2001  
VTÚPV Vyškov, experimental laboratory No. 1103, protocol No. 730-372/2001 of 02/05/2001  
VTÚPV Vyškov, experimental laboratory No. 1103, protocol No. 730-934/2001 of 20/11/2001

Place and date of issue: Prague, 19. Juli 2009

Miroslav Hackl  
Company representative

Assessment of conformity pursuant to §22 of Act no. 22/1997 Coll. and changes as amended by Act no.71/2000 Coll. and 205/2002 Coll