



# OMM 37

---

3 1/2 DIGIT

DC VOLTMETER/AMMERMETER  
PROCESS MONITOR  
THERMOMETER FOR Pt 100



## SAFETY INSTRUCTIONS

Please, read the enclosed safety instructions carefully and observe them!  
 These instruments should be safeguarded by isolated or common fuses (breakers)!  
 For safety information the EN 61 010-1 + A2 standard must be observed.  
 This instrument is not explosion-safe!

## TECHNICAL DATA

Measuring instruments of the OMM 37 series conform to the European regulation 89/336/EWG and the Ordinance 168/1997 Coll.

They are up to the following European and Czech standards:

EN 55 022, class B

EN 61000-4-2, -4, -5, -6, -8, -9, -10, -11

The instruments are applicable for unlimited use in agricultural and industrial areas.

## CONNECTION

Supply of energy from the main line has to be isolated from the measuring leads.



### ORBIT MERRET, spol. s r.o.

Vodňanská 675/30  
 198 00 Prague 9  
 Czech Republic

Tel: +420 - 281 040 200

Fax: +420 - 281 040 299

e-mail: [orbit@merret.cz](mailto:orbit@merret.cz)

[www.orbit.merret.cz](http://www.orbit.merret.cz)



1.	Contents .....	3
2.	Instrument description .....	4
3.	Connection .....	5
4.	Setting .....	6
	Setting the decimal point.....	6
	Change of projection on the display.....	8
5.	Technical data .....	8
6.	Instrument dimensions and installation .....	10
7.	Certificate of guarantee .....	11

## 2.1 Description

The OMM 37 model series include simple 3 1/2 digit panel instruments in these alternatives:

DC	DC voltmeter/ammeter
PM	Process monitor
RTD	Thermometer for Pt 100 sensors

For their dimensions the instruments are suitable for mosaic panel installation.

### ADJUSTABLE DISPLAY PROJECTION

Setting	by potentiometers from the back of the instrument (in the range of approx. $\pm 10\%$ )
Projection	$\pm 1999$

## 2.2 Operation

The instrument is designed for simple measurement without further control.

Placement of the decimal point is selectable by a jumper under the front panel.

## 2.3 Option


**Isolated supply** of the instrument with range of 10...30 VDC is designated for applications where galvanic separation must be used.

The lead for feeding the instrument should not be in the proximity of the incoming low-potential signals.


Contactors, motors with larger input power and other efficient elements should not be in the proximity of the instrument.

The lead into the input of the instrument (the measured quantity) should be in sufficient distance from all power leads and appliances. Provided this cannot be secured it is necessary to use shielded leads with connection to ground.

The instruments are tested in compliance with standards for use in industrial area, yet we recommend to abide by the above mentioned principles.



OM 37DC, PM




OM 37RTD

**SETTING BRIGHTNESS AND DECIMAL POINT**


After removing the top cover frame the following settings are accessible

- decimal point, by jumper X1
- display brightness, by trimmer P1 under the front panel

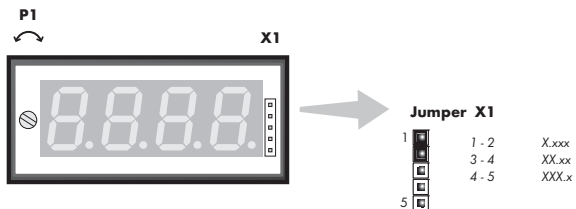**MODIFICATION FO THE MEASURING RANGE**

The adjusting trimmers for correction of display projection are accessible at the input brackets of the instrument

- Full range** setting display projection (approx.  $\pm 10\%$ )
- Offset** shifting zero (compensation of 2-wire lead for OMM 37RTD), the trimmer is fitted only in the OMM 37PM and RTD model

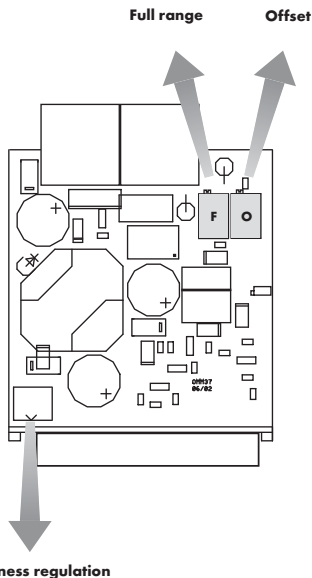



**INPUT**

the range is fixed, according to order

±199,9 mV	1 MOhm
±1,999 V	1 MOhm
±19,99 V	1 MOhm
±199,9 V	1 MOhm
±199,9 µA	< 260 mV
±1,999 mA	< 260 mV
±19,99 mA	< 260 mV
±199,9 mA	< 260 mV

the range is fixed, according to order

0...5 mA	< 260 mV
0...20 mA	< 260 mV
4...20 mA	< 260 mV
±2 V	1 MOhm
±5 V	1 MOhm
±10 V	1 MOhm

Pt 100	-20°...140°C
Type Pt:	100 Ohm, platinum element, $\alpha = 0,003850 \text{ Ohm/Ohm/}^\circ\text{C}$
Connection:	2 wire

**PROJECTION**

Display:	±1999, intensive red or green LED, digit height 9,1 mm
Decimal point:	adjustable - by jumper
Brightness:	adjustable - by trimmer inside the instrument

**INSTRUMENT ACCURACY**

TC:	50 ppm/°C
Accuracy:	±0,1 % of range + 1 digit ±0,8 % of range + 1 digit
Resolution:	1°C
Rate:	2,5 measurements/s
Overload:	10x (t < 100 ms), 2x (long-term)
Calibration:	at 23°C and 40 % r.h.

**POWER SUPPLY**

7...12 V AC/DC, max. 100 mA
10...30 V AC/DC, max. 160 mA (DC), 280 mA (AC), (24 VDC/55 mA), isolated

**DC****MECHANIC PROPERTIES**

Material:	Noryl GFN2 SE1, incombustible UL 94 V-1
Dimensions:	48 x 24 x 7,5 mm
Panel Cut-out:	43,5 x 22,5 mm



**OPERATING CONDITIONS**

Connection:	connector terminal board, section up to 2,5 mm <sup>2</sup>
Stabilization period:	within 15 minutes after switch-on
Working temp.:	0°...50°C
Storage temp.:	-10°...85°C
Cover:	IP42, (front panel only)
El. safety:	EN 61010-1, A2
Dielectric strength:	2,5 kVAC after 1 min between supply and input
Insulation resistance:	for pollution degree II, measuring cat. III. Power supply, input > 300 V (PI), 250 V (DI)
EMC:	EN 61326-1

**PM****RTD****RTD****RTD**






**Front view****Panel cut****Side view**

Panel thickness: 0,5...20 mm

Product **OMM 37** DC PM RTD  
 Type .....  
 Manufact. No. ....  
 Date of sale .....

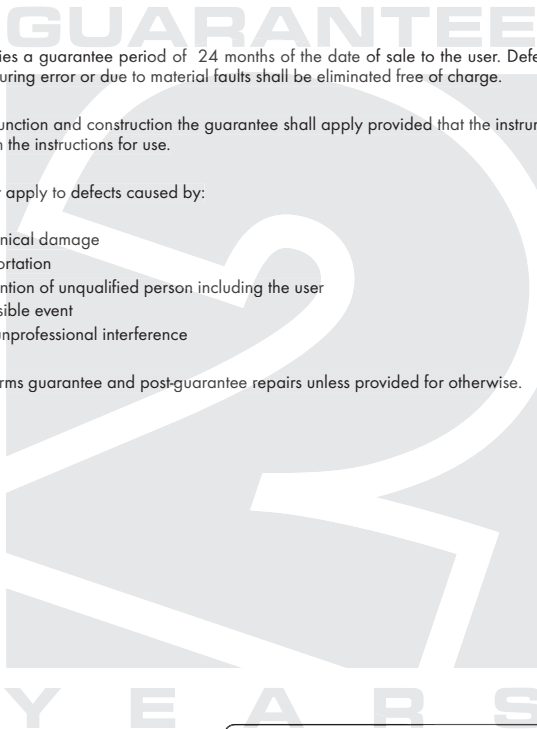

For this instrument applies a guarantee period of 24 months of the date of sale to the user. Defects occurring during this period due to manufacturing error or due to material faults shall be eliminated free of charge.

For instrument quality, function and construction the guarantee shall apply provided that the instrument was connected and used in compliance with the instructions for use.

The guarantee does not apply to defects caused by:

- mechanical damage
- transportation
- intervention of unqualified person including the user
- irreversible event
- other unprofessional interference

The manufacturer performs guarantee and post-guarantee repairs unless provided for otherwise.

Stamp, signature

