


# OUT.01


## 4X RELAYS WITH SWITCH-OVER CONTACT



**DIGITAL OUTPUTS**  
 4x Relays with switch-over contact  
**Rate**  
 < 10 ms



### CARD SETTINGS



The following parameters are edited in the setting


Select the **Position of the card** to be set. Use buttons ◀ ▶ to scroll among the fitted cards.


**Type of the card** fitted in the specified position.

Data transfer **priority** of the selected card. Bigger number of plugged-in cards slows down data flow on the bus. It can be optimized by setting priorities. The real value of the data flow can be then controlled in diagnostics. The maximum achievable data flow in slots A is 1100 frames/s, in slots B 550 frames /s.

**Channel** to be set. Use buttons ◀ ◀◀ ▶▶ ▶ to scroll among the channels. Number of possible selectable channels is determined by the card, which is being set

Limit MIN	setting the lower limit for switching
Limit MAX	setting the upper limit for switching
Hysteresis	shows the hysteresis range around the limit (on both sides, Limit. $\pm 1/2$ Hysteresis)
Activation delay	0,0...99,9 s setting the activation output delay
Deactivation delay	0,0...99,9 s setting the deactivation output delay
Permit MIN	<input checked="" type="checkbox"/> output is evaluated by the setting Limit MIN and MAX
Permit MAX	<input type="checkbox"/> output is set in binary form directly from the node
Inverted	<input checked="" type="checkbox"/> relay is in the active state OFF <input type="checkbox"/> relay is in the active state ON



Button  is used to navigate to the settings of the selected channel.

### INSTALLATION OF A NEW CARD

**When installing a new card, always make sure the recorder is disconnected from the power supply!**

1. Remove the recorder's back cover and break off the plugs covering the position where you intend to insert the new card. It is recommended to place analogue cards into faster slots in column „A“ (Speed of the bus: Slot „A“ 1 ms, Slot „B“ 2 ms).
2. Remove the card from its shipping container and from the ESD packaging and slide it carefully into the selected slot until you feel a gentle click
3. Replace the back cover and turn the device on
4. Setting of the card is described in the preceding paragraph

# OUT.01

## TECHNICAL DATA

### OUTPUTS

Number	4, isolated
Type	Relays with switch-over contact (Form C) ON / OFF
Maximum switching U and I	250 VAC / 30 VDC / 3 A
Maximum switching power	2 500 VA / 240 W
Relays	1 / 8 HP 277 VAC, 1 / 10 HP 125 V, Pilot Duty D300
Rate	< 10 ms

### TECHNICAL SPECIFICATION

Watch-dog	reset after 500 ms
Calibration	at 25°C and 40 % r.h.

### POWER SUPPLY

Power supply	5 VDC, 24 VDC
Consumption	max. 150 mA

### MECHANIC PROPERTIES

Dimensions	65 x 98 mm
Installation	to OMR 700

### OPERATING CONDITIONS


Connection	connector terminal board, cross section < 2,5 mm <sup>2</sup>
Working temperature	-20°...60°C
Storage temperature	-20°...85°C
IP rating	IP00
Construction	safety class I
El. safety	EN 61010-1, A2
Dielectric strength	2,5 kVAC over 1 min between bus and inputs 2,5 kVAC over 1 min between outputs
Insulation resistance*	for pollution degree II, measuring cat. III. Input / Bus - 300 V (PI), 150 (DI)
EMC	EN 61326-1 (Industrial use)
Seismic resistance	IEC 980: 1993, par.6

\* PI - Primary insulation, DI - Double insulation

## OUT.01

### CONNECTION

OUT.1

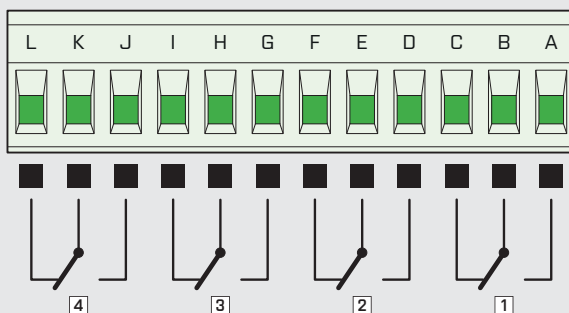

## OUT.01

### ORDER CODE

### OUT.01

Specifications

Used only for customised versions



00



ORBIT MERRET, spol. s r. o.  
Vodňanská 675/30  
198 00 Praha 9  
Czech republic

tel.: +420 281 040 200

fax.: +420 281 040 299

orbit@merret.eu

[www.orbit.merret.eu](http://www.orbit.merret.eu)

